

MITSUBISHI ELECTRIC INDICATORS and TRANSDUCERS





Table of Contents (Mechanical Indicators)

| Overview and Features | 3 |
|--|-----|
| Safety Precautions | 5 |
| Selection Precautions | 9 |
| Special Specifications | .10 |
| Selection | |
| ■Products List | |
| Rectangular Indicators | |
| Wide-angle Indicators | |
| Indicators with Changeover SwitchMechanical Demand Meters and Demand Meter Relays | |
| Meter Relays | |
| Indicators with Maximum and Minimum Needles, | |
| Special Application Meters | |
| Bar-shaped Indicators | |
| Glossary of Terms | |
| Standards | .24 |
| ■Reference Chart for Test Voltages and | |
| JIS Mark | .25 |
| Mechanical Indicators | |
| Common Specifications | |
| Common standard specifications | |
| Covers | |
| Scale plate indications | |
| ■Standard Scale Diagrams | |
| Outer Dimension Drawings | |
| Overall Connection Examples | |
| ■ Mechanical Indicator Specifications | .00 |
| •DC Ammeters | 43 |
| YM-206NDA, YM-208NDA, YM-210NDA, YM-8NDA, | |
| YM-10NDA, YM-12NDA, LM-80NDA, LM-110NDA | |
| OC Voltmeters | 47 |
| YM-206NDV, YM-208NDV, YM-210NDV, YM-8NDV, YM-10NDV, YM-12NDV, LM-80NDV, LM-110NDV | |
| •AC Ammeters | 49 |
| YS-206NAA, YS-208NAA, YS-210NAA, YS-8NAA, | |
| YS-10NAA, YS-12NAA, LS-80NAA, LS-110NAA, | |
| YR-206NAA, YR-208NAA, YR-210NAA, YR-8NAA, | |
| YR-10NAA, YR-12NAA, LR-80NAA, LR-110NAA ■AC Voltmeters | 51 |
| YS-206NAV, YS-208NAV, YS-210NAV, YS-8NAV, | |
| YS-10NAV, YS-12NAV, LS-80NAV, LS-110NAV, | |
| YR-206NAV, YR-208NAV, YR-210NAV, YR-8NAV, | |
| YR-10NAV, YR-12NAV, LR-80NAV, LR-110NAV | |
| •Wattmeters YP-206NW, YP-208NW, YP-210NW, YP-8NW, | 53 |
| YP-10NW, YP-12NW, LP-80NW, LP-110NW | |
| Varmeters | 57 |
| YP-206NVAR, YP-208NVAR, YP-210NVAR, YP-8NVAR, | |
| YP-10NVAR, YP-12NVAR, LP-80NVAR, LP-110NVAR | |
| Power Factor Meters (for balanced circuits) | 61 |
| YP-206NPF, YP-208NPF, YP-210NPF, YP-8NPF, YP-10NPF, YP-12NPF, LP-80NPF, LP-110NPF | |
| Power Factor Meters (for unbalanced loads) | 63 |
| YP-206NPFU, YP-208NPFU, YP-210NPFU, YP-8NPFU, | |
| YP-10NPFU, YP-12NPFU, LP-80NPFU, LP-110NPFU | |
| • Frequency Meters | 66 |
| YP-206NF, YP-208NF, YP-210NF, YP-8NF, YP-10NF, YP-12NF, LP-80NF, LP-110NF | |
| Receiving Indicators | 67 |
| YM-206NRI, YM-208NRI, YM-210NRI, YM-8NRI, | |
| YM-10NRI, YM-12NRI, LM-80NRI, LM-110NRI, | |
| YR-206NRI, YR-208NRI, YR-210NRI, YR-8NRI, | |
| YR-10NRI, YR-12NRI, LR-80NRI, LR-110NRI ●Indicators with Changeover Switch | 60 |
| AC ammeters | |
| YR-8UNAA. YR-10UNAA. YR-12UNAA | |

| AC voilineters | | / 0 |
|------------------------------------|--|-----|
| YR-8UNAV, YR-10U | INAV, YR-12UNAV | |
| Mechanical Demar | nd Meters | 71 |
| AC ammeters | | 72 |
| LB-8ZNAA, LB-11ZN | | |
| AC voltmeters | | 72 |
| LB-8ZNAV, LB-11ZN | | |
| Wattmeters | | 73 |
| | NW, LB-11ZRNW, LB-11YRNW | |
| = | | 73 |
| , | NRI, LB-11ZRNRI, LB-11YRNRI | |
| | nd Meter Relays | 75 |
| AC ammeters LB-112 | | |
| | | |
| DC ammeters | YM-210MRNDA, YM-210MRHNDA | 79 |
| | LM-11MRNDA, LM-11MRHNDA | |
| DC voltmeters | YM-210MRNDV, YM-210MRHNDV | 80 |
| | LM-11MRNDV, LM-11MRHNDV | |
| AC ammeters | YR-210MRNAA, YR-210MRHNAA | 81 |
| | LR-11MRNAA, LR-11MRHNAA | |
| AC voltmeters | YR-210MRNAV, YR-210MRHNAV | 82 |
| | LR-11MRNAV, LR-11MRHNAV | |
| Wattmeters | YM-210MRNW, YM-210MRHNW | 83 |
| | LM-11MRNW, LM-11MRHNW | |
| Varmeters | YM-210MRNVAR, YM-210MRHNVAR | 83 |
| | LM-11MRNVAR, LM-11MRHNVAR | |
| Power factor meters | YM-210MRNPF, YM-210MRHNPF | 85 |
| | LM-11MRNPF, LM-11MRHNPF | |
| | YM-210MRNPFU, YM-210MRHNPFU | |
| | LM-11MRNPFU, LM-11MRHNPFU | |
| Frequency meters | YM-210MRNF, YM-210MRHNF | 86 |
| | LM-11MRNF, LM-11MRHNF | |
| Receiving indicators | YM-210MRNRI, YM-210MRHNRI | 87 |
| • Indiantors with May | LM-11MRNRI, LM-11MRHNRI | 00 |
| | ximum and Minimum Needles | 89 |
| DC ammeters | LM-11ZNDA, LM-11YNDA | |
| AC ammeters DC voltmeters | LM-11ZNAA, LM-11YNAA | |
| Receiving indicators | LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI | |
| • | ectors | 01 |
| LM-11NGD | 50.013 | |
| | | 03 |
| LI-11NSY | | |
| | cators | 95 |
| LM-11NE | | |
| | tors | 96 |
| · | 1015 | |
| | SN, FM-215SN, FM-217SN | |
| | DN, FM-215DN, FM-217DN | |
| | | 98 |
| | SN, FR-215SN, FR-217SN | |
| | , | |

Table of Contents (Transducers)


| Overview and Features | 105 |
|---|---------------|
| Safety Precautions | 107 |
| Safety Precautions | |
| Requests Regarding Selection | ropoduooro |
| Power, Instrumentation and Peripheral T (Single Function) | ransuucers |
| Products List | 111 |
| Model Name Configuration | |
| Specifications According to Product | |
| Active Power Transducers | ** |
| Current Transducers | 113 |
| T-51KAA, T-51HAA, T-101SAA | |
| Current Transducers (Saturated Power) T-51KSS, T-51HSS | 114 |
| Voltage Transducers | 115 |
| T-51KAV, T-51HAV, T-101SAV | |
| Active Power Transducers | 117 |
| T-101HW, T-101SW Reactive Power Transducers | 110 |
| T-101HVAR, T-101SVAR | 119 |
| Phase Angle Transducers | 121 |
| T-101HPA, T-101HPA(U), T-101SPA(U) | |
| ●Power Factor Transducers (for Unbalanced | Loads)123 |
| T-101HPF(U), T-101SPF(U) Frequency Transducers | 125 |
| T-51HF, T-101SF | 123 |
| Voltage Phase Angle Transducers | 126 |
| T-101SY | |
| Instrumentation Transducers | |
| DC Level Transducers T-51DL | 127 |
| DC Reverse Transducers | 128 |
| T-51DR | |
| •Isolators | 129 |
| T-101IS High-speed Isolators | 120 |
| T-101ISQ | 130 |
| ●Limiters | 131 |
| T-51LM | |
| • Adders | 132 |
| T-101AD Resistance-bulb Temperature Transducers | |
| (Insulated/Non-insulated) | 133 |
| T-51TP, T-101TPZ | |
| Thermocouple Temperature Transducers | 105 |
| (Insulated/Non-insulated) T-101TC, T-101TCZ | 135 |
| • First-order Lag Transducers | 137 |
| T-51DS | |
| ■Peripheral Transducers | |
| ●AC Current Demand Transducers (Moderate Time In | nterval)139 |
| T-101HAA(DS) AC Voltage Demand Transducers (Moderate Time I | nterval) 140 |
| T-101HAV(DS) | 1101741)140 |
| Current Transducers with Power Flow Detec | tion141 |
| T-101HAA(D) | |
| Leakage Current Transducers T-51LG | 143 |
| Leakage Current Transducers (with Built-in Low-pas | ss Filter)145 |
| T-51LGF | |
| ●Voltage (Rise/Drop) Detectors | 147 |
| T-101VDL, T-101VDH • Filters | 140 |
| Auxiliary Parts | |
| Handling | |
| | |

| Outer Dimensions | 15 |
|--|----|
| ■Multi-transducers [Insulated] | |
| Multi-transducers [Insulated] | 15 |
| T-120M | |
| ■Special Application Transducers | |
| Harmonics Transducers | 16 |
| T-120HA | |
| Active Power/Active Energy Transducers | 17 |
| T-51WWH | |
| ■Usage/Care/Storage/Request for | |
| Maintenance and Inspection | 17 |
| Performance | |
| Overall Connection Diagrams | 17 |
| Glossary of Terms | |
| = alossary or refinis | 10 |




Overview and Features

High Reliability and Abundant Product Line-up

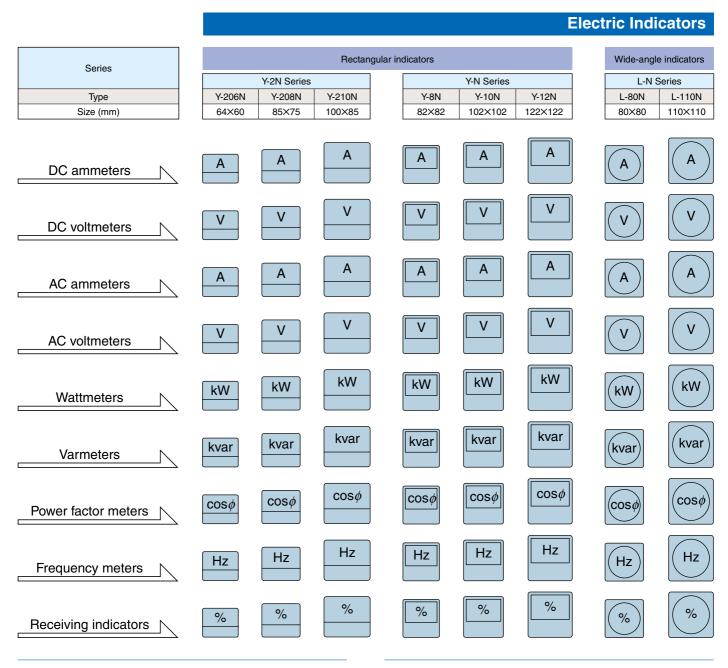

Depth dimension: 100mm or less

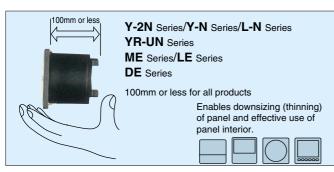

Equipped with isolation barrier and terminal cover

The isolation barrier and terminal cover reinforce isolation between terminals and protect conducting parts, thus preventing accidents and realizing improved safety.

Symbol details









- · Depth dimension: 100mm or less
- · Equipped with isolation barrier and terminal cover
- · Easy mounting and wiring




· Equipped with isolation barrier and terminal cover

(Mechanical Indicators)

| Indicators with changeover switch | | | | | | |
|-----------------------------------|--------------|---------|--|--|--|--|
| , | YR-UN Series | i | | | | |
| YR-8UN | YR-10UN | YR-12UN | | | | |
| 82×99 | 102×119 | 122×139 | | | | |

| Demand meters/Demand meter relays | | | | |
|-----------------------------------|---------|--|--|--|
| LB-N Series | | | | |
| LB-8N | LB-11N | | | |
| 80×80 | 110×110 | | | |


| Meter relays | | | | | | |
|--------------|---------|--|--|--|--|--|
| Y-210MRN | L-11MRN | | | | | |
| 100×83 | 110×110 | | | | | |


























































%





· With maximum and minimum pointers





· Synchroscopes






· Dual-element indicators



Easy mounting and wiring

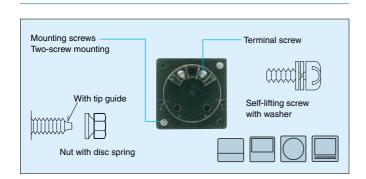

Easy-to-read scales

Scales are bright and easy-to-read, allowing them to perform their essential functions.





Safety Precautions

Please follow the following precautions when using Mitsubishi Electric products and be sure to carefully read the explanations regarding safety precautions in the boxes marked "Caution." In addition, ensure that any stickers or other items with relevant safety information are delivered to the final user.

1. Precautions concerning usage environment and usage conditions

- (1) Do not use in the following locations. Use in such locations may lead to malfunction or reduced service life.
 - · Locations where the ambient temperature is outside the range of -5 to +50°C.
 - · Locations where the average daily temperature exceeds 35°C.
 - · Locations where condensation or relative humidity is less than 30% or more than 70% (85% for electronic indicators).
 - ☆ Moisture-proof treatment is available for high-humidity environments for some electrical indicator models. See page 10 of this catalog or contact a Mitsubishi Electric representative for details.
 - · Locations with excessive dust, corrosive gas, salinity, or oil fumes.
 - * Corrosive gases include sulfur dioxide, ammonia, hydrogen sulfide and other gases that corrode metal, plastic and other materials.
 - ☆ Supplementary anti-corrosion treatment is available for special environments for some electrical indicators. See page 10 of this catalog or contact a Mitsubishi Electric representative for details.
 - · Locations where indicators are subject to excessive vibration or shock.
 - ☆ When used in a location subject to excessive vibration, moving parts may resonate and this may cause error and fluctuation of indicated values. In such cases, apply anti-vibration measures to the installed panel or change the installation location.
 - · Locations directly exposed to rain, water drops, ultraviolet rays, or sunlight.
 - · Locations at an altitude of 2000m or more for electric indicators or 1000m or more for electronic indicators.
 - · Locations with excessive external noise or radio waves.
 - · Locations where a large amount of static electricity is generated.
 - · Locations where there is a high level of waveform distortion or high-frequency waves caused by harmonic/thyristor circuits or other means.
- (2) Please consult a Mitsubishi Electric representative regarding the use of indicators for any of the following facilities.
 - · Nuclear power plants, medical devices, military facilities, airplanes or vehicles.
- (3) The products in this catalog are not certified indicators.
 - They do not comply with the mandatory specifications for electrical meters as specified in the Measurement Act of Japan.

2. Mounting precautions

Please pay attention to the following items during installation.

For safety reasons, installation should only be performed by a professional electrical wiring technician.

- · Mount the electrical indicators on metal panels.
- · Mount on the panel in such a way that ensures the electrical indicator terminals and charged parts cannot be touched accidently by an operator.
- · Install the special accessories for T-100 and T-150 inside the panel. In addition, install them so that it is ensured the accessories cannot be touched accidently by an operator.
- · The screws for mounting onto the panel must be tightened by appropriate tools at torques appropriate for the screw size.

* Recommended tightening torques M3 screws: 0.48~0.98N·m

M4 screws: 0.98~1.47N·m M5 screws: 1.47~1.96N·m

3. Connection precautions

Please pay attention to the following items when making connections.

For safety reasons, installation should only be performed by a professional electrical wiring technician.

- · The metal panel must be grounded.
- · Before using a voltmeter when connecting to a main power-supply circuit, make sure that an appropriate exterior fuse is installed.
- · Indicators that require an auxiliary power supply must not be directly connected to/use a main power supply. For these indicators, use a power supply that is isolated from the main power supply circuit via a voltage transformer or other means.

- · Varmeters and power factor meters will not operate correctly with a reverse phase sequence. Use with the correct phase sequence.
- Grounding of the secondary side of an instrument voltage transformer or current transformer is not necessary for low-voltage circuits.

- · Connections must be made correctly as shown in the connection diagrams of the catalog. Inappropriate connection and installation may cause equipment burnout, fire or leakage of electricity.
- · For connection, use crimp terminals suited for the electrical quantity and terminal size.
- \cdot Make sure to use the terminal screws supplied with the product.
- The terminal screws must be tightened by appropriate tools at torques appropriate for the screw size. Failure to do so may cause overheating, equipment burnout or fire.
 - * Recommended tightening torques M4 screws: 0.98~1.47N·m

M5 screws: 1.47~1.96N·m

- Do not perform connection work with live wires.
 Dangers include electrical shock, electrical burns, equipment burnout and fire.
- · For safety, make sure to attach the terminal cover.
- · Indicators combined with a current transformer (CT) must be correctly connected to the CT secondary-side signal. Incorrect connection or opening of the secondary side of the CT will generate high voltage on the secondary side of the CT, which may lead to CT failure, scorching or a fire.
- Indicators combined with a voltage transformer (VT) must be correctly connected to the secondary side of the VT. Incorrect connection or short-circuiting of the secondary side of the VT will cause a large overcurrent to flow through the secondary winding of the VT, leading to scorching of the secondary winding and VT failure, scorching or a fire.

4. Precautions concerning preparation before use

Please read the following carefully before use.

(1) Transportation

Be sure to prevent the indicators from vibration or shock as much as possible during transportation.

In situations where it is possible that indicators will be subject to excessive vibration or shock, remove the indicator from the panel before transportation.

When the indicators are received, check the indicators for any abnormalities in appearance or operation that may have been caused as a result of excessive vibration or shock during transportation.

(2) Check the product name and rating

As a precautionary measure, check the product name and rating (e.g., voltage, current, frequency, phase-wire) before use.

(3) Adjustment

If an indication corresponding to an input is to be adjusted in an indicator with a built-in adjustment resistor such as a DC ammeter or receiving indicator, perform adjustment without applying excessive force to the adjuster. Otherwise, the adjuster may break.

Additionally, avoid using the adjuster under normal circumstances.

(4) Insulation resistance test and voltage test

Please read the following carefully before performing an insulation resistance test or voltage test. Not doing so may cause indicator failure.



- · When performing an insulation resistance or voltage test between 1) an electrical circuit and an outer casing, or 2) a voltage circuit and a current circuit, short-circuit the input terminals in both the current and voltage circuits. Not doing so may cause the indicator to malfunction.
- The applied voltage for the voltage test varies according to the indicator model. Please note the voltages indicated in this catalog.
- · For the applied voltage of the impulse withstand test, apply a $1.2\times50\mu$ s standard lightning impulse voltage waveform with a full wave voltage of 5kV six times or less.
- · Be careful of where voltage is applied; applying voltage across terminals of equal potential, such as across VT input terminals, may cause failure.

Safety Precautions

5. Usage precautions

Please conform to the following during use.



- (1) Use within the rated range. Use outside of the rated range may cause malfunction or failure.
 - · Applying an electric current exceeding the rated value may cause a failure. Note that this excludes certain models (AC ammeters with expanded scales), for which a temporary current (less than one minute at three times the rated value) may be applied.
 - · With the LM-11MRN, LM-11MRHN, LR-11MRN, and LR-11MRHN meter relays, when interruption of the auxiliary power supply occurs, the contact output state immediately before interruption is memorized. Thus, depending on the state during recovery from interruption, the contact output may be abnormal. After recovery from interruption, to return the indicator to normal operation, perform the resetting operation after moving the setting needle past the driving needle using the setting knob (see p.90 of this catalog for details).
 - · With the LM-11ZN and LM-11YN indicators with maximum and minimum needles, LB-8ZN, LB-11ZN, LB-11ZN, LB-11ZRN, and LB-11YRN demand meters, and LB-11ZRMN demand meter relay, set the current application time of the electromagnetic remaining needle resetting terminal to "within 5 seconds." Burnout will occur if current application is continued for 5 seconds or longer.
- (2) If, when using a movable iron-core indicator by connecting it to the output side of an inverter, the carrier frequency of the inverter is set higher than 5kHz, the indicator may generate heat and failure may occur. Use a carrier frequency of 5kHz or less.
- (3) The upper-limit alarm and lower-limit alarm settings of the meter relay and demand meter relay must be set correctly. If the settings are incorrect, an alarm will not be generated when an alarm is needed.
- (4) A shunt (SHT) generates heat and must not be touched by bare hands as it will cause a burn. Additionally, select a well-ventilated location for installation and mount the unit giving consideration to heat radiation. (Refer to p.47 of the catalog.)
- (5) Do not remove or modify the cover of an indicator, otherwise failure, electrical shock or fire may occur.

6. Precautions concerning repair/response in case of failure/abnormality

If an abnormal noise or heat is generated or a failure occurs, take immediate measures such as shutting off the input, and contact the nearest Mitsubishi Electric System & Service Co. Ltd. branch or relevant Mitsubishi Electric branch.

7. Maintenance and inspection

Perform the following inspections to ensure correct use of indicators.

1 Daily inspection

Check for the following:

- · Damage to the indicator
- · Abnormal functioning
- · Abnormal noise or odor
- · Presence of debris, dust or water
- 2 Periodic inspection

In addition to the above items, check for the following:

- · Loose mounting or loose terminal wire connections
- · Overheating or deformation due to stress to terminals, outer casings or other components.



- \cdot Always perform terminal wire connection inspections when power to the devices has been interrupted.
- Do not touch charged parts of the terminals while current is being applied. There is danger of electrical shock, electrical burns, and damage to equipment.
- (1) The cover has an antistatic treatment; please follow these precautions when cleaning it.
 - · Wipe the cover surface with a soft cloth to remove any dust/dirt. If the dust/dirt cannot be removed, the cover should be replaced.
 - · To prevent cover deformation or discoloration, or peeling of the cover coating, do not use benzene, thinner or similar cleaning agents on the cover and avoid placing any type of chemically-treated cloth on the cover for a long period of time.
 - · Static electricity can cause unstable needle movement. If this happens, it may be necessary to coat the cover with a commercially available antistatic agent.

8. Storage precautions

- (1) Do not store indicators for long periods in the following locations. Long-term storage in such locations may lead to malfunction or reduced service life.
 - · Locations where the ambient temperature is outside the range of -20 to +60°C.
 - · Locations where the average daily temperature exceeds 35°C.
 - · Locations where the humidity is 90%RH or more and dew condensation occurs.
 - · Locations with excessive dust, corrosive gas, salinity, or oil fumes.
 - * Corrosive gases include sulfur dioxide, ammonia, hydrogen sulfide and other gases that corrode metal, plastic and other materials
 - · Locations with excessive vibration or shock.
 - · Locations directly exposed to rain, water drops, ultraviolet rays, or sunlight.
- (2) When storing the indicators, turn off the power, remove the wiring and place in a vinyl bag, box or other container.

9. Disposal precautions

- (1) Please note that the electric/electronic indicators do not use batteries.
- (2) Dispose of the indicators following the procedures for disposal of general industrial waste.

■ Warranty

- (1) The warranty period shall be one year from the date of purchase or 18 months from the date of manufacture, whichever is earlier. In addition, the repair of any failure due to a customer's intentional or negligent actions shall incur a service charge, irrespective of whether or not the warranty is still valid.
- (2) Mitsubishi Electric shall not be liable for:
 - Damage that cannot be attributed to Mitsubishi Electric; Lost opportunity or earnings resulting from failure of a Mitsubishi Electric product; Damage, secondary damage or compensation for an accident resulting from special circumstances regardless of whether or not the circumstances were foreseeable; Damage to products/Other services for products not manufactured by Mitsubishi Electric.

■ Service life

The expected service life of electric indicators is 10 years.

* The expected service life is the period or number of operations for which the indicator can be used without functions deteriorating to a level that impairs practical use, based on the condition that the equipment or material is used according to standard specification conditions. Please note that the expected service life is only a guide and performance is not guaranteed for this period.

(Excerpt/Summary of "Expected Service Life of Electrical Equipment," in the September, 1998 issue of the Journal of the Institute of Electrical Installation Engineers of Japan.)

Selection Precautions

1 Selection of indicator ratings

Application of an input exceeding a rating may cause failure or reduced service life.

In cases where a rating value may be exceeded temporarily due to a starting current of a motor or other reason, select an expanded scale indicator.

Meter relays respond instantaneously and thus output a signal immediately when the starting current or other current exceeds a set value.

When it is necessary to temporarily prevent detection, add an external circuit.

2 Distortion of input waveform

Error occurs readily when the input waveform is distorted.

AC ammeter/voltmeter error is comparatively low if the indicator operates using movable iron core or approximate effective value rectifications. However, please note that the internal parts of movable iron core indicators generate heat when a harmonic current is input, which may lead to deformation or scorching of the casing. For this reason, use a carrier frequency of 5kHz or less for inverter circuits.

3 Use a power factor meter for unbalanced loads if the 3-phase load is unbalanced

Power factor meter errors may occur if the load of a balanced circuit becomes unbalanced. Select a power factor meter for unbalanced loads if it is possible that the 3-phase load will be unbalanced.

4 Error may occur due to extremely low input current

Power factor meter errors may occur if the input current is significantly lower than the rated current.

When selecting the rated primary current of a CT, ensure that the secondary current during actual use will be 1/5 or more of the rated secondary current of the CT.

5 Malfunction may occur due to decrease of input voltage

Wattmeters or varmeters may malfunction if the input voltage decreases. Ensure that the input voltage does not decrease to 85% or less of the indicator's rated voltage.

6 Use a special specification product in an environment with high temperature, high humidity, or corrosive gas

Insulation degradation or failure may occur when the product is used under an environment with high temperature, high humidity, or corrosive gas (e.g., in a wastewater treatment plant, sewage treatment plant, chemical plant, rubber manufacturing plant).

Please select a model with special specifications such as anti-corrosion or moisture-proof treatment.

7 Special specification products

Please specify the necessary specifications or contact a Mitsubishi Electric representative if you require a special-specification model (see p.10).

Special Specifications

The information in the following table relates to special specifications for mechanical indicators. Please contact a Mitsubishi Electric representative for information regarding special specifications for electronic indicators.

| Application | | Specification | |
|--|---|---|--|
| Mounting attitude | The standard attitude for mounting indicators is Please specify the mounting angle if a non-stan | | ed. |
| | Standard (Horizonta | ounting Example of mounting nation angle designation | Example of mounting angle designation ANGL (150°) |
| High humidity | Moisture-proof treatment | | |
| | Use of indicators in high-humidity environmen To prevent this, a special moisture-proof coati | | |
| F 4////). | Applicable models: Y-2N Series, Y-N Series, L- | | useu. |
| A MINITED AND THE MENT OF THE PARTY OF THE P | ●A "moisture-proof" sticker is attached to produ | cts that have been treated. | |
| | ●This treatment cannot be applied to some more | dels. Please contact a Mitsubish | i Electric representative for details. |
| | | | |
| | | | Moisture-proof treatment |
| Corrosive gases | Supplementary anti-corrosion treatment | | |
| _ | This treatment is a simplified anti-corrosion treatment where there is a high level of an | | - |
| K an | environments where there is a high level of co chemical plants, indicators are generally prote | - | = |
| | The treatment involves use of a sealed structu | ire and anti-corrosion plating. | |
| | Applicable models: Y-2N Series, Y-N Series, at A supplementary anti-corrosion sticker is attact | | treated |
| 180 83 8 | This treatment cannot be applied to some more | • | |
| | | | |
| H ₂ S d d d d d d d d d d d d d d d d d d d | | | Supplementary anti-corrosion treatment |
| High-frequency circuits | Use the following models for high-frequency c exceeded. | ircuits with which the commercia | al frequency of 50 to 60Hz is |
| | Indicator AC ammeter AC voltmeter | Applicable models | Applicable range (max.) |
| 66 (11/1) | AC ammeter, AC voltmeter Wattmeter, varmeter, power factor meter | Rectifying Transducer | Approx. 1000Hz 400Hz |
| 2 200 L | Frequency meter | Transducer | 400Hz (scale: 360~440Hz) |
| | | | |
| | Please specify the frequency when ordering. | | |
| Products complying with foreign | Please specify the frequency when ordering. •Products that comply with foreign standards s | uch as ANSI and BS can also be | e manufactured. |
| | ●Products that comply with foreign standards s When ordering, please specify the relevant sta | andards and frequency. | |
| , , , | ●Products that comply with foreign standards s When ordering, please specify the relevant sta ●Models with JIS indications comply with IEC s | andards and frequency. tandards (no changes necessar | |
| Products complying with foreign standards Special characters and symbols | ●Products that comply with foreign standards s When ordering, please specify the relevant sta | andards and frequency. tandards (no changes necessar o not have the CE mark. | у). |
| standards | Products that comply with foreign standards s When ordering, please specify the relevant sta • Models with JIS indications comply with IEC s Please note that the products in this catalog d • Please clearly specify the language and font s uppercase or lowercase characters). | andards and frequency. tandards (no changes necessar o not have the CE mark. settings required (for example, Ja | y). apanese or English characters; |
| standards | Products that comply with foreign standards s When ordering, please specify the relevant sta Models with JIS indications comply with IEC s Please note that the products in this catalog d Please clearly specify the language and font suppercase or lowercase characters). Orders without language/font settings specifies | andards and frequency. tandards (no changes necessar o not have the CE mark. settings required (for example, Ja d will be manufactured accordin | y). apanese or English characters; |
| standards Special characters and symbols | Products that comply with foreign standards s When ordering, please specify the relevant sta Models with JIS indications comply with IEC s Please note that the products in this catalog of the second s | andards and frequency. tandards (no changes necessar o not have the CE mark. ettings required (for example, Ja d will be manufactured accordin Helvetica regular font). | y). apanese or English characters; g to Mitsubishi Electric's standard |
| standards | Products that comply with foreign standards s When ordering, please specify the relevant sta Models with JIS indications comply with IEC s Please note that the products in this catalog d Please clearly specify the language and font suppercase or lowercase characters). Orders without language/font settings specifies | andards and frequency. tandards (no changes necessar o not have the CE mark. ettings required (for example, Ja d will be manufactured accordin Helvetica regular font). lease submit detailed diagrams) | y). apanese or English characters; g to Mitsubishi Electric's standard |

Selection

Please refer to the following when selecting an electric indicator.

| | | Selec | tion procedure | | Danie |
|------------|----------------------------|----------------------------------|----------------------------------|-------------------------|-----------|
| Item | Measure | ment element | Indicator type | Series | Page |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | 40.40 |
| | | | Wide-angle indicators | L-N Series | 43~48 |
| | | | | YM-210MRN Series | 70.00 |
| | DC electrical quantity | DC ammeters, DC voltmeters | Meter relays | LM-11MRN Series | 79~80 |
| | measurement | | With maximum/minimum | LM-11ZN Series | 00.00 |
| | | | needles | LM-11YN Series | 89~90 |
| | | | Bar-shaped indicators | F-N Series | 97 |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | 40.50 |
| | | | Wide-angle indicators | L-N Series | 49~52 |
| | | | With changeover switch | YR-UN Series | 69~70 |
| | | | Demand meters | | 72 |
| | | | Demand meter relays | LB-N Series | 75 |
| | | AC ammeters, AC voltmeters | | YR-210MRN Series | |
| | | | Meter relays | LR-11MRN Series | 81~82 |
| | | | With maximum/minimum | LM-11ZN Series | |
| | | | needles | LM-11YN Series | 89~90 |
| | | | Bar-shaped indicators | F-N Series | 98 |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | |
| | | | Wide-angle indicators | L-N Series | 53~56 |
| | | | Demand meters | LB-N Series | 73~74 |
| | AC electrical quantity | | Meter relays | YM-210MRN Series | 70 71 |
| | measurement | | | LM-11MRN Series | 83~84 |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | |
| Mechanical | | | Wide-angle indicators | L-N Series | 57~60 |
| indicators | cators | | Varmeters Meter relays | YM-210MRN Series | |
| | | | | LM-11MRN Series | 83~84 |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | |
| | | Wide-angle indicators L-N Series | | | 61~65 |
| | | Power factor meters | wide-angle indicators | YM-210MRN Series | |
| | | | Meter relays | LM-11MRN Series | 85 |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | |
| | | | Wide-angle indicators | L-N Series | 66 |
| | | Frequency meters | vvide arigic indicators | YM-210MRN Series | |
| | | | Meter relays | LM-11MRN Series | 86 |
| | | | Rectangular indicators | Y-2N Series, Y-N Series | |
| | | | Wide-angle indicators | L-N Series | 67~68 |
| | | | Demand meters | LB-N Series | 73~74 |
| | | | Demand meters | YM-210MRN Series | 70 71 |
| | Telemetry measurement | Receiving indicators | Meter relays | LM-11MRN Series | 87 |
| | Receiving indication | Ticcerving maleators | NACIAL | LM-11ZN Series | |
| | | | With maximum/minimum needles | LM-11YN Series | 89~90 |
| | | | Dual-element indicators | LM-11NE | 95 |
| | | | Bar-shaped indicators | F-N Series | 97 |
| | | | · | LM-11ZN Series | 37 |
| | Ground voltage measurement | Ground voltmeters | With maximum/minimum needles | | 89~90, 92 |
| | Ground voilage measurement | Forth lookage detectors | | LM-11YN Series | 01 02 |
| | Cumphy | Earth-leakage detectors | (Special application indicators) | LM-11NGD | 91~92 |
| | Synchroscopy | Synchroscope | (Special application indicators) | LI-11NSY | 93~94 |

| Item | | | Selection procedure | Page | | | | |
|-----------------------------|--|-----------------|--|------------------|--|--|--|--|
| nom | Indicator type | | Selection item | r ago | | | | |
| | | Y-2N Series | 64×60 (Y□-206N□□) , 85×75 (Y□-208N□□) 100×85 (Y□-210N□□) Note 1 | 35 | | | | |
| | Rectangular indicators | Y-N Series | 82×82 (Y□-8N□□) , 102×102 (Yh-10N□□) 122×122 (Y□-12N□□) Note 1 | 36 | | | | |
| | Wide-angle indicators | L-N Series | 80×80 (L□-80N□□) , 110×110 (L□-110N□□) Note 1 | 37 | | | | |
| Front face outer dimensions | Indicators with changeover switch | YR-UN Series | 82×109 (YR-8UN□□) , 102×119 (YR-10UN□□) 122×139 (YR-12UN□□) Note 1 | 69~70 | | | | |
| differisions | Demand meters Demand meter relays | LB-N Series | 80×80 (LB-8ZN□□) , 110×110 (LB-11□N□□) Note 1 | 72~75 | | | | |
| | Matauralaura | Y-210MRN Series | 100×83 (Y□-210MR□N□□) Note 1 | 70 | | | | |
| | Meter relays | L-11MRN Series | 110X110 (L□-11MR□N□□) Note 1 | 78 | | | | |
| | Bar-shaped indicators | F-N Series | 100×30 (F□-210*N) , 130×36 (F□-213*N) Note 1 150×40 (F□-215*N) , 170×40 (F□-217*N) Note 2 | 99~100 | | | | |
| | DC ammeters, DC voltmeters AC ammeters, AC voltmeters Wattmeters, varmeters Receiving indicators | In common | A selection should be made so that the maximum scale value is approximately 1.2 to rated value or the steady-state value of the circuit to be measured. For the maximum scale, any of the following values are recommended (or any of the multiplied by 10 resulting in a whole number). 1, 1.2, 1.5, 2, 2.5, 3, 4, 5, 6, 7.5, 8 (4.5 and 9 are also recommended in the case of values. | se values | | | | |
| | DC ammeters | | Select a value that is 1.5 times or more than the load current. When combining with a shunt, in general, make a selection that matches the rated val | ue of the shunt. | | | | |
| Scale | DC voltmeters | | Select a value 1.2 to 1.5 times the circuit voltage. | | | | | |
| | AC ammeters | | The selection should have a maximum scale value approx. 1.5 times the load current. When combining with a current transformer (CT), make a selection that matches the rated value of the CT | | | | | |
| | AC voltmeters | | Select a value 1.2 to 1.5 times the circuit voltage. When combining with a voltage transformer (VT), select a value approx. 1.36 times the rated value of the VT. | | | | | |
| | Wattmeters, varmet | ers | Select according to the calculation result of: VT ratio × CT ratio × indicator rating (Po). Refer to the "Scale Selection Reference Table" (wattmeter: p.56; varmeter: p.60). | | | | | |
| | Receiving indicators | 3 | Select so as to match the rated value of the device that the indicator is combined with (e.g., tra | nsducer, sensor) | | | | |
| | Power factor met | ers | The standard scale is LEAD 0.5–1–LAG 0.5. A LEAD 0–1–LAG 0 scale can also be manufactured (values between 0 and 0.5 are for | reference only). | | | | |
| | Frequency mete | ers | Select according to the frequency of the circuit to be measured. In general, for 50Hz, select a 45–55Hz scale; for 60Hz, select a 55–65Hz scale and for 50/60Hz common use, select a 45–65Hz scale. | | | | | |
| | Ground voltmete | ers | Select so that the maximum scale value is the measured circuit's voltage or 1.35 time | es this value. | | | | |
| | DC ammeters, DC vo | tmeters | The indicator rating is the input value corresponding to the manipular code value | 43~48, 79~80, 97 | | | | |
| | AC ammeters, AC vol | tmeters | The indicator rating is the input value corresponding to the maximum scale value. | 49~52, 81~82, 98 | | | | |
| | Wattmeters | | The secondary side rated voltage of a VT is selected as the rated voltage and the secondary side rated current of a CT is selected as the rated current. | 53~56, 83~84 | | | | |
| Indiantar | Varmeters | | Additionally, the rated power (or rated reactive power) Po is selected to be within a range of 0.8 to 1.2 times the secondary side rated power of the transformer (VT, CT). | | | | | |
| Indicator ratings | Power factor met | ers | Generally, the secondary side rated voltage of a VT is selected as the rated voltage and the secondary side rated current of a CT is selected as the rated current. | | | | | |
| | Frequency meter | rs | Generally, the secondary side rated voltage of a VT is selected as the indicator rating. | 66, 86 | | | | |
| | Receiving indicat | ors | | 67~68, 87, 97 | | | | |
| | Indicators with changeo | | The indicator rating is the input value corresponding to the maximum scale value. | 69~70 91~92 | | | | |
| | Earth-leakage dete | | | | | | | |
| | Synchroscope: Without setting needle | 5 | Generally, the secondary side rated voltage of a VT is selected as the indicator rating. Black (B) needles are standard specification. Transparent (T) and special color (F) needles can also be manufactured. (Transparent cover (G) needles can only be manufactured for the Y-N and Y-2N Series.) | 93~94 | | | | |
| Cover | With setting needle | | Black (BR), transparent (GR), and special color (FR) needles are available. (Please note that not all options are available for all models.) | | | | | |
| Special specifications | 1 | | for information regarding specifications for environments where there are special conditions ment), corrosive gases (supplementary anti-corrosion treatment) or high-frequency circuits. | 10 | | | | |

Note 1. The empty squares (□) are replaced with letters/numbers to specify the model and specifications.

Note 2. The asterisks (*) are replaced with S or D to identify whether the indicator has one (S) or two (D) needles.



1. Rectangular Indicators (Y-2N Series, Y-N Series)

| Indicator type | | DC ammeters | | DC voltmeters | | | AC am | meters | | | AC vol | tmeters | | | | |
|--------------------------------|---|--------------|---------------------------|---------------|---|--------------|---|-------------------------|--|-------------------------------------|--|---|---------------|--|--|---|
| indicator type | | pe | DC animeters | | DC voitmeters | | Non-uniform scale | | Uniform scale | | Non-uniform scale | | Uniform scale | | | |
| Appearance | | A A | | V | | A ==. | | A A | | V | | V | | | | |
| | Accurac | y (cla | ass) | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | |
| | Y-2N | | 64×60 | YM-206NDA | _ | YM-206NDV | | YS-206NAA | _ | YR-206NAA | _ | YS-206NAV | _ | YR-206NAV | _ | |
| πe | Y-2IN Series | - | 85×75 | YM-208NDA | _ | YM-208NDV | _ | YS-208NAA | _ | YR-208NAA | _ | YS-208NAV | _ | YR-208NAV | _ | |
| Model name | Selles | (mm) | 100×85 | YM-210NDA | _ | YM-210NDV | _ | YS-210NAA | _ | YR-210NAA | _ | YS-210NAV | | YR-210NAV | _ | |
| odel | Y-N | ize | Size | 82×82 | YM-8NDA | _ | YM-8NDV | | YS-8NAA | _ | YR-8NAA | _ | YS-8NAV | _ | YR-8NAV | _ |
| Š | Series | | 102×102 | YM-10NDA | _ | YM-10NDV | _ | YS-10NAA | _ | YR-10NAA | _ | YS-10NAV | | YR-10NAV | _ | |
| | Series | | 122×122 | _ | YM-12NDA | _ | YM-12NDV | _ | YS-12NAA | | YR-12NAA | _ | YS-12NAV | _ | YR-12NAV | |
| | Operation principle | | n principle Movable coil | | ole coil | Movable coil | | Movable iron core | | Rectifier | | Movable iron core | | Rectifier | | |
| Indicator ratings | [| Direct | | | Note 1 100, 200, 300, 500 μ A 1, 3, 5, 10, 20, 50mA 100, 200, 500mA 1, 2, 5, 7.5, 10, 15, 20, 30A | | Note 2 1, 3, 5, 10, 15V 30, 50, 100, 150V 300, (500), (600)V | | Note 1 500mA 1, 3, 5, 10A 15, 20, 30A | | Note 1, 2 (200), (300), 500 µA 1, 3, 5, 10, 20, 30, 50 mA 75, 100, 200, 500 mA 1, 3, 5, 10, 15, 20, 30 A | | | | Note 2 50, 75V 150, 190V (400)V | |
| dic | Combine | ed wi | th shunt, | 1~7500A | | 750~2000V | | 5A, | , 1A | 5A, 1A | | 150V | | 150V | | |
| = | multiplier, | or tra | ansformer | (combined | with shunt) | (combined w | ith multiplier) | | | (combined with current transformer) | | r) (combined with instrument voltage transformer) | | (combined with instrument voltage transformer) | | |
| | 01- | Ord | inary | (|) | (|) | (|) | (|) | 0 | | 0 | | |
| | Scale | Exp | anded | _ | _ | _ | _ | |) | | Note 3 | 3 | | _ | | |
| | | Blac | k (B) | 0 0 | | 0 0 | | 0 | | 0 | | | | | | |
| | Cover | Tran | sparent (G) | |) | 0 | | 0 | | 0 | | 0 | | 0 | | |
| | | Specia | l color coating (F) | | Δ | | 7 | Δ | | Δ | | Δ | | Δ | | |
| | | d nee | | |) | | | 0 | | 0 | | 0 | | 0 | | |
| Su | Special acc | urac | y class ^{Note 4} | ○(Class 1.5) | O(Class 1) | ○(Class 1.5) | ○(Class 1) | ○(Class 1.5) ○(Class 1) | | ○(Class 1.5) ○(Class 1) | | ○(Class 1.5) | O(Class 1) | ○(Class 1.5) | ○(Class 1) | |
| atio | Foreign standards | | | Δ Δ | | | Δ | | | 7 | | | | 7 | | |
| cific | Special environment | | | Δ | | | | Δ | | | | 7 | | 7 | | |
| sbe | Foreign standards Special environment Double scale Colored lines/bands Shut | | |) | | | |) | | | | | | | | |
| cial | Colored | | | |) | | | |) | | - | | - | | | |
| Spe | | Shun | | |) | _ | | - | | _ | | _ | | _ | | |
| • | | ad wi | | |) | _ | | _ | _ | | | _ | | _ | _ | |
| | Lead wire ac | • | | |) | - | - | | _ | _ | | _ | | | | |
| Page with specifications table | | 4 | 3 | 4 | / | 4 | 19 | 5 | U | 5 | 1 | 5 | 2 | | | |

Remarks All indicators, excluding special grade and foreign standard specification indicators, comply with the Japanese Industrial Standards relating to direct-acting electrical indicators and have the JIS mark.

However, the JIS mark may not apply depending on the operating circuit voltage or rated voltage. Refer to the Reference Chart for Test Voltages and JIS Mark on p.25/26 for details.


- Note 1. The operating circuit voltage is 300V or less for the Y-2N Series and 600V or less for the Y-N Series.
- Note 2. Parentheses () indicate that some models cannot be manufactured with this rating. Refer to the specifications tables starting on p.45 for details.
- Note 3. Some models cannot be manufactured for some ratings. Refer to the specifications tables starting on p.45 for details.
- Note 4. Please designate the frequency if a special accuracy class is required for an AC indicator.

| 0 | Standard specifications |
|---|-------------------------------|
| 0 | Quasi-standard specifications |
| Δ | Special specifications |

| | Ind | licato | or typ | oe . | Wattm | neters | Varm | eters | | tor meters Unbalanced loads | Frequenc | cy meters | | Receiving | indicators | |
|-------------------|--|----------|------------------|-----------------------|--------------|--------------|------------------------|-----------|----------------------------|-----------------------------|--|--------------|-----------------------|--------------|--|-----------|
| | Appearance | | kW | | uso kyar us | | LEG COSØ LIG | | Hz | | of the state of th | | | | | |
| | Accuracy (class) | | ıss) | 2.5 | 1.5 | 2.5 | 1.5 | į | 5 | 1 | 0.5 | 2.5 | 1.5 | 2.5 | 1.5 | |
| | | | | 64×60 | YP-206NW | _ | YP-206NVAR | _ | YP-206NPF | YP-206NPFU | YP-206NF | _ | YM-206NRI | _ | YR-206NRI | _ |
| Je | | Y-2N | 85×75 | YP-208NW | _ | YP-208NVAR | _ | YP-208NPF | YP-208NPFU | YP-208NF | _ | YM-208NRI | _ | YR-208NRI | _ | |
| nar | Series | S | (mm) | 100×85 | YP-210NW | _ | YP-210NVAR | _ | YP-210NPF | YP-210NPFU | YP-210NF | _ | YM-210NRI | _ | YR-210NRI | _ |
| Model name | VAL | | Size | 82×82 | YP-8NW | _ | YP-8NVAR | _ | YP-8NPF | YP-8NPFU | YP-8NF | _ | YM-8NRI | _ | YR-8NRI | _ |
| ž | Y-N | | S | 102×102 | YP-10NW | _ | YP-10NVAR | _ | YP-10NPF | YP-10NPFU | YP-10NF | _ | YM-10NRI | _ | YR-10NRI | _ |
| | Series | | | 122×122 | _ | YP-12NW | 1 | YP-12NVAR | YP-12NPF | YP-12NPFU | _ | YP-12NF | _ | YM-12NRI | _ | YR-12NRI |
| | Operation principle | | ciple | Trans | ducer | Trans | ducer | Trans | ducer | Trans | ducer | Movab | | Rec | tifier | |
| | 11-phase 2-wire | | 1 | 110V 5A | 0.4~0 | .6kW | | | Note 5 LEAD LAG | _ | | | 100, 200, 3 | 300μΑ | (000) 000 | Note 1, 2 |
| S | | | 2 | 220V 5A | 0.8~1.2kW | | _ | | 0.5~1~0.5 | | | | 500μA 1, 5, 10, 20 |)mA | (200), 300, 1, 3, 5, 10, | , , |
| Indicator ratings | 1-phase 3- | -wire | 100 | 0/200V 5A | 0.8~1 | .2kW | | | - | _ | 45~5 | 55Hz | 1, 3, 5, 10, 15V | | 30, 50, 75mA | |
| rra | 3-phase 3- | -wire | 1 | 110V 5A | 0.8~1 | .2kW | 0.8~1.2kvar | | Note 6 LEAD0.5~1~0.5LAG | | 55~65Hz 45~65Hz | | 30, 50, 100V | | 100, 200, 500mA | |
| catc | , p | | | 220V 5A | 1.6~2 | | 1.6~2.4kvar | | | | | | Zero-supplindicator | ressed | 1, 3, 5, 10, 15, 20A 5, 10, 30, 50, 75V | |
| Indi | | _ | <u>110</u> √3 | ² /110V 5A | 0.8~1 | | 0.8~1.2kvar | | _ | | | | 1-5, 2-10m | Α | 100, 150, 3 | I |
| | 3-phase 4- | -wire | | 0/190V 5A | 1.4~2 | | 1.4~2.0kvar | | | | | | 4-20, 10-50 | | , , . | |
| | | | | 0/380V 5A | 2.8~4 | | _ | _ | _ | | | | 1-5V | | | |
| | | Blac | | (B) | (| | | | | | | | (| | (| |
| (| - | Tran | | | | | (| | |) | | <u> </u> | | | | |
| | | | | or coating (F) | | | | | | 7 | | <u> </u> | | | | |
| ions | | Red | | | 0(0) 45) | | (0) 15) | | |) | |) | (0) 15) | | 0(0) 4.5) | |
| ficat | Red needle Special accuracy class Note of the spec | | | ` / | ○(Class 1) | ○(Class 1.5) | , , | | _ | | | ○(Class 1.5) | , , | ○(Class 1.5) | | |
| peci | | <u> </u> | | | | | | 7 | | 7 | | <u> </u> | | | | |
| Sials | Special environmer Double scale | | | 2 | | | | | 7 | |) 7 | | | | | |
| Spec | Colored lines/bands | | | | | | |) | | <i>_</i> | | | | | | |
| | Adjustment resistor | | | <u> </u> | _ | _ | _ | _ | | _ | | | | _ | | |
| | · | | T-150 1 unit | | T-150 1 unit | | Note 7 T-100 1 unit | Note 8 | | | | | | | | |
| P | | | | tions table | 5 | 3 | 5 | 7 | 1-100 1 unit | T-150 1 unit | | 6 | 6 | | 68 | |

- Note 5. 1-phase, 2-wire power factor meters can only be manufactured for YP-12NPF.
- Note 6. 3-phase, 4-wire power factor meters can only be manufactured for YP-206NPFU, YP-208NPFU, YP-210NPFU, YP-8NPFU, YP-10NPFU and YP-12NPFU.
- Note 7. T-100 is provided as an accessory with YP-206NPF, YP-208NPF, and YP-210NPF.
- Note 8. T-150 is not provided as an accessory with YP-12NPFU.

■ Model Naming System

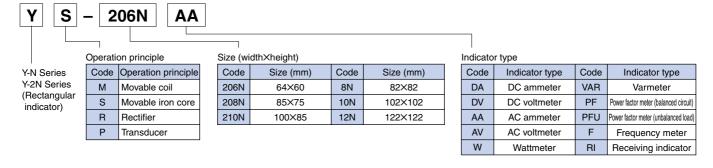



2. Wide-angle Indicators (L-N Series)


| | Indicator type | | 20 | DC am | motoro | DC volt | ton a ta va | | AC am | meters | | | AC volt | meters | |
|------------------------|-------------------------------|----------------|--|--------------|---|--------------|---------------------------------------|-------------------|--|------------------------------|-------------------------------------|---------------------------------------|---|--------------|--------------------------|
| | " | iuicator ty | pe | DC alli | illeters | DC VOII | ineters | Non-unifo | orm scale | Uniforr | n scale | Non-unifo | rm scale | Uniforn | n scale |
| | Appearance | | 10 20 1 30 | | 100 200 V | | 40 60 40 80 20 4) 100 | | 40 | 40 60 20 80 4 100 A | | 2000 3000 -1000 (1) 4000 - 4500 | | 9000 | |
| | Accuracy (class) | | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | |
| M | odel | Size | 80×80 | LM-80NDA | _ | LM-80NDV | _ | LS-80NAA | _ | LR-80NAA | _ | LS-80NAV | _ | LR-80NAV | |
| na | name (mm) 110×110 | | - | LM-110NDA | - | LM-110NDV | _ | LS-110NAA | _ | LR-110NAA | _ | LS-110NAV | _ | LR-110NAV | |
| | Оре | eration prin | ciple | Movab | le coil | Movable coil | | Movable iron core | | Rectifier | | Movable iron core | | Rectifier | |
| Indicator ratings | Direct | | Note 1 300, 500,µA 1, 3, 5, 10, 20, 50, 100mA 200, 500mA 1, 2, 5, 7.5, 10, 15, 20, 30A | | 1, 3, 5, 10, 30V 50, 100, 150, 300V 500, 600V | | Note 1 1, 3, 5, 10A 15, 20, 30A | | Note 1 1, 3, 5, 10, 20, 30, 50mA 75, 100, 200, 500mA 1, 3, 5, 10, 15, 20, 30A | | 150, 300V 600V | | 5, 10, 30, 50, 75, 100V 110, 150, 190, 260V 300, 400, 500, 600V | | |
| ndi | Com | nbined with | shunt, | 1~75 | 1~7500A 750~2000V | | V0002 | 5A, | 1A | 5A, | 1A | 15 | 0V | 15 | 0V |
| | multi | iplier, or tra | ansformer | (combined | ed with shunt) (com | | ` ' ' | | , , | | (combined with current transformer) | | , , | | ent voltage transformer) |
| S | cale | Ordinary | | 0 | | 0 | | 0 | | 0 | | 0 | | 0 | |
| | Jaic | Expande | d | _ | _ | _ | _ | 0 | | Note 2 | | _ | | _ | |
| C | over | Black | (B) | (| | (| | 0 | | 0 | | 0 | | 0 | |
| | | Special col | or coating (F) | Δ | 7 | Z | 7 | | Δ | Δ | | Δ | | Δ | |
| | | Red nee | edle | |) | | | | | | | 0 | | 0 | |
| દ | Speci | al accurac | y class Note 4 | ○(Class 1.5) | ○(Class 1) | ○(Class 1.5) | O(Class 1) | ○(Class 1.5) | ○(Class 1) | ○(Class 1.5) | O(Class 1) | ○(Class 1.5) | ○(Class 1) | ○(Class 1.5) | ○(Class 1) |
| atioi | F | oreign sta | ndards | Δ | 7 | | 7 | | Δ | | Δ | | 7 | | 7 |
| ific | Sp | pecial envi | ronment | Δ | 7 | | 7 | | Δ | | Δ | | 7 | | 7 |
| bed | | Double s | cale | C |) | |) | |) | (|) | |) | |) |
| ial | Co | olored line | s/bands | | | |) | |) | |) | |) | | |
| Special specifications | | Shun | t | |) | _ | _ | _ | _ | - | _ | _ | - | _ | _ |
| (O) | Lead wires | | | | _ | _ | - | _ | _ | | - | _ | - | _ | |
| | Lead wire adjustment resistor | | C |) | _ | | _ | | - | | _ | | - | _ | |
| Pa | ge with | n specifica | tions table | 4: | 3 | 4 | 7 | 4 | 9 | 5 | 0 | 5 | 1 | 5 | 2 |

Remarks All indicators, excluding special grade and foreign standard specification indicators, comply with the Japanese Industrial Standards relating to direct-acting electrical indicators and have a JIS mark.

However, the JIS mark may not apply depending on the operating circuit voltage or rated voltage. Refer to the Reference Chart for Test Voltages and JIS Mark on p.25/26 for details.

- Note 1. The operating circuit voltage is 600V or less.
- Note 2. Some models cannot be manufactured for some ratings. Refer to the specifications tables starting on p.45 for details.
- Note 3. Models with an indicator rating of 600V are provided with the KR-1 accessory.
- Note 4. Please specify the frequency if a special accuracy class is required for an AC indicator.

■Model Naming System

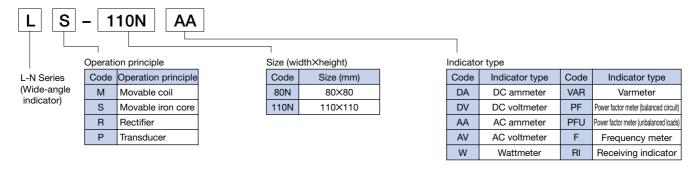

| 0 | Standard specifications |
|---|-------------------------------|
| 0 | Quasi-standard specifications |
| Δ | Special specifications |

| | Inc | licator | type | Wattm | neters | Varm | eters | Power fac Balanced circuit | tor meters Unbalanced loads | Frequency meters | | Receiving | indicators | |
|-------------------|--|--------------------|--|--------------|-------------------------|---|--------------------------|-------------------------------|--------------------------------|------------------|---|------------|--|------------|
| | Appearance | | 200 1000 1200 1200 18W | | - 400 - 400 - 500 | 600 - 600 - 5 - COS#s | | 9 LAG 7 5 2 | 50 Hz | 20 | | 80 | | |
| | Accı | uracy (| (class) | 2.5 | 1.5 | 2.5 | 1.5 | į | 5 | 0.5 | 2.5 | 1.5 | 2.5 | 1.5 |
| M | odel | Size | 80×80 LP-80NW — LP-80NVAR — LP-80NPF LP-80NPFU | | LP-80NF | LM-80NRI | _ | LR-80NRI | | | | | | |
| na | name (mm) 110×110 | | _ | LP-110NW | _ | LP-110NVAR | LP-110NPF | LP-110NPFU | LP-110NF | _ | LM-110NRI | _ | LR-110NRI | |
| | Operation principle | | rinciple | Trans | ducer | Transducer | | Transducer | | Transducer | Movable coil | | Rectifier | |
| | 1-nhase 2 | ase 2-wire 110V 5A | | 0.4~0 | 0.4~0.6kW | | | Note 5 LEAD LAG | | | | | | Note 1, 2 |
| | i pridoo z | **** | 220V 5A | 0.8~1 | .2kW | _ | _ | 0.5~1~0.5 | | | 300, 500 <i>μ</i> A 1, 5, 10, 20mA | | 500 <i>μ</i> A 1, 3, 5, 10, 20mA | |
| sbu | 1-phase 3 | -wire | 100/200V 5A | 0.8~1 | .2kW | | | _ | | | 1, 3, 5, 10, 20mA 1, 3, 5, 10, 15V 30, 50, 100V Zero-suppressed indicator 1-5, 2-10mA 4-20, 10-50mA | | 1, 3, 5, 10, 20MA 30, 50, 75mA 100, 200, 500mA 1, 3, 5, 10, 15, 20A 5, 10, 30, 50, 75V 100, 150, 300V | |
| ratir | 3-phase 3 | -wire - | 110V 5A | 0.8~1.2kW | | 0.8~1 | .2kvar | LEAD0.5~1 | Note 6 | 45~55Hz | | | | |
| tor | o pridoo o | **** | 220V 5A | 1.6~2 | 2.4kW | 1.6~2.4kvar | | LLADO.5*1 | 1 O.OLAG | 55~65Hz | | | | |
| Indicator ratings | 3-phase 4 | -wire | $\frac{110}{\sqrt{3}}$ /110V 5A | 0.8~1 | .2kW | 0.8~1.2kvar | | _ | | 45~65Hz | | | | |
| | priase 4 | WIIC | 110/190V 5A | 1.4~2 | 2.0kW | 1.4~2 | .0kvar | 1 | | | 1-5V | | | |
| | | | 220/380V 5A | 2.8~4 | .0kW | _ | _ | _ | _ | | | | | |
| | Cover | Black | (B) | 0 | | (| | (|) | 0 | (|) | (| |
| | | Special | color coating (F) | Δ | | | 7 | | Δ | Δ | 4 | Δ | | 7 |
| ဟ | | | needle | | - | | - | (|) | 0 | (|) | (| |
| ation | Special | accur | acy class Note 4 | ○(Class 1.5) | ○(Class 1) | ○(Class 1.5) | O(Class 1) | - | _ | _ | O(Class 1.5) | ○(Class 1) | ○(Class 1.5) | ○(Class 1) |
| cifica | Fo | reign s | standards | Δ | 7 | | 7 | | Δ | Δ | 4 | Δ | | 7 |
| spec | Special environment | | | Δ | | | | 4 | Δ | Δ | | Δ | | 7 |
| cial | Special accuracy Foreign stan Special enviro Double so Colored lines | | e scale | | | | | _ | _ | _ | |) | |) |
| Spe | Colored lines/bands | | nes/bands | |) | |) | (|) | 0 | |) | | |
| | Adjustment resistor | | _ | _ | _ | _ | _ | - Net- 7 | _ | (|) | | | |
| | Accessories | | T-150 1 unit | _ | T-150 1 unit | _ | - Note 7 T-150 1 unit | | _ | _ | | - – | | |
| Pa | Page with specifications table | | 5 | 3 | 5 | 7 | 61 | 63 | 66 | 6 | 57 | 6 | 8 | |

Note 5. 1-phase, 2-wire power factor meters can only be manufactured for LP-110NPF.

Note 6. 3-phase, 4-wire power factor meters can only be manufactured for LP-80NPFU and LP-110NPFU.

Note 7. T-150 is not provided as an accessory with LP-110NPFU.



3. Indicators with Changeover Switch (YR-UN Series)

| | In | dicator ty | ре | AC amı | meters | AC vol | tmeters | | |
|-------------------|---|-----------------|----------------------|---|------------------------------|-----------------|--|--|--|
| | Appearance | | | A | A 9224 | 017 8-5 5-1 1-4 | 000 000 000 000 000 000 000 000 000 00 | | |
| | Acc | curacy (cla | ass) | 2.5 | 1.5 | 2.5 | 1.5 | | |
| M | Model Size 82×99 | | 82×99 | YR-8UNAA | | YR-8UNAV | _ | | |
| | ame | (mm) | 102×119 | YR-10UNAA | <u> </u> | YR-10UNAV | _ | | |
| 110 | airie | (11111) | 122×139 | _ | YR-12UNAA | _ | YR-12UNAV | | |
| | Oper | ration prin | ciple | | ifier Note 1 | Red | ctifier | | |
| atings | | Direc | t | 1, 5, 10, 18 | 5, 20, 30A ^{Note 2} | 150, 30 | 00, 600V | | |
| Indicator ratings | Combi | ined with | ransformer | 5A, (combined with cu | | | 50V nent voltage transformer) | | |
| | · · · · · · · · · · · · · · · · · · · | Ordinary | / | © | | (| 0 | | |
| ٥ | Scale | Expande | ed | © | | <u> </u> | | | |
| | | Black | (B) | © | | © | | | |
| C | over | Transpa | rent (G) | C |) | 0 | | | |
| | | Special co | or coating (F) | _ | 7 | | Δ | | |
| Te | rminal | Direct in | dicator | 4 term | ninals | 3 ten | minals | | |
| conf | iguration | Indicator combi | ned with transformer | 3 terminals Note 3 (operation principle: movable iron core) | 3 terminals Note 3 | 3 ten | minals | | |
| suc | | Red nee | dle | C |) | | 0 | | |
| catic | Special accuracy class | | acy class | _ | - | - | _ | | |
| ecifi | Red needle Special accuracy class Foreign standards Special environment Double scale Colored lines/bands | | ndards | _ | - | - | _ | | |
| l sp | Special environment | | ronment | _ | - | - | _ | | |
| ecia | Double scale | | cale | C |) | 0 | | | |
| Spe | Colored lines/bands | | | C |) | 0 | | | |
| Pa | Page with specifications table | | | 69 | 9 | 70 | | | |

Remarks All indicators, excluding special grade and foreign standard specification indicators, comply with the Japanese Industrial Standards relating to direct-acting electrical indicators and have a JIS mark.

- Note 1. The 3-terminal, CT-combined models of YR-8UNAA and YR-10UNAA operate on the principles of the movable iron core.
- Note 2. The operating circuit voltage is 600V or less.
- Note 3. A 4-terminal AC ammeter to be combined with a transformer can be manufactured if required.

■Model Naming System R 10 UN AAOperation principle Size (width \times height) Structure Indicator type Code Indicator type Code Operation principle Code Size (mm) Code Structure YR-UN Series (With changeover switch) Rectifier 8 UN Changeover switch AC ammeter (Movable iron core) 10 102X119 ΑV AC voltmeter 12 122X139

| 0 | Standard specifications |
|---|-------------------------------|
| 0 | Quasi-standard specifications |
| Δ | Special specifications |


4. Mechanical Demand Meters and Demand Meter Relays (LB-N Series)

| | | | | | De | emand meters | | | | Demand meter relays | |
|----------|--|---|-------------------------|---|-------------------|---|--|--------------------------------------|---|--|---|
| | In | dicator type | AC am | meters | AC vol | tmeters | Wattmeter | rs | Receiving indicators | AC ammeters | |
| | Α | ppearance | | 150 150 150 150 150 150 150 150 150 150 | 200 | 300 400 200 500 0 400 100 500 100 500 | | 600 | Ü | 60 80 40 100 - 0 100 - | |
| A | ccuracy c | lass (driving needle) | 2.5 | 1.5 | 2.5 | 1.5 | 1.5 | | 1.5 | 1.5 | |
| a | Needle Size | | 80×80 | 110×110 | 80×80 | 110×110 | 110×110 |) | 110×110 | 110×110 | |
| ame | With needle showing max. value remainin With needle showing min./max values remainin With With with needle showing max. value remainin | | LB-8ZNAA | LB-11ZNAA | LB-8ZNAV | LB-11ZNAV | LB-11ZNW | | LB-11ZNW LB-11ZNRI | | _ |
| <u>=</u> | With needle showing min./max values remainin | | _ | _ | _ | _ | LB-11YNV | V | LB-11YNRI | _ | |
| 00 | With | With needle showing max. value remaining | _ | LB-11ZRNAA | _ | _ | LB-11ZRN | LB-11ZRNW | | LB-11ZRMNAA | |
| _ | | With needle showing min./max values remaining | _ | _ | _ | LB-11YRNAV | LB-11YRN | W | LB-11YRNRI | _ | |
| | Oper | ration principle | Bin | netal (instantaned | ous rectifying me | ter) | Bimetal (instantant | eous mete | er is movable coil) | Bimetal (instantaneous rectifying meter) | |
| | | Note 1 icator ratings | 5. (combined transfo | with current | (combined w | iOV ith instrument ansformer) | 1-phase 110V 5A 2-wire 220V 5A 3-phase 110V 5A 3-wire 220V 5A 3-phase 110 5A 4-wire 73 /110V 5A | 0.8~1.2kW 0.8~1.2kW 1.6~2.4kW | DC 1mA (internal resistance: 1kΩ) | 5A (combined with current transformer) | |
| | Time ir | nterval (minutes) | 2, 15 | 2, 5, 10, 15 | | 2 | 2, 15 | | 2, 15 | 10, 15 | |
| | Cover | Black (B) | (| | (|) | 0 | | 0 | 0 | |
| | | Special color coating (F) | | 7 | 1 | Δ | Δ | | Δ | Δ | |
| | Contact configuration | | | | | | | | | No-voltage 1C contact | |
| | Auxiliary power supply | | | _ | _ | | 100VA0 | C ⁺¹⁰ ₋₁₅ % 50 | -60Hz | both 100-110VAC/DC | |
| | Remaining needle resetting | | | Both manual and | electromagnetic | resetting (electr | omagnetic resetting | g voltage: | both 100-110VA | C/DC) | |
| | Color | red lines/bands | |) | 0 | | 0 | | 0 | 0 | |
| | Accessories | | | | _ | | T-150, T-150LB 1 | unit each | T-150LB 1 unit | | |
| F | age with | specifications table | 7 | 2 | 7 | '2 | 73 | | 73 | 75 | |

Remarks All indicators, excluding special grade and foreign standard specification indicators comply with the Japanese Industrial Standards relating to direct-acting electrical indicators and have a JIS mark (excluding LB-8ZNAA, LB-8ZNAV and LB-11ZRMNAA).

Note 1. Use an AC indicator in combination with an instrument current transformer and an instrument voltage transformer.

■Model Naming System

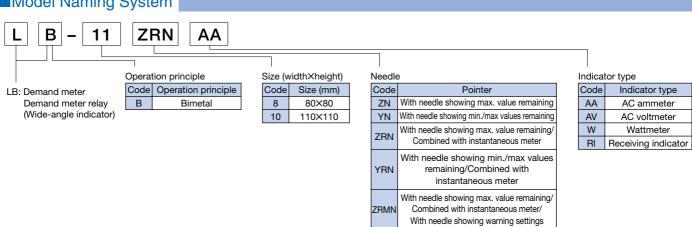


Products List

5. Meter Relays

| | In | dicator type | Э | DC am | meters | DC volt | meters | AC am | meters | AC volt | AC voltmeters | | |
|-------------------|------------------------------------|------------------|---------------|---------------------------|-----------------|------------------|-----------------|-------------------|-------------|------------------------|---------------|--|--|
| | Appearance | | A | | 50 100 | | A A | | 200 400 | | | | |
| | Ac | curacy clas | ss | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | 2.5 | 1.5 | | |
| ame | Setting n | needle | Size | 100×83 | 110×110 | 100×83 | 110×110 | 100×83 | 110×110 | 100×83 | 110×110 | | |
| Model name | Uppe | r/Lower-limi | it settings | YM-210MRNDA | LM-11MRNDA | YM-210MRNDV | LM-11MRNDV | YR-210MRNAA | LR-11MRNAA | YR-210MRNAV | LR-11MRNAV | | |
| ₹ | U | pper-limit s | etting | YM-210MRHNDA | LM-11MRHNDA | YM-210MRHNDV | LM-11MRHNDV | YR-210MRHNAA | LR-11MRHNAA | YR-210MRHNAV | LR-11MRHNAV | | |
| | Ope | ration princ | iple | Moval | ole coil | Movab | Movable coil | | Rectifier | | Rectifier | | |
| Indicator ratings | | Direct | | ±0.5mA, 1, 10mA, 1, 3, 5A | | 1, 50, 100, 150V | | 100, 200, 500mA | | 10, 30, 50, 75V | | | |
| or rat | Tratt | | | Zero-suppressed | | 300, 500V | | 1, 5, | | 100, 15 | 0, 300V | | |
| icatc | ਰੇ ☑ Combined with shunt or tra | | r transformer | 1~75 | | _ | _ | 5A, | | 15 | - | | |
| 밀 | | | | (combined with shunt) | | | | (combined with cu | | (combined with instrum | | | |
| s | cale F | Ordinary | | 0 | | 0 | | 0 | | (| | | |
| | | Expanded | | _ | | _ | | Δ | | | | | |
| c | OVER | Black | (B) | | | 0 | | 0 | | 0 | | | |
| | | Special color of | | | | | | | | | | | |
| Re | lav sett | ing range | Upper limit | 5~100% | 10~100% | 5~100% | 10~100% | 5~100% | 10~100% | 5~100% | 10~100% | | |
| | | | Lower limit | 0~95% | 0~90% | 0~95% | 0~90% | 0~95% | 0~90% | 0~95% | 0~90% | | |
| | | act configur | | 10 | contact each fo | | | contact for upper | | pacity 250VAC, 3 | A) | | |
| | Auxilia | ary power s | | | | 10 | 00-110VAC/200-2 | 220VAC selectab | le | I | | | |
| Suc | | Red need | | _ | = | - | - | - | = | - | = | | |
| specifications | | oreign stand | | _ | | _ | | _ | | _ | _ | | |
| cific | Special environment | | _ | | - | | _ | | - | _ | | | |
| sbe | | | C | | | | | | | | | | |
| cial | Colore | d lines/colo | red bands | | | |) | | | (|) | | |
| Special | | Shunt | | | | _ | _ | - | | _ | _ | | |
| | Lead wires | | | | | _ | | _ | | | | | |
| | Page with specifications table | | | 7 | 9 | 80 | | 81 | | 82 | | | |

Remarks These models do not have a JIS mark.

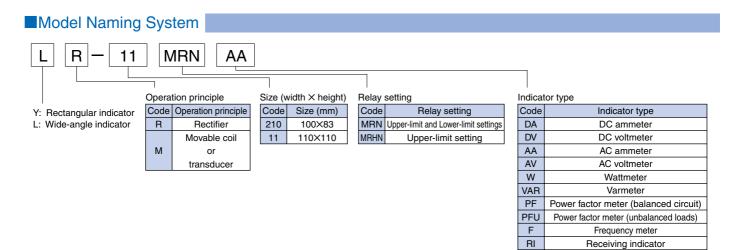

| 0 | Standard specifications |
|---|-------------------------------|
| 0 | Quasi-standard specifications |
| Δ | Special specifications |

| | Indicat | or type | Wattm | neters | Varm | eters | Power fac | tor meters | Frequenc | y meters | Receiving | indicators |
|------------------------|---------------------|---------------------------------|-------------|--------------|--|---------------|----------------|----------------|--------------------|----------------|---------------|---------------|
| | Appearance | | kW e | | 200 200 -400 400 - 600 600 - 8 kvar 8 | | <u>a</u> | | Hz 20 | | 60 80 100 100 | |
| | Accurac | cy class | 2.5 | 1.5 | 2.5 | 1.5 | 5 | 5 | - | | 2.5 | 1.5 |
| ıme | Setting needle | Size | 100×83 | 110×110 | 100×83 | 110×110 | 100×83 | 110×110 | 100×83 | 110×110 | 100×83 | 110×110 |
| Model name | Upper/Low | er-limit settings | YM-210MRNW | LM-11MRNW | YM-210MRNVAR | LM-11MRNVAR | YM-210MRNPFU | LM-11MRNPFU | YM-210MRNF | LM-11MRNF | YM-210MRNRI | LM-11MRNRI |
| Mod | Upper- | limit setting | YM-210MRHNW | LM-11MRHNW | YM-210MRHNVAR | LM-11MRHNVAR | YM-210MRHNPFU | LM-11MRHNPFU | YM-210MRHNF | LM-11MRHNF | YM-210MRHNRI | LM-11MRHNRI |
| | Operation | principle | Transducer | | Transducer | | Transducer | | Transducer | | Movable coil | |
| | 1-phase 110V 5A | | 0.4~0 | .6kW | | | | | | | | |
| sgui | 2-wire | 220V 5A | 0.8~1 | .2kW | | | _ | _ | - 45∼55Hz | | ±0.5mA | |
| rati | 3-phase | 110V 5A | 0.8~1 | .2kW | 0.8~1.2kvar | | | Note 1 | | | 1, 10 | 0mA |
| ator | 3-wire | 220V 5A | 1.6~2.4kW | | 1.6~2 | .4kvar | LEADOE | 1 0 51 40 | 55~65Hz 45~65Hz | | Zero-suppres | sed indicator |
| Indicator ratings | 3-phase 4-wire | $\frac{110}{\sqrt{3}}$ /110V 5A | 0.8~1 | .2kW | 0.8~1.2kvar | | LEAD0.5~ | 1~0.5LAG | | | 4-20mA | |
| | over | (B) | 0 | | 0 | | 0 | | 0 | | 0 | |
| | Specia | al color coating (F) | | 7 | | 7 | | 7 | | 7 | | 7 |
| Re | elay setting ra | Upper limit | 5~100% | 10~100% | 5~100% | 10~100% | 5~100% | 10~100% | 5~100% | 10~100% | 5~100% | 10~100% |
| 110 | nay setting re | Lower limit | 0~95% | 0~90% | 0~95% | 0~90% | 0~95% | 0~90% | 0~95% | 0~90% | 0~95% | 0~90% |
| | Contact co | nfiguration | | 1C contact e | each for upper | limit and low | er limit or 1C | contact for up | per limit (cont | act capacity 2 | 250VAC, 3A) | |
| | Auxiliary po | wer supply | | | | 100- | 110VAC/200-2 | 220VAC selec | table | | | |
| ions | Red | l needle | _ | - | _ | _ | _ | _ | _ | _ | _ | _ |
| ificat | Foreigr | n standards | _ | _ | _ | _ | _ | _ | _ | _ | _ | _ |
| Special specifications | Special | environment | _ | _ | _ | _ | _ | _ | _ | _ | _ | _ |
| cial | Dou | ble scale | |) | | | _ | _ | _ | - | | |
| Spe | Colored lines/bands | | |) | |) | 0 | | 0 | | (| |
| | Accessories | | T-150 | 1 unit | T-150 1 unit | | T-150 1 unit | | T-100 1 unit | | _ | |
| Pa | age with spec | ifications table | 8 | 3 | 83 | | 85 | | 86 | | 87 | |

Note 1. The YM-210MRNPF, YM-210MRHNPF, LM-11MRNPF, and LM-11MRHNPF models (provided with the T-100 accessory) are for 3-phase, 3-wire balanced circuits.



6. Indicators with Maximum and Minimum Needles

| | Indicator type | DC ammeters | AC ammeters | AC voltmeters | Receiving indicators | | |
|------------|--|--|--------------------------|----------------------------------|---------------------------|--|--|
| Appearance | | 0 | 60 80 100 | 200 400 F | | | |
| A | Accuracy class | 1.5 (remaining needle: 2) | 1.5 (remainir | ng needle: 2) | 1.5 (remaining needle: 2) | | |
| | Size (mm) | 110×110 | 110×110 | 110×110 110×110 | | | |
| Model | With max. value remaining needle | LM-11ZNDA | LM-11ZNAA | LM-11ZNAV | LM-11ZNRI | | |
| name | With max. and min. value remaining needles | LM-11YNDA | LM-11YNAA | LM-11YNAV | LM-11YNRI | | |
| Ор | eration principle | Movable coil | Rect | tifier | Movable coil | | |
| Ir | ndicator ratings | 5, 10, 15, 20mA 1, 3, 5, 10, 15A Note 1 | 1, 5, 10, 15A 20, 30A | 100, 110, 150, 190V 260, 300V | 5mA | | |
| F | Response time | 0.3 seconds | 0.1 seconds | 0.1 seconds | 0.3 seconds | | |
| | Black (B) | © | © | © | 0 | | |
| Cover | Special color coating (F) | Δ | Δ | Δ | Δ | | |
| Remair | ning needle resetting | Both manual and | 100-110VAC/DC) | | | | |
| | Accessories | _ | T-150 1 unit | T-150 1 unit | _ | | |
| Page wi | th specifications table | | 8 | 9 | · | | |

 $\label{lem:Remarks} \textbf{Remarks} \ \ \textbf{These indicator models do not have the JIS mark}.$

Note 1. Models with a rating exceeding 15A DC are manufactured as 300mV-shunt-combined units.

7. Special Application Meters

| I | Indicator type | Earth-leakage detectors | Synchroscopes | Dual-element indicators |
|------------|-------------------------|--|---|-------------------------|
| | Appearance | | STACHHOLOGIAN | 3000 6000 |
| | Application | Detects earth faults of 3-phase 3-wire circuits | Detects generator-side and bus line-side phases | Measures two elements |
| Model name | Rectangular indicator | _ | _ | _ |
| Model | Wide-angle indicator | LM-11NGD | LI-11NSY | LM-11NE |
| | Accessories | T-150 1 unit | T-150 1 unit | _ |
| Page wit | th specifications table | 91 | 93 | 95 |

Remarks The synchroscope and dual-element indicator are compliant with Japanese Industrial Standards relating to direct-acting electrical indicators and therefore have the JIS mark.

| 0 | Standard specifications |
|---|-------------------------------|
| 0 | Quasi-standard specifications |
| Δ | Special specifications |

8. Bar-shaped Indicators (F-N Series)


| | Indicator type | | DC inc | licators | | | AC ind | icators | | |
|------------------------|---------------------------|--------------|--|---|----------|---|---------------------------------------|-------------|-------------------------|--|
| Appearance | | | -a -b -b | 96PP A 30 30 30 30 30 30 30 30 30 30 30 30 30 | 7. III. | : | 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 | 700 -200 | - 399 - 280 - 160 | |
| | Accuracy class | 1.5 or 2.5 | | 1 or 1.5 | | 2.5 | | 1.5 | | |
| | Size (mm) | 100×30 | 130×36 | 150×40 | 170×42 | 100×30 | 130×36 | 150×40 | 170×42 | |
| Model r | 1-needle | FM-210SN | FM-213SN | FM-215SN | FM-217SN | FR-210SN | FR-213SN | FR-215SN | FR-217SN | |
| | 2-needle | FM-210DN | FM-213DN | FM-215DN | FM-217DN | _ | _ | _ | _ | |
| | Operation principle | | Movable | coil type | | Rectifying type | | | | |
| Indica ratin | | 1, 5 1, 3 | (100), 500mA N 1, 5, 10, 50, 100, 500mA 1, 3, 5, 10A 4-20mA (zero-suppressed indicator) | | | 500mA 1, 5, 10, 50, 100, 500mA 1, 3, 5A | | | | |
| | Voltage input | 1, 5 | 1, 5, 10, 15, 30, 50, 100, 150, 300V 1-5V (zero-suppressed indicator) | | | | 5, 10, 30, 50, 100, 150V | | | |
| Cov | Black (B) | | 0 | | | © | | | | |
| 000 | Special color coating (F) | | Δ | | | Δ | | | | |
| Moun | Vertical | | 0 | | | | (| | | |
| WOUT | Horizontal | | 0 | | | | (| | | |
| tions | Nameplate engraving | | Δ | | | | | 7 | | |
| T Sejjica | g number plate engraving | | Δ | | | | | 7 | | |
| Special specifications | Double scale | | 0 | | | | (|) | | |
| Spec | Colored lines/bands | | 0 | | | | (|) | | |
| Page | with specifications table | | 97 | | | | 9 | 8 | | |

Remarks All indicators, excluding special grade and foreign-standard specification indicators, comply with the Japanese Industrial Standards relating to direct-acting electrical indicators and have the JIS mark.

Note 1. The operating circuit voltage is 300V or less.

Note 2. Parentheses around an indicator rating indicate that the rating is only available for certain models. Refer to the specifications for details.

■Model Naming System

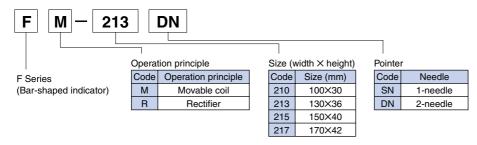

Glossary of Terms

| Term | Meaning | Term | Meaning |
|--|--|--|---|
| Electric indicator (direct-acting indicator) | An indicator with a needle driven by a mechanically coupled movable element. | Intrinsic error | Error of an indicator in a standard state. Intrinsic error = $\left[\frac{\text{target value - reference value}}{\text{base value}}\right] \times 100 (\%)$ |
| Electronic indicator | An indicator that uses an electronic means to measure and display an electrical quantity or non-electrical quantity. | | A specified standard-error value used to define the accuracy of an indicator. The value varies according to the type of |
| Fixed indicator (indicator for switchboard) | Indicators that are mounted permanently, connected to an external circuit via fixed conductive wires. | | indicator. For ammeters, voltmeters, wattmeters and varmeters, the standard value is the upper value of the measurement range. |
| Portable indicator | An indicator that can be transported and used in different places. | | (If there are both mechanical and electrical zero points in the scale [i.e., there is a negative and positive range], the |
| Wide-angle indicator | An indicator with a scale spanning a range of 180° or more. | Standard value | standard value is the sum of the absolute values of the |
| Receiving indicator | Indicators with scales that differ from the quantity of electricity input, but the relationship between the quantity of electricity input and scale values is known. | | electrical quantity corresponding to the two limits of the measurement range.) (If the scale does not match the quantity of the electricity input, the standard value is the span.) |
| Zero-suppressed | An indicator with a mechanical zero point outside the range | | · Frequency meter |
| indicator | of the scale. | | The upper value of the measurement range. |
| Movable coil | An indicator that operates based on the interaction between | | Power factor meter |
| indicator | magnetic fields produced by a fixed, permanent magnet and | | Electrical angle of 90°. |
| indicator | by a current inside a movable coil. | Span | The algebraic difference between the upper and lower limits |
| | Indicators that have fixed and moving cores made of soft | Оран | of the measurement range. |
| Movable iron core indicator | magnetic material and operate based on the repulsive force (and suction) generated as a result of magnetizing the fixed and mobile iron cores by passing an electrical current | Overshoot | The difference between the maximum deflection value and the final value when a measured quantity changes suddenly. |
| | through the fixed coil. | | When the management value shanges and donly from your |
| Rectifier indicator | An indicator combining a DC-operated indicator and a rectifier to measure AC current/voltage. | Response time | When the measurement value changes suddenly from zero to a specified value, the time (seconds) until the needle stops at its final stationary position. |
| Transducer indicator | An indicator that converts a quantity of AC electricity to a DC voltage/current using an electronic device or circuit, and then indicates the quantity using a movable coil indicator. | Residual displacement | The deflection of a mechanically controlled movable element still remaining after the cause of the deflection has been eliminated. |
| Bimetal indicator | Heat-based indicators that operate by changing the shape of the metal elements, which occurs when they are heated directly/indirectly via an electrical current. | Extent of influence | In general, the potential extent of influence that an external factor has on performance (e.g., ambient temperature, external magnetic field). |
| Compatible accessory | An accessory that has special properties/accuracy itself, regardless of whether or not it is combined with the performance of an indicator. | Distortion rate (total harmonic distortion rate) | Rate: Effective value of the harmonics contained Effective value of non-sinusoidal wave |
| Limited-compatibility accessory | An accessory that has special properties/accuracy itself and can be combined with an indicator that has special performance. | Ripple content | Content: Effective value of varying component value of DC component |
| Dedicated accessory (non-compatible accessory) | An accessory that is adjusted considering the electrical characteristics of the indicator it is combined with. | Standby state | Prior to indicator testing, the specified measurement amount supplied to the circuit being measured. |

Abbreviations for items measured

DA : DC current
DV : DC voltage
AA : AC current
AV : AC voltage
W : Power
VAR : Reactive power

PF : Power factor, phase

F : Frequency SY : Synchroscope

Standard value

DA, DV, AA, AV, W, VAR
 The upper limit of the
 measurement range; the sum of
 the absolute values of both sides
 where there is a zero point on the
 scale [i.e., there are positive and
 negative ranges]; the span when
 the scale does not match the
 quantity of electricity.

P
 Upper-limit value of the measurement range

3) PF, SY 90° electric angle

Standby conditions

Prior to testing, the following input is applied to meters that are required to have a standby state.

| Measured quantity | Input condition | Time |
|-------------------|--|---------|
| DA, DV, AA, AV | 80% of maximum scale value | |
| W, VAR | Voltage: 100%; power factor (or reactive factor): 1 80% of maximum scale value | 15 |
| F | Voltage: 100%; maximum scale value | minutes |
| PF | Voltage: 100%; current: 80%; power factor: 1 | |
| SY | Voltage: 100%; synchronization point | |



Excerpts from Japanese standards

(1) JIS C 1102-1 ~ -9

| Influencing item | | | | Type of measured qua | | | | | antity |
|------------------------|--|--|---|----------------------|-----------|------------|-----|-----------|----------|
| Influ | encing item | Test conditions | Performance | DA DV | AA ¦AV | ¦W ¦VAR | F | PF | SY |
| Inhe | erent error | Measure important points under standard conditions | ±100% of the accuracy class | 0 | 0 | 0 | 0 | 0 | 0 |
| Ambier | nt temperature | Temperature varies ±10°C from standard temperature (23°C) | 100% of class index | 0 | 0 | ;0 | 0 | 0 | 0 |
| F | lumidity | Leave for 96hr in states of 25% and 80% relative humidity, respectively | 100% of class index | 0 | 0 | 0 | 0 | 0 | 0 |
| DC measured quantity | Ripple | 20% input, and 45–65Hz and 90–130Hz current (AC) superimposed | 50% of class index | | | | 1 | 1 | |
| AC measured | Distortion AC, DC, W: 20% third harmonic wave content (W: with each measured circuit) PF, F: 15% third harmonic wave content (PF: with each measured circuit) 100% of class index (rectifying type is exempt) | | 100% of class index (rectifying type is exempt) | | 0 | 0 | 0 | 0 | 0 |
| quantity | Frequency | Vary by ±10% from reference frequency | 100% of class index | | 10 | ¦ 0 | ! | 0 | 0 |
| | Voltage component | Vary by ±15% from reference voltage | 100% of class index | | | 0 | 0 | 0 | 0 |
| | Current component | Vary by 20 to 120% of rated current | 100% of class index | | | 1 | | 0 | 1 |
| Por | wer factor | Power factor varies from 1 to 0.5 (var: lagging phase angle: 30°) | 100% of class index | | | .0 | | 1 | 1 |
| Pha | se balance | One current circuit removed | 200% of class index | | | ;0 | | 0 | Ī |
| | etween multiple phase tor elements | One voltage circuit removed | 200% of class index | | | - | 1 | 1 1 1 1 1 | |
| , | Attitude | Incline of 5°to the front/back/left/right from the standard attitude | 50% of class index | 0 | 0 | 0 | 0 | 0 | .0 |
| External | I magnetic field | Magnetic field of 0.4kA/m | Movable iron core: 6%; others: 1.5% | 0 | 0 | ; 0 | 0 | 0 | 0 |
| Ferroma | agnetic support | Mounted to a 2mm-thick steel-plate panel | Within limits of inherent error | 0 | 0 | 10 | 0 | 0 | 10 |
| Condu | ctive support | Mounted to a 1.5mm-thick (or thicker) aluminum panel | Within limits of inherent error | 0 | 0 | :0 | 0 | 0 | 0 |
| | Overshoot | Input of approx. 2/3 scale length; measure initial overshoot distance | 20% or less if the full deflection angle is less than 180°; 25% or less otherwise | | | 1 | | 1 | 1 |
| Damping | Response time | Input of approx. 2/3 scale length; measure time to settle within 1.5% | 4s or less | 0 | ! 0 | 0 | . 0 | 10 | 10 |
| Se | If-heating | Changes at 1 to 3 minutes after and 30 to 35 minutes after applying a 90% input. | 100% of class index | 0 | 10 | 10 | 0 | 0 | 10 |
| | Ŭ | Apply power 10-fold that of the rated power nine times for 0.5s at 60s | | | 1 | <u> </u> | | ! | <u> </u> |
| Short-time overload | Power supply circuit Voltage circuit | intervals and one time for 5s. Apply voltage double that of the rated voltage nine times for 0.5s at 60s intervals and one time for 5s. | Within limits of inherent error | 0 | 0 | 0 | 0 | 0 | 0 |
| Continuous overload | Current circuit Voltage circuit | Apply current 120% that of the rated current for 2h Apply voltage 120% that of the rated voltage for 2h | Within limits of inherent error | 0 | 0 | 0 | 0 | 0 | 0 |
| | f current circuit after urrent overload | Apply current 30-fold that of the CT nominal secondary current for 2s (applies to indicators combined with a CT of 1 to 10A) | Current circuit does not open | | 0 | 0 | 1 | 1 1 1 1 | 1 1 |
| Tempera | ature limit value | 40°C for 16h, -25°C for 8h (repeated three times) | Within limits of inherent error | 0 | 0 | 0 | 0 | 0 | 0 |
| Deviation | from zero point | Measure deviation after applying the maximum value of the measurement range for 30s and zero point setting for 15s. | 50% of class index | 0 | 0 | 10 | 0 | 0 | 10 |
| Mechanical | zero-point adjuster | Maximum adjustment value in increasing/decreasing directions | Range: 2% or 2° or more | 0 | 0 | 0 | 0 | 0 | 0 |
| | Drop-out frequency | Frequency when rotation stops after increasing and then decreasing the starting circuit frequency. | <u> </u> | | | - | | - | 1 |
| Synchroscope | Pull-in frequency | Frequency when rotation starts after increasing and then decreasing the starting circuit frequency. | For 1-phase: 1Hz or more | | 1 | 1 | i | 1 | 0 |
| | Open circuit | Open starting-circuit or operating-circuit side | Index indicates synchronization point ±30 externally | | i | i | ļ | į | i |
| | | 10-65-10Hz, amplitude: 15mm | | | | Ī | | İ | 1 |
| Vibration/Impact | Vibration Impact | Sweeping speed: 1 octave/min., No. of sweeps: 5 490m/s² in X-, Y- and Z-, forward and reverse directions (repeated three times) | 100% of class index | 0 | 0 | 0 | 0 | 0 | 0 |

(2) JIS C 1010-1 (Measurement Category Ⅲ, Pollution Degree 2)

| Test item | Test conditions | Performance/Reference value | | easurement |
|---------------------------------|--|--|-------|------------|
| Voltage test | Between entire measurement circuit and outer casing The test voltage value is defined according to the operating circuit voltage. 50Hz/60Hz effective AC voltage, 5s | Dielectric breakdown and flashover must not occur. | 0 0 0 | |
| Clearance and creeping distance | circuit that is not insulated from the input. | Metal and resin connected: basic insulation Ungrounded metal: reinforced insulation or double insulation | 0 0 0 | 000 |

Representative operating circuit voltages and the clearance and creeping distance required

| On a reating a singuit valte as | | Standard insulation | | | Reinforced insulation or double insulation | | |
|---------------------------------|-----------|---------------------|--------------------|-----------|--|--------------------|--|
| Operating circuit voltage | Clearance | Creeping distance | Test voltage value | Clearance | Creeping distance | Test voltage value | |
| 100V | 0.5 | 1.4 | 840 | 1.5 | 2.8 | 1390 | |
| 150V | 1.5 | 1.57 | 1390 | 3.0 | 3.14 | 2210 | |
| 300V | 3.0 | 3.0 | 2210 | 5.9 | 6.0 | 3480 | |
| 600V | 5.5 | 6.0 | 3320 | 10.5 | 12.0 | 5200 | |

(3) Reference (JIS C 1102-1: 1997 specified standard)

| | Test item | Test conditions | | Type of measurement DA AA W F PF SY DV AV VAR |
|---|------------------|---|------------------------|---|
| | Insulation test | Between entire measurement circuit and outer casing | 5 Μ Ω or more | 0 0 0 0 0 0 0 |
| l | ilisulation test | Apply 500VDC and measure | SIMIZZ OF THOSE | |

Reference Chart for Test Voltages and

Corresponding test voltages according to indicator type

| | Indicator type | 1 | Model name | Operating circuit voltage or maximum rating | Factory-tested voltage | JIS voltage test | JIS mark indication |
|----------------|----------------|-------------------|---|---|------------------------|------------------------------|------------------------------|
| DC ammeters | | | YM-206NDA, YM-208NDA, YM-210NDA | 300V or less 301V~600V | 2210V, 5s 3320V, 5s | 2000V, 1min 2000V, 1min | Indicated Not indicated |
| DC ammeters | | | YM-8NDA, YM-10NDA, YM-12NDA | | | | |
| | | | LM-80NDA, LM-110NDA | 600V or less | 3320V, 5s | 2000V, 1min | Indicated |
| | | | | 1~300V 301V~600V | 2210V, 5s 3320V, 5s | 2000V, 1min 2000V, 1min | Indicated Not indicated |
| DC voltmeters | | | | 601V~1000V | 4300V, 5s | 3000V, 1min | Not indicated Not indicated |
| | | | YM-206NDV, YM-208NDV, YM-210NDV | 1001V~1200V | 4950V, 5s | 5000V, 1min | Not indicated |
| | | | | 1201V~1500V | 5800V, 5s | 5000V, 1min | Not indicated |
| | | | | 1501V~2000V | 7400V, 5s | 5000V, 1min | Not indicated |
| | | | | 1~600V | 3320V, 5s | 2000V, 1min | Indicated |
| | | | | 601V~1000V | 4300V, 5s | 3000V, 1min | Not indicated |
| | | | YM-8NDV, YM-10NDV, YM-12NDV | 1001V~1200V | 4950V, 5s | 5000V, 1min | Not indicated |
| | | | LM-80NDV, LM-110NDV | 1201V~1500V | 5800V, 5s | 5000V, 1min | Not indicated |
| | | | | 1501V~2000V | 7400V, 5s | 5000V, 1min | Not indicated |
| | | | | 300V or less | 2210V, 5s | 2000V, 1min | Indicated |
| | Movable iron | | YS-206NAA, YS-208NAA, YS-210NAA | 301V~600V | 3320V, 5s | 2000V, 1min | Not indicated |
| | | core | | Combined with CT | 2210V, 5s | 2000V, 1min | Indicated |
| | | | YS-8NAA, YS-10NAA, YS-12NAA | 600V or less | 3320V, 5s | 2000V, 1min | Indicated |
| AC ammeters | | | LS-80NAA, LS-110NAA | Combined with CT | 2210V, 5s | 2000V, 1min | Indicated |
| | | | | 300V or less | 2210V, 5s | 2000V, 1min | Indicated |
| | | | YR-206NAA, YR-208NAA, YR-210NAA | 301V~600V | 3320V, 5s | 2000V, 1min | Not indicated |
| | | Rectifier | | Combined with CT | 2210V, 5s | 2000V, 1min | Indicated |
| | | | YR-8NAA, YR-10NAA, YR-12NAA | 600V or less | 3320V, 5s | 2000V, 1min | Indicated |
| | | | LR-80NAA, LR-110NAA | Combined with CT | 2210V, 5s | 2000V, 1min | Indicated |
| | | | YS-206NAV, YS-208NAV, YS-210NAV | 50~300V Combined with VT | 2210V, 5s | 2000V, 1min | Indicated |
| | | Movable iron | YS-8NAV, YS-10NAV | 50~600V | 2210V, 5s 3320V, 5s | 2000V, 1min 2000V, 1min | Indicated Indicated |
| | | Movable iron core | YS-12NAV | Combined with VT | 3320V, 5s | 2000V, 111111 2000V, 1min | Indicated |
| | | | | 150~600V | 3320V, 5s | 2000V, 1min | Indicated |
| AC voltmeters | | | LS-80NAV, LS-110NAV | Combined with VT | 3320V, 5s | 2000V, 1min | Indicated |
| 7.0 70 | • | | 5~300V | | 2210V, 5s | 2000V, 1min | Indicated |
| | | | YR-206NAV, YR-208NAV, YR-210NAV | 301V~600V | 3320V, 5s | 2000V, 1min | Not indicated |
| | | Rectifier | 200.0 (1, 11) 200.0 (1, 11) 210.0 (1 | Combined with VT | 2210V, 5s | 2000V, 1min | Indicated |
| | | | YR-8NAV, YR-10NAV, YR-12NAV | 5~600V | 3320V, 5s | 2000V, 1min | Indicated |
| | | | LR-80NAV, LR-110NAV | Combined with VT | 2210V, 5s | 2000V, 1min | Indicated |
| | | | VP COCNIM VP COCNIM VP CLONIM | 1P2W: 110~220V | 2210V, 5s | 2000V, 1min | Indicated |
| Wattmeters | | | YP-206NW, YP-208NW, YP-210NW | 1P3W: 100/200V | 2210V, 5s | 2000V, 1min | Indicated |
| vvalimeters | | | YP-8NW, YP-10NW, YP-12NW LP-80NW, LP-110NW | 3P3W: 110~220V | 2210V, 5s | 2000V, 1min | Indicated |
| | | | LI -OOIVV, LI -I IOIVV | 3P4W:110/√3/110~220/380V | 2590V, 5s | 2000V, 1min | Indicated |
| Varmeters | | | YP-206NVAR, YP-208NVAR YP-210NVAR | 3P3W: 110~220V | 2210V, 5s | 2000V, 1min | Indicated |
| vaimeters | | | YP-8NVAR, YP-10NVAR, YP-12NVAR LP-80NVAR, LP-110NVAR | 3P4W: 110/√3/110~110/190V | 2210V, 5s | 2000V, 1min | Indicated |
| | | Balanced circuits | YP-206NPF, YP-208NPF, YP-210NPF YP-8NPF, YP-10NPF, YP-12NPF LP-80NPF, LP-110NPF | 3P3W: 110~220V | 2210V, 5s | 2000V, 1min | Indicated |
| Power factor i | meters | Unbalanced | YP-206NPFU, YP-208NPFU YP-210NPFU | 3P3W: 110~220V | 2210V, 5s | 2000V, 1min | Indicated |
| | | loads | YP-8NPFU, YP-10NPFU, YP-12NPFU LP-80NPFU, LP-110NPFU | 3P4W: 110/√3/110~110/190V | 2210V, 5s | 2000V, 1min | Indicated |
| Frequency me | eters | | YP-206NF, YP-208NF, YP-210NF YP-8NF, YP-10NF, YP-12NF LP-80NF, LP-110NF | 110~220V | 2210V, 5s | 2000V, 1min | Indicated |
| | DO in the | Current input | YM-206NRI, YM-208NRI, YM-210NRI YM-8NRI, YM-10NRI, YM-12NRI LM-80NRI, LM-110NRI | 300V or less | 2210V, 5s | 2000V, 1min | Indicated |
| Receiving | DC input | Voltage input | YM-206NRI, YM-208NRI, YM-210NRI YM-8NRI, YM-10NRI, YM-12NRI LM-80NRI, LM-110NRI | 1~300V | 2210V, 5s | 2000V, 1min | Indicated |
| indicators | AC input | Current input | YR-206NRI, YR-208NRI, YR-210NRI YR-8NRI, YR-10NRI, YR-12NRI LR-80NRI, LR-110NRI | 300V or less | 2210V, 5s | 2000V, 1min | Indicated |
| | Ao input | Voltage input | YR-206NRI, YR-208NRI, YR-210NRI YR-8NRI, YR-10NRI, YR-12NRI LR-80NRI, LR-110NRI | 5~300V | 2210V, 5s | 2000V, 1min | Indicated |

JIS Mark

| | Indicator type | | Model name | | cuit voltage or um rating | Factory-tested voltage | JIS voltage test | JIS mark indication | |
|--|---|--|--|--|--|--|---|---|--|
| Indicators with | changeover | AC ammeters | YR-8UNAA, YR-10UNAA, YR-12UNAA | 600V | or less | 3320V, 5s | 2000V, 1min | Indicated | |
| switches | | AC voltmeters | YR-8UNAV, YR-10UNAV, YR-12UNAV | 150- | 150~600V | | 2000V, 1min | Indicated | |
| | | | LB-8ZNAA | 150V | or less | 2210V, 5s | 2000V, 1min | Not indicated | |
| | | AC ammeters | LB-11ZNAA, LB-11ZRNAA | 300V | 300V or less | | 2000V, 1min | Indicated | |
| | | | LB-8ZNAV | 15 | 50V | 2210V, 5s 2210V, 5s | 2000V, 1min | Not indicated | |
| | | AC voltmeters | LB-11ZNAV, LB-11YRNAV | 150V | | 2210V, 5s | 2000V, 1min | Indicated | |
| Demand meter | rs | | | 150V 1P2W: 110~200V | | 2210V, 5s | 2000V, 1min | Indicated | |
| | | Wattmeters | LB-11ZNW, LB-11ZRNW, LB-11YNW | | 110~220V | 2210V, 5s | 2000V, 1min | Indicated | |
| | | | LB-11YRNW | | 3/110~220/380V | 2590V, 5s | 2000V, 1min | Indicated | |
| | | Receiving | LB-11ZNRI, LB-11ZRNRI, LB-11YNRI | | ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,, | | | | |
| indicators | | _ | LB-11YRNRI | 300V | or less | 2210V, 5s | 2000V, 1min | Indicated | |
| Demand meter | r relavs | AC ammeters | | 300V | or less | 2210V, 5s | 2000V, 1min | Not indicated | |
| Domana motor | | 710 4 | YM-210MRNDA, YM-210MRHNDA | | Exterior | 2210V, 5s | 2000V, 1min | Trot maloatoa | |
| | DC ammeters | | LM-11MRNDA, LM-11MRHNDA | 300V or less | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| | | | ENT THAT INDICATE OF THE PROPERTY OF THE PROPE | | Exterior | 2210V, 5s | 2000V, 1min | | |
| | | | YM-210MRNDV, YM-210MRHNDV | 1~300V | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| | DC voltmeters | | , , | | Exterior | 3110V, 5s | 2000V, 1min | | |
| | | | LM-11MRNDV, LM-11MRHNDV | 301~500V | | · · · · · · · · · · · · · · · · · · · | | Not indicated | |
| | | | VP 010MPNA VP 010MPUNA | | Between input and output | 1200V, 1min | 1200V, 1min | | |
| | AC ammeters | | YR-210MRNAA, YR-210MRHNAA | 300V or less | Exterior | 2210V, 5s | 2000V, 1min | Not indicated | |
| | | | LR-11MRNAA, LR-11MRHNAA | | Between input and output | 1200V, 1min | 1200V, 1min | | |
| | AC voltmeters | | YR-210MRNAV, YR-210MRHNAV | 10~300V | Exterior | 2210V, 5s | 2000V, 1min | Not indicated | |
| | | | LR-11MRNAV, LR-11MRHNAV | | Between input and output | 1200V, 1min | 1200V, 1min | | |
| | | | | 1P2W: 110~220V | Exterior | 2210V, 5s | 2000V, 1min | Not indicated | |
| | | | | | Between input and output | 1200V, 1min | 1200V, 1min | | |
| | Wattmeters | | YM-210MRNW, YM-210MRHNW | 3P3W: 110~220V | Exterior | 2210V, 5s | 2000V, 1min | Not indicated | |
| | VVattilleters | LM-11MRNW, LM-11MRHNW | LM-11MRNW, LM-11MRHNW | 31 3VV. 110-220V | Between input and output | 1200V, 1min | 1200V, 1min | 140t indicated | |
| | | | | 3P4W:110/√3/110 | Exterior | 2590V, 5s | 2000V, 1min | Not indicated | |
| Anton volovo | | | | ~220/380V | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| Meter relays | | | | 0D0W-110-000V | Exterior | 2210V, 5s | 2000V, 1min | Nation disease of | |
| | | | YM-210MRNVAR, YM-210MRHNVAR | 3P3W: 110~220V | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| | Varmeters | | LM-11MRNVAR, LM-11MRHNVAR | 3P4W:110/√3/110 | Exterior | 2210V, 5s | 2000V, 1min | Nick in discuss of | |
| | | | | ~110/190V Between input and outpu | | 1200V, 1min | 1200V, 1min | Not indicated | |
| | | | YM-210MRNPF, YM-210MRHNPF | | | 001011 = | | | |
| | | | LM-11MRNPF, LM-11MRHNPF | | Exterior | 2210V, 5s | 2000V, 1min | | |
| | | | YM-210MRNPFU, YM-210MRHNPFU | 3P3W: 110~220V | Between input | | | Not indicated | |
| | Power factor n | neters | LM-11MRNPFU, LM-11MRHNPFU | | and output | 1200V, 1min | 1200V, 1min | | |
| | | | YM-210MRNPFU, YM-210MRHNPFU | 3P4W:110/√3/110 | Exterior | 2210V, 5s | 2000V, 1min | | |
| | | | LM-11MRNPFU, LM-11MRHNPFU | ~110/190V | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| | | | YM-210MRNF, YM-210MRHNF | | Exterior | 2210V, 5s | 2000V, 1min | | |
| | Frequency me | ters | LM-11MRNF, LM-11MRHNF | 110~220V | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| | | Power supply | | | | / | , , | | |
| | | . ono. capp.y | | | Exterior | 2210V 5s | 2000V 1min | | |
| | Receiving | input | I M-11MRNRI I M-11MRHNRI | 300V or less | Exterior Between input and output | 2210V, 5s | 2000V, 1min | Not indicated | |
| | Receiving | Input | LM-11MRNRI, LM-11MRHNRI YM-210MRNRI, YM-210MRHNRI | 300V or less | Between input and output | 1200V, 1min | 1200V, 1min | Not indicated | |
| | indicators | Voltage | YM-210MRNRI, YM-210MRHNRI | 300V or less 1~300V | Between input and output Exterior | 1200V, 1min 2210V, 5s | 1200V, 1min 2000V, 1min | Not indicated | |
| | _ | Voltage input | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI | 1~300V | Between input and output Exterior Between input and output | 1200V, 1min 2210V, 5s 1200V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min | Not indicated | |
| ndicatore with | indicators | Voltage input DC ammeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA | 1~300V | Between input and output Exterior Between input and output or less | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min | Not indicated | |
| | indicators | Voltage input DC ammeters AC ammeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA | 1~300V 300V 300V | Between input and output Exterior Between input and output or less or less | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 2000V, 1min | Not indicated Not indicated Not indicated | |
| | indicators | Voltage input DC ammeters AC ammeters AC Voltmeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV | 1~300V 300V 300V 100- | Between input and output Exterior Between input and output or less or less -300V | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2210V, 5s 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 2000V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated | |
| minimum need | indicators maximum and | Voltage input DC ammeters AC ammeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI | 1~300V 300V 300V 100- 300V | Between input and output Exterior Between input and output or less or less -300V or less | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated | |
| minimum need Earth-leakage | maximum and dles | Voltage input DC ammeters AC ammeters AC Voltmeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD | 1~300V 300V 300V 100- 300V 63.5 | Between input and output Exterior Between input and output or less or less ~300V or less ~150V | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min | Not indicated | |
| minimum need Earth-leakage | maximum and dles | Voltage input DC ammeters AC ammeters AC Voltmeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI | 1~300V 300V 300V 100- 300V 63.5 | Between input and output Exterior Between input and output or less or less -300V or less ~150V -220V | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated | |
| minimum need Earth-leakage Synchroscopes | maximum and dles detectors | Voltage input DC ammeters AC ammeters AC Voltmeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD | 1~300V 300V 300V 100- 300V 63.5 | Between input and output Exterior Between input and output or less or less ~300V or less ~150V | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min | Not indicated | |
| minimum need Earth-leakage Synchroscopes | maximum and dles detectors | Voltage input DC ammeters AC ammeters AC Voltmeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less | Between input and output Exterior Between input and output or less or less -300V or less ~150V -220V Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min 1200V, 1min 2000V, 1min 50V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated | |
| ninimum need Earth-leakage Synchroscopes | maximum and dles detectors | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less | Between input and output Exterior Between input and output or less or less -300V or less ~150V -220V Exterior | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated | |
| ninimum need Earth-leakage Synchroscopes | maximum and dles detectors | Voltage input DC ammeters AC ammeters AC Voltmeters | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less | Between input and output Exterior Between input and output or less or less -300V or less ~150V -220V Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min 1200V, 1min 2000V, 1min 50V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated | |
| ninimum need Earth-leakage Synchroscopes | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less | Between input and output Exterior Between input and output or less or less -300V or less -150V -220V Exterior Between terminals or less | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min 50V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated | |
| Earth-leakage Synchroscopes Dual-element i | maximum and dles detectors | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-210DN, FM-213DN, FM-215DN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V | Between input and output Exterior Between input and output or less or less -300V or less ~150V -220V Exterior Between terminals or less Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min 2210V, 5s 500V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated Indicated Indicated | |
| Earth-leakage Synchroscopes Dual-element i | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators Current input | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-217DN, FM-213DN, FM-215DN FM-217DN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V | Between input and output Exterior Between input and output or less or less -300V or less -150V -220V Exterior Between terminals or less Exterior | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated | |
| Earth-leakage Synchroscopes Dual-element i | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-217DN FM-213SN, FM-215SN FM-217DN FM-210SN, FM-213SN, FM-215SN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V | Between input and output Exterior Between input and output or less or less -300V or less ~150V -220V Exterior Between terminals or less Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min 2210V, 5s 500V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated Indicated Indicated Indicated Indicated | |
| Earth-leakage Synchroscopes Dual-element i | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators Current input | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-217DN FM-213DN, FM-215SN FM-215SN FM-217SN FM-210DN, FM-213SN, FM-215SN FM-217DN FM-210DN, FM-213DN, FM-215DN FM-217SN FM-210DN, FM-213DN, FM-215DN FM-217SN FM-210DN, FM-213DN, FM-215DN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V | Between input and output Exterior Between input and output or less or less -300V or less -150V -220V Exterior Between terminals or less Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min 2210V, 5s 500V, 1min 2210V, 5s 500V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated Indicated Indicated | |
| Earth-leakage Synchroscopes Dual-element i | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators Current input | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-210DN, FM-213DN, FM-215DN FM-217DN FM-217SN FM-213SN, FM-215SN FM-217SN FM-213SN, FM-215SN FM-217DN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V | Between input and output Exterior Between input and output or less or less -300V or less -150V -220V Exterior Between terminals or less Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min 2210V, 5s 500V, 1min 2210V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated Indicated Indicated Indicated Indicated | |
| minimum need | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators Current input | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-210DN, FM-213DN, FM-215DN FM-217SN FM-210SN, FM-213SN, FM-215SN FM-217DN FM-217DN FM-217DN FM-217DN FM-217DN FM-213SN, FM-215DN FM-217DN FM-217DN FM-217DN FM-217DN FM-217DN FR-210SN, FR-213SN, FR-215SN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V 10V or less | Between input and output Exterior Between input and output or less or less -300V or less -150V -220V Exterior Between terminals or less Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 50V, 1min 2210V, 5s 500V, 1min 2210V, 5s 500V, 1min | 1200V, 1min 2000V, 1min 1200V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated Indicated Indicated Indicated Indicated Indicated Indicated Indicated | |
| Earth-leakage Synchroscopes Dual-element i | maximum and dles detectors s indicators | Voltage input DC ammeters AC ammeters AC Voltmeters Receiving indicators Current input Voltage input | YM-210MRNRI, YM-210MRHNRI LM-11MRNRI, LM-11MRHNRI LM-11ZNDA, LM-11YNDA LM-11ZNAA, LM-11YNAA LM-11ZNAV, LM-11YNAV LM-11ZNRI, LM-11YNRI LM-11NGD LI-11NSY LM-11NE FM-210SN, FM-213SN, FM-215SN FM-217SN FM-210DN, FM-213DN, FM-215DN FM-217DN FM-217SN FM-213SN, FM-215SN FM-217SN FM-213SN, FM-215SN FM-217DN | 1~300V 300V 300V 100- 300V 63.5 110- 10V or less 300V 10V or less | Between input and output Exterior Between input and output or less or less ~300V or less ~150V -220V Exterior Between terminals or less Exterior Between terminals 300V Exterior Between terminals | 1200V, 1min 2210V, 5s 1200V, 1min 2210V, 5s 2010V, 5s 500V, 1min 2010V, 5s | 1200V, 1min 2000V, 1min 1200V, 1min 1200V, 1min 2000V, 1min 50V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 2000V, 1min 500V, 1min 2000V, 1min | Not indicated Not indicated Not indicated Not indicated Not indicated Not indicated | |

Note 1. The factory-tested voltages are the values for the voltage test at the time of shipment. (The test may be performed at a value higher than the standard value.)

Note 2. Values in JIS C 1102-1 to 7 (1997 version).

Note 3. In some cases, special specification models (special grade, foreign standards) may not have a JIS mark.

Note 4. Models shown in shaded areas do not have the JIS mark.

Mechanical Indicators

Common Specifications

■Common standard specifications

| | • | | | | | | |
|--------------------------------|--|--|--|--|--|--|--|
| Standards | Direct-acting electrical indicators JIS C 1102-2, JIS C 1102-3, JIS C 1102-4, JIS C 1102-5, JIS C 1102-7 | | | | | | |
| Accuracy (grade) | Class 1.5 or 2.5 (frequency meters: class 0.5 or 1; power factor meters: class 5, synchroscope: class 5) | | | | | | |
| Usage temperature range | re range -5°C to 50°C (reference temperature: 23°C) | | | | | | |
| Usage humidity range | At a relative humidity of 30% to 70%, there are no adverse effects on indications. | | | | | | |
| Mounting attitude | Vertical (the scale plate is vertical with respect to a horizontal surface) | | | | | | |
| Scale plate | Background color: white | | | | | | |
| Cover | Acrylic resin (with antistatic treatment applied) | | | | | | |
| Case | Steel plate or molded product | | | | | | |
| Input signal peak-to-rms ratio | Sine wave $(\sqrt{2})$ | | | | | | |
| Measurement category | CAT Ⅲ (category of measurement performed inside a building facility) | | | | | | |
| Operating environment | 2 (non-conductive pollution only) | | | | | | |
| pollution rating | 2 (non-conductive politition only) | | | | | | |
| Installation altitude | 2,000m or less | | | | | | |
| Usage location | Indoors | | | | | | |
| Mounting panel | Metal panel | | | | | | |
| Voltage test | Rated voltage 300V: 2210V for 5s; rated voltage 600V: 3320V for 5s ^{Note 1} (between electrical circuit and outer casing) | | | | | | |
| Insulation test | 10MΩ or more at a test voltage of 500V (between electrical circuit and outer casing) | | | | | | |
| Storage temperature | -20°C to 60°C | | | | | | |

Note 1. Refer to the Reference Chart for Test Voltages and JIS Mark on p.25/26 for information regarding the circuit voltage ranges of respective models and applicable voltage test values.

■Covers

| Cover specification | Classification | Y-2N Series | Y-N Series | L-N Series |
|---|----------------|---|--|---|
| B design cover (Munsell N 1.5 semi-gloss) | 0 | A @ | A DESCRIPTION OF THE PROPERTY | 40 60 80 = 100 = A = A = 100 = 100 = A = 100 = 1 |
| G design cover (all transparent) | 0 | A @.sa. | WINDOW COMPANY OF THE PARK OF | |
| F design cover Note 1 (special color coating) | Δ | A @ | A State Color Colo | 2000 3000 4000 – 4500 – |
| Cover with red needle (can be manufactured for B, G, and F designs | 0 | A () () () () () () () () () (| 20 30 40 50 A @-man | 40 60 80 = 100 = 1 |

Remarks The B design cover is standard specification. The G and F design covers and covers with red needles can be manufactured if required.
 Note 1. When ordering the F-design cover, please use F as the cover code and specify the color coating. Munsell 7.5BG 4/1.5 will be used for orders with no color coating specified.

Cover codes

| Cover specifications | Without red needle | With red needle |
|----------------------|--------------------|-----------------|
| B design | В | BR*1 |
| G design | G | GR |
| F design | F | FR |

Remarks For the Y-N Series, a B cover with two red needles (BRR cover) can be manufactured depending on the model (please inquire for details).


Accessories

Nuts for mounting screws are provided with all models. T-150 and other special accessories are indicated in the specification columns of the respective indicator types.

Mechanical Indicators

Common Specifications

Scale plate components and items indicated

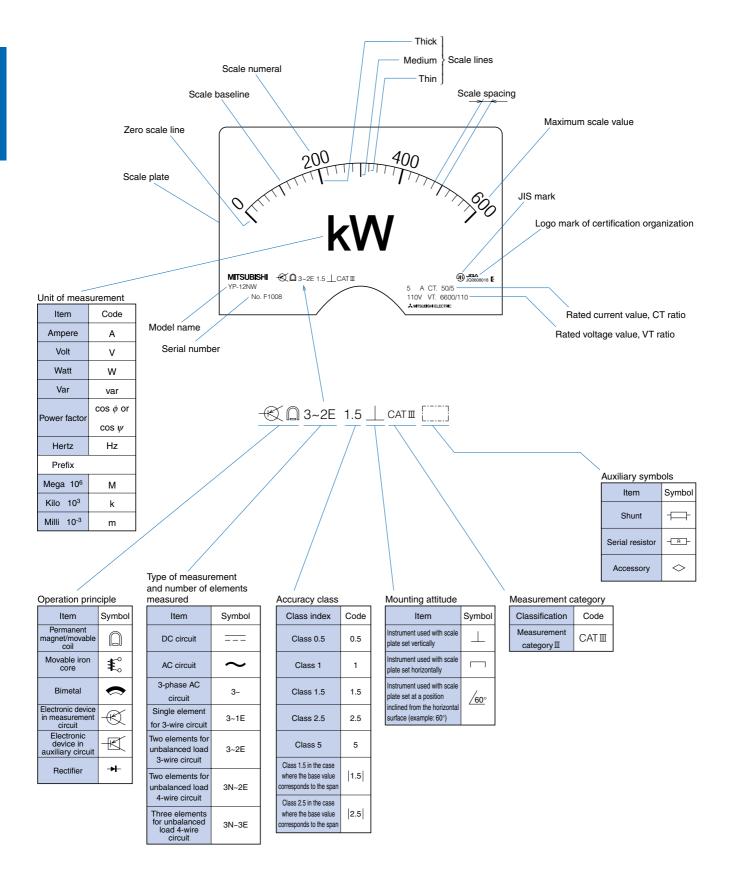

■Scale plate indications

The following tables show the scales, including numerals, colored lines, bands and colors, used as standard specifications. Red, blue, green and yellow are used for the colored lines/bands.

| | Y-2N Series | Y-N Series | L-N Series |
|---|---|------------------------|---|
| Standard scale | | 5 10 10 | 100 200 |
| Expanded scale (expanded by 3 times) | 5 10 30 | 0,111 15 | 300 400 200 500 100 1000 0 1500 |
| Positive/ Negative scale | 20,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,, | 20 - + >0 | 750 50 - + |
| Single scale with double stamp | 100 200 100 50 100 100 100 100 100 100 100 10 | 10 20 30 5 75 | 200 400 100 200 0 600 300 |
| Double scale with double stamp | 10 10 16 | 200 400 | 100 600 400 150 200 1000 0 1200 0 250 |
| Colored lines Colored bands | Colored band | Colored line 5 10 line | Colored band |

Remarks (1) See the "Standard Scale Diagrams" on pp.31 to 34 regarding the scale division with respect to the maximum scale value.

(2) Special scales can also be manufactured.



Standard Scale Diagrams

1a. Y-206N ordinary scale indicators

1b. Y-206N expanded scale indicators

| Maximum | | Number | Single | Maximum | | Number | Single |
|--------------------------|---|-----------|-----------------------|--------------------------|--|-----------|------------------------|
| scale | Scale specification | of | space | scale | Scale specification | of | space |
| value | | divisions | reading | value | | divisions | reading |
| 1 10 100 1000 | 0 2 4 6 8 10 | 10 | 0.1 1 10 100 | 1 10 100 1000 | 0 5 10 20 30 | 10 | 0.1 1 10 100 |
| 1.2 12 120 1200 | 0 3 6 9 12 1 1 1 1 1 1 1 1 1 1 | 12 | 0.1 1 10 100 | 1.2 12 120 1200 | 0 3 6 9 12 24 36 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 12 | 0.1 1 10 100 |
| 1.5 15 150 1500 | 0 5 10 15 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 15 | 0.1 1 10 100 | 1.5 15 150 1500 | 0 5 10 15 30 45 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 15 | 0.1 1 10 100 |
| 2 20 200 2000 | 0 5 10 15 20 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 20 | 0.1 1 10 100 | 2 20 200 2000 | 0 10 20 40 60 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 20 | 0.1 1 10 100 |
| 2.5 25 250 2500 | 0 5 10 15 20 25 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 25 | 0.1 1 10 100 | 2.5 25 250 2500 | 0 5 10 15 20 25 50 75 | 25 | 0.1 1 10 100 |
| 3 30 300 3000 | 0 10 20 30 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 15 | 0.2 2 20 200 | 3 30 300 3000 | 0 10 20 30 60 90 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 15 | 0.2 2 20 200 |
| 4 40 400 4000 | 0 10 20 30 40 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 20 | 0.2 2 20 200 | 4 40 400 4000 | 0 10 20 30 40 80 120 | 8 | 0.5 5 50 500 |
| 4.5 45 450 4500 | 0 10 20 30 40 45 1 1 1 1 1 1 1 1 1 1 | 22.5 | 0.2 2 20 200 | _ | | _ | _ |
| 5 50 500 5000 | 0 10 20 30 40 50 1 1 1 1 1 1 1 | 10 | 0.5 5 50 500 | 5 50 500 5000 | 0 10 20 30 40 50 100 150 | 10 | 0.5 5 50 500 |
| 6 60 600 6000 | 0 20 40 60 1 1 1 1 1 1 1 1 1 1 1 | 12 | 0.5 5 50 500 | 6 60 600 6000 | 0 20 40 60 120 180 | 12 | 0.5 5 50 500 |
| 7.5 75 750 7500 | 0 20 40 60 75 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 15 | 0.5 5 50 500 | 7.5 75 750 7500 | 0 25 50 75 150 225 1 | 15 | 0.5 5 50 500 |
| 8 80 800 8000 | 0 20 40 60 80 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 16 | 0.5 5 50 500 | 8 80 800 8000 | 0 20 40 60 80 160 240 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 16 | 0.5 5 50 500 |
| 9 90 900 9000 | 0 30 60 90 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 18 | 0.5 5 50 500 | 9 90 900 9000 | 0 30 60 90 180 270 | 9 | 1 10 100 1000 |

Remarks The ranges underlined in the Scale specification column of the table above are omitted for indicators where the interval between scale marks are very small close to the zero point (e.g., an indicator with a movable iron core).

2a. Y-208N and Y-210N ordinary scale indicators 2b. Y-208N and Y-210N expanded scale indicators

| Maximum scale value | Scale specification | Number of divisions | Single space reading | Maximum scale value | Scale specification | | Number of divisions | Single space reading |
|---------------------------|---|---------------------------|----------------------------|---------------------------|--|----------------------|---------------------|----------------------------|
| 1 10 100 1000 | 0 2 4 6 8 10 | 20 | 0.05 0.5 5 50 | 1 10 100 1000 | 0 5 10 <u> </u> | 20 30 I I | 20 | 0.05 0.5 5 50 |
| 1.2 12 120 1200 | 0 3 6 9 12 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 24 | 0.05 0.5 5 50 | 1.2 12 120 1200 | 0 3 6 9 12 | 24 36 I I | 24 | 0.05 0.5 5 50 |
| 1.5 15 150 1500 | 0 5 10 15 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 15 | 0.1 1 10 100 | 1.5 15 150 1500 | 0 5 10 15 | 30 45 | 15 | 0.1 1 10 100 |
| 2 20 200 200 | 0 5 10 15 20 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 20 | 0.1 1 10 100 | 2 20 200 200 | 0 10 20 <u> </u> | 40 60 I I | 20 | 0.1 1 10 100 |
| 2.5 25 250 2500 | 0 5 10 15 20 25 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 25 | 0.1 1 10 100 | 2.5 25 250 2500 | 0 5 10 15 20 25 | 50 75 | 25 | 0.1 1 10 100 |
| 3 30 300 3000 | 0 10 20 30 <u> </u> | 30 | 0.1 1 10 100 | 3 30 300 3000 | 0 10 20 30 | 60 90 I I | 15 | 0.2 2 20 200 |
| 4 40 400 400 | 0 10 20 30 40 | 20 | 0.2 2 20 200 | 4 40 400 400 | 0 10 20 30 40 <u> </u> | 80 120 I I | 20 | 0.2 2 20 200 |
| 4.5 45 450 4500 | 0 10 20 30 40 45 | 22.5 | 0.2 2 20 200 | _ | | | _ | _ |
| 5 50 500 5000 | 0 10 20 30 40 50 | 25 | 0.2 2 20 200 | 5 50 500 5000 | 0 10 20 30 40 50 | 100 150 | 25 | 0.2 2 20 200 |
| 6 60 600 6000 | 0 20 40 60 <u> </u> | 30 | 0.2 2 20 200 | 6 60 600 6000 | 0 20 40 60 1 1 1 1 1 1 | 120 180 | 12 | 0.5 5 50 500 |
| 7.5 75 750 7500 | 0 20 40 60 75 _ 1 1 1 1 1 1 1 | 15 | 0.5 5 50 500 | 7.5 75 750 7500 | 0 25 50 75 | 150 225 | 15 | 0.5 5 50 500 |
| 8 80 800 8000 | 0 20 40 60 80 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 16 | 0.5 5 50 500 | 8 80 800 8000 | 0 20 40 60 80 _ | 160 240 | 16 | 0.5 5 50 500 |
| 9 90 900 9000 | 0 30 60 90 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | 18 | 0.5 5 50 500 | 9 90 900 9000 | 0 30 60 90 <u> </u> | 180 270 | 18 | 0.5 5 50 500 |

Remarks The ranges underlined in the Scale specification column of the table above are omitted for indicators where the interval between scale marks are very small close to the zero point (e.g., an indicator with a movable iron core).

3a. Y-8N and Y-10N ordinary scale indicators 3b. Y-8N and Y-10N expanded scale indicators

| Maximum | | Number | Single | Maximum | | Number | Single |
|--------------------------|---------------------|-----------|------------------------|--------------------------|--------------------------|-----------|--------------------------|
| scale | Scale specification | of | space | scale | Scale specification | of | space |
| value | • | divisions | reading | value | ' | divisions | reading |
| 1 10 100 1000 | 0 2 4 6 8 10 | 20 | 0.05 0.5 5 | 1 10 100 1000 | 0 5 10 20 30 | 20 | 0.05 0.5 5 50 |
| 1.2 12 120 1200 | 0 3 6 9 12 | 24 | 0.05 0.5 5 50 | 1.2 12 120 1200 | 0 3 6 9 12 24 36 | 24 | 0.05 0.5 5 50 |
| 1.5 15 150 1500 | 0 5 10 15 | 15 | 0.1 1 10 100 | 1.5 15 150 1500 | 0 5 10 15 30 45 | 15 | 0.1 1 10 100 |
| 2 20 200 2000 | 0 5 10 15 20 | 20 | 0.1 1 10 100 | 2 20 200 2000 | 0 10 20 40 60 | 20 | 0.1 1 10 100 |
| 2.5 25 250 2500 | 0 5 10 15 20 25 | 25 | 0.1 1 10 100 | 2.5 25 250 2500 | 0 5 10 15 20 25 50 75 | 25 | 0.1 1 10 100 |
| 3 30 300 3000 | 0 10 20 30 | 30 | 0.1 1 10 100 | 3 30 300 3000 | 0 10 20 30 60 90 | 15 | 0.2 2 20 200 |
| 4 40 400 4000 | 0 10 20 30 40 | 40 | 0.1 1 10 100 | 4 40 400 4000 | 0 10 20 30 40 80 120 | 20 | 0.2 2 20 200 |
| 4.5 45 450 4500 | 0 10 20 30 40 45 | 22.5 | 0.2 2 20 200 | _ | | _ | _ |
| 5 50 500 5000 | 0 10 20 30 40 50 | 25 | 0.2 2 20 200 | 5 50 500 5000 | 0 10 20 30 40 50 100 150 | 25 | 0.2 2 20 200 |
| 6 60 600 6000 | 0 20 40 60 | 30 | 0.2 2 20 200 | 6 60 600 6000 | 0 20 40 60 120 180 | 12 | 0.5 5 50 500 |
| 7.5 75 750 7500 | 0 20 40 60 75 | 15 | 0.5 5 50 500 | 7.5 75 750 7500 | 0 25 50 75 150 225 | 15 | 0.5 5 50 500 |
| 8 80 800 8000 | 0 20 40 60 80 | 16 | 0.5 5 50 500 | 8 80 800 8000 | 0 20 40 60 80 160 240 | 16 | 0.5 5 50 500 |
| 9 90 900 9000 | 0 30 60 90 | 18 | 0.5 5 50 500 | 9 90 900 9000 | 0 30 60 90 180 270 | 18 | 0.5 10 100 1000 |

Remarks The ranges underlined in the Scale specification column of the table above are omitted for indicators where the interval between scale marks are very small close to the zero point (e.g., an indicator with a movable iron core).

4a. Y-12N ordinary scale indicators

4b. Y-12N expanded scale indicators

| Maximum | | Number | Single | Maximum | | Number | Single |
|--------------------------|----------------------|-----------|------------------------|--------------------------|------------------------------|-----------|------------------------|
| scale | Scale specification | of | space | scale | Scale specification | of | space |
| value | | divisions | reading | value | | divisions | reading |
| 1 10 100 1000 | 0 2 4 6 8 10 | 50 | 0.02 0.2 2 20 | 1 10 100 1000 | 0 5 10 20 30 | 20 | 0.05 0.5 5 50 |
| 1.2 12 120 1200 | 0 3 6 9 12 | 24 | 0.05 0.5 5 50 | 1.2 12 120 1200 | 0 3 6 9 12 24 36 | 24 | 0.05 0.5 5 50 |
| 1.5 15 150 1500 | 0 5 10 15 | 30 | 0.05 0.5 5 50 | 1.5 15 150 1500 | 0 5 10 15 30 45 | 15 | 0.1 1 10 100 |
| 2 20 200 2000 | | 40 | 0.05 0.5 5 50 | 2 20 200 2000 | 0 5 10 15 20 40 60 | 20 | 0.1 1 10 100 |
| 2.5 25 250 2500 | 0 5 10 15 20 25 | 25 | 0.1 1 10 100 | 2.5 25 250 2500 | 0 5 10 15 20 25 50 75 | 25 | 0.1 1 10 100 |
| 3 30 300 3000 | 0 10 20 30 | 30 | 0.1 1 10 100 | 3 30 300 3000 | 0 10 20 30 60 90 | 15 | 0.2 2 20 200 |
| 4 40 400 4000 | 0 10 20 30 40 | 40 | 0.1 1 10 100 | 4 40 400 4000 | 0 10 20 30 40 80 120 | 20 | 0.2 2 20 200 |
| 4.5 45 450 4500 | 0 10 20 30 40 45 | 45 | 0.1 1 10 100 | _ | | _ | _ |
| 5 50 500 5000 | 0 10 20 30 40 50 | 50 | 0.1 1 10 100 | 5 50 500 5000 | 0 10 20 30 40 50 100 150 | 25 | 0.2 2 20 200 |
| 6 60 600 6000 | 0 20 40 60 | 30 | 0.2 2 20 200 | 6 60 600 6000 | 0 20 40 60 120 180 | 30 | 0.2 2 20 200 |
| 7.5 75 750 7500 | 0 20 40 60 75 [| 37.5 | 0.2 2 20 200 | 7.5 75 750 7500 | 0 25 50 75 150 225 | 15 | 0.5 5 50 500 |
| 8 80 800 8000 | 0 20 40 60 80 | 40 | 0.2 2 20 200 | 8 80 800 8000 | 0 20 40 60 80 160 240 | 16 | 0.5 5 50 500 |
| 9 90 900 9000 | 0 30 60 90 | 45 | 0.2 2 20 200 | 9 90 900 9000 | 0 30 60 90 180 270 | 18 | 0.5 5 50 500 |

Remarks The ranges underlined in the Scale specification column of the table above are omitted for indicators where the interval between scale marks are very small close to the zero point (e.g., an indicator with a movable iron core).



Standard Scale Diagrams

5a. L-110N ordinary scale indicators

5b. L-110N expanded scale indicators

| Maximum | | Number | Single | Maximum | | Number | Single |
|--------------------------|---------------------|-----------|------------------------|--------------------------|--------------------------|-----------|------------------------|
| scale | Scale specification | of | space | scale | Scale specification | of | space |
| value | | divisions | reading | value | | divisions | reading |
| 1 10 100 1000 | 0 2 4 6 8 10 | 50 | 0.02 0.2 2 20 | 1 10 100 1000 | 0 5 10 20 30 | 20 | 0.05 0.5 5 50 |
| 1.2 12 120 1200 | 0 2 4 6 8 10 12 | 24 | 0.05 0.5 5 50 | 1.2 12 120 1200 | 0 3 6 9 12 24 36 | 24 | 0.05 0.5 5 50 |
| 1.5 15 150 1500 | 0 5 10 15 | 30 | 0.05 0.5 5 50 | 1.5 15 150 1500 | 0 5 10 15 30 45 | 30 | 0.05 0.5 5 50 |
| 2 20 200 2000 | 0 5 10 15 20 | 40 | 0.05 0.5 5 50 | 2 20 200 2000 | 0 5 10 15 20 40 60 | 40 | 0.05 0.5 5 50 |
| 2.5 25 250 2500 | 0 5 10 15 20 25 | 25 | 0.1 1 10 100 | 2.5 25 250 2500 | 0 5 10 15 20 25 50 75 | 25 | 0.1 1 10 100 |
| 3 30 300 3000 | 0 10 20 30 | 30 | 0.1 1 10 100 | 3 30 300 3000 | 0 10 20 30 60 90 | 30 | 0.1 1 10 100 |
| 4 40 400 4000 | 0 10 20 30 40 | 40 | 0.1 1 10 100 | 4 40 400 4000 | 0 10 20 30 40 80 120 | 20 | 0.2 2 20 200 |
| 4.5 45 450 4500 | 0 10 20 30 40 45 | 45 | 0.1 1 10 100 | _ | | _ | _ |
| 5 50 500 5000 | 0 10 20 30 40 50 | 50 | 0.1 1 10 100 | 5 50 500 5000 | 0 10 20 30 40 50 100 150 | 25 | 0.2 2 20 200 |
| 6 60 600 6000 | 0 20 40 60 | 30 | 0.2 2 20 200 | 6 60 600 6000 | 0 20 40 60 120 180 | 30 | 0.2 2 20 200 |
| 7.5 75 750 7500 | 0 20 40 60 75 | 37.5 | 0.2 2 20 200 | 7.5 75 750 7500 | 0 25 50 75 150 225 | 15 | 0.5 5 50 500 |
| 8 80 800 8000 | 0 20 40 60 80 | 40 | 0.2 2 20 200 | 8 80 800 8000 | 0 20 40 60 80 160 240 | 40 | 0.2 2 20 200 |
| 9 90 900 9000 | 0 30 60 90 | 45 | 0.2 2 20 200 | 9 90 900 9000 | 0 30 60 90 180 270 | 18 | 0.5 5 50 500 |

Remarks The ranges underlined in the Scale specification column of the table above are omitted for indicators where the interval between scale marks are very small close to the zero point (e.g., an indicator with a movable iron core).

6a. L-80N ordinary scale indicators

6b. L-80N expanded scale indicators

| | | IN I | 0: 1 | | | IN I | 0: 1 |
|--------------------------|---------------------|-----------|------------------------|--------------------------|--------------------------|-----------|------------------------|
| Maximum | | Number | - 3 - | Maximum | | Number | Single |
| scale | Scale specification | of | space | scale | Scale specification | of | space |
| value | | divisions | reading | value | | divisions | reading |
| 1 10 | | 50 | 0.02 0.2 | 1 10 | | | 0.05 0.5 |
| 100 1000 | 0 2 4 6 8 10 | 50 | 2 20 | 100 1000 | 0 5 10 20 30 | 20 | 5 50 |
| 1.2 12 120 | 0 2 4 6 8 10 12 | 24 | 0.05 0.5 5 | 1.2 12 120 | | 24 | 0.05 0.5 5 |
| 1200 | | | 50 | 1200 | | | 50 |
| 1.5 15 150 1500 | 0 5 10 15 | 30 | 0.05 0.5 5 50 | 1.5 15 150 1500 | 0 5 10 15 30 45 | 30 | 0.05 0.5 5 50 |
| 2 20 200 2000 | 0 5 10 15 20 | 40 | 0.05 0.5 5 50 | 2 20 200 2000 | 0 5 10 15 20 40 60 | 40 | 0.05 0.5 5 50 |
| 2.5 25 250 2500 | 0 5 10 15 20 25 | 25 | 0.1 1 10 100 | 2.5 25 250 2500 | 0 5 10 15 20 25 50 75 | 25 | 0.1 1 10 100 |
| 3 30 300 3000 | 0 10 20 30 | 30 | 0.1 1 10 100 | 3 30 300 3000 | 0 10 20 30 60 90 | 30 | 0.1 1 10 100 |
| 4 40 400 4000 | 0 10 20 30 40 | 40 | 0.1 1 10 100 | 4 40 400 4000 | 0 10 20 30 40 80 120 | 20 | 0.2 2 20 200 |
| 4.5 45 450 4500 | 0 10 20 30 40 45 | 22.5 | 0.2 2 20 200 | _ | | _ | _ |
| 5 50 500 5000 | 0 10 20 30 40 50 | 25 | 0.2 2 20 200 | 5 50 500 5000 | 0 10 20 30 40 50 100 150 | 25 | 0.2 2 20 200 |
| 6 60 600 6000 | 0 20 40 60 | 30 | 0.2 2 20 200 | 6 60 600 | 0 20 40 60 120 180 | 30 | 0.2 2 20 200 |
| 7.5 75 750 7500 | 0 20 40 60 75 | 37.5 | 0.2 2 20 200 | 7.5 75 750 7500 | 0 25 50 75 150 225 | 15 | 0.5 5 50 500 |
| 8 80 800 8000 | 0 20 40 60 80 | 40 | 0.2 2 20 200 | 8 80 800 8000 | 0 20 40 60 80 160 240 | 40 | 0.2 2 20 200 |
| 9 90 900 9000 | 0 30 60 90 | 45 | 0.2 2 20 200 | 9 90 900 9000 | 0 30 60 90 180 270 | 18 | 0.5 5 50 500 |

Remarks The ranges underlined in the Scale specification column of the table above are omitted for indicators where the interval between scale marks are very small close to the zero point (e.g., an indicator with a movable iron core).

7a. F-210N ordinary scale indicators (Class 2.5)

| Maximum scale value | 1 10 100 1000 | 1.2 12 120 1200 | 1.5 15 150 1500 | 2 20 200 2000 | 2.5 25 250 2500 | 3 30 300 3000 | 4 40 400 4000 | 4.5 45 450 4500 | 5 50 500 5000 | 6 60 600 6000 | 7.5 75 750 7500 | 8 80 800 8000 | 9 90 900 9000 |
|------------------------------|--|---|--------------------------|------------------------|--------------------------|------------------------|------------------------|---|------------------------|------------------------|--------------------------|------------------------|------------------------|
| Scale specification | 10 8 8 6 6 6 7 4 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 | 9 - 9 - 6 - 7 - 7 - 7 - 7 - 7 - 7 - 7 - 7 - 7 | 15 | 20 | 25 | 20 | 40 | 45 - 40 - 30 - 20 - 10 - 0 | 50 | 40 | 75 | 80 | 90 |
| Number of divisions | 20 | 24 | 30 | 20 | 25 | 30 | 20 | 22.5 | 25 | 30 | 15 | 16 | 18 |
| Single spacing reading | 0.05 0.5 5 | 0.05 0.5 5 | 0.05 0.5 5 | 0.1 1 10 100 | 0.1 1 10 100 | 0.1 1 10 100 | 0.2 2 20 200 | 0.2 2 20 200 | 0.2 2 20 200 | 0.2 2 20 200 | 0.5 5 50 500 | 0.5 5 50 500 | 0.5 5 50 500 |


8a. F-213N, F-215N, and F217N ordinary scale indicators

| Maximum scale value | 1 10 100 1000 | 1.2 12 120 1200 | 1.5 15 150 1500 | 2 20 200 2000 | 2.5 25 250 2500 | 3 30 300 3000 | 4 40 400 4000 | 4.5 45 450 4500 | 5 50 500 5000 | 6 60 600 | 7.5 75 750 7500 | 8 80 800 8000 | 9 90 900 9000 |
|------------------------------|------------------------|--------------------------|--------------------------|------------------------|--|------------------------|------------------------|--------------------------|------------------------|-----------------------|--------------------------|------------------------|------------------------|
| Scale specification | 8 6 4 4 4 0 | 9 - 6 - 3 - 0 | 15 | 20 | 25 15 15 10 10 11 10 11 10 11 10 11 10 11 10 11 10 11 10 11 10 11 10 10 | 20 | 30 | 45 | 30 | 60 | 75 | 60 | 90 |
| Number of divisions | 50 | 24 | 30 | 40 | 50 | 30 | 40 | 45 | 50 | 30 | 37.5 | 40 | 45 |
| Single spacing reading | 0.02 0.2 2 20 | 0.05 0.5 5 50 | 0.05 0.5 5 50 | 0.05 0.5 5 50 | 0.05 0.5 5 50 | 0.1 1 10 100 | 0.1 1 10 100 | 0.1 1 10 100 | 0.1 1 10 100 | 0.2 2 20 200 | 0.2 2 20 200 | 0.2 2 20 200 | 0.2 2 20 200 |

М

Outer Dimension Drawings


Rectangular indicators (Y-2N Series)

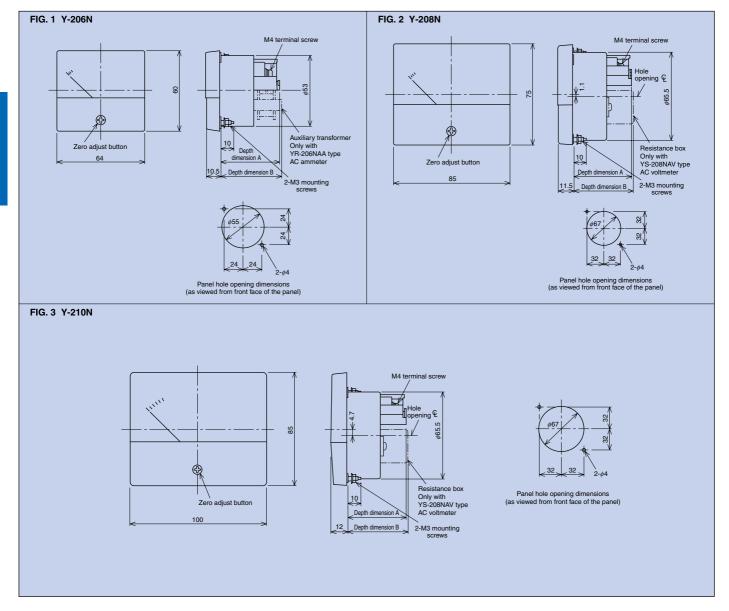

Depth dimension details

| | Indicator | tuno | Y-20 |)6N | | Y-20 | 08N | | Y-2 | 10N | |
|----|----------------------|---------------|------------|-------------|-------------|------------|-------------|-------------|------------|-------------|-------------|
| | mulcator | туре | Type name | A dimension | B dimension | Type name | A dimension | B dimension | Type name | A dimension | B dimension |
| DC | Amm | eters | YM-206NDA | 43 | _ | YM-208NDA | 43 | _ | YM-210NDA | 43 | _ |
| ЬС | | neters | YM-206NDV | 43 | _ | YM-208NDV | 43 | _ | YM-210NDV | 43 | _ |
| | Amm | eters | YS-206NAA | 43 | _ | YS-208NAA | 43 | _ | YS-210NAA | 43 | _ |
| | | Uniform scale | YR-206NAA | 43 | 44 | YR-208NAA | 43 | _ | YR-210NAA | 43 | _ |
| | Voltmeters | | YS-206NAV | 43 | _ | YS-208NAV | 43 | 45 | YS-210NAV | 43 | 45 |
| | | Uniform scale | YR-206NAV | 43 | _ | YR-208NAV | 43 | _ | YR-210NAV | 43 | _ |
| AC | Wattn | neters | YP-206NW | 43 | _ | YP-208NW | 43 | _ | YP-210NW | 43 | _ |
| | Varm | eters | YP-206NVAR | 43 | _ | YP-208NVAR | 43 | _ | YP-210NVAR | 43 | _ |
| | Power-factor | Balanced | YP-206NPF | 43 | _ | YP-208NPF | 43 | _ | YP-210NPF | 43 | _ |
| | meters | Unbalanced | YP-206NPFU | 43 | _ | YP-208NPFU | 43 | _ | YP-210NPFU | 43 | _ |
| | Frequency meters | | YP-206NF | 83 | _ | YP-208NF | 83 | _ | YP-210NF | 83 | _ |
| | Receiving DC indicat | | YM-206NRI | 43 | _ | YM-208NRI | 43 | _ | YM-210NRI | 43 | _ |
| | indicators | AC indicators | YR-206NRI | 43 | _ | YR-208NRI | 43 | _ | YR-210NRI | 43 | _ |

Rectangular indicators (Y-N Series)

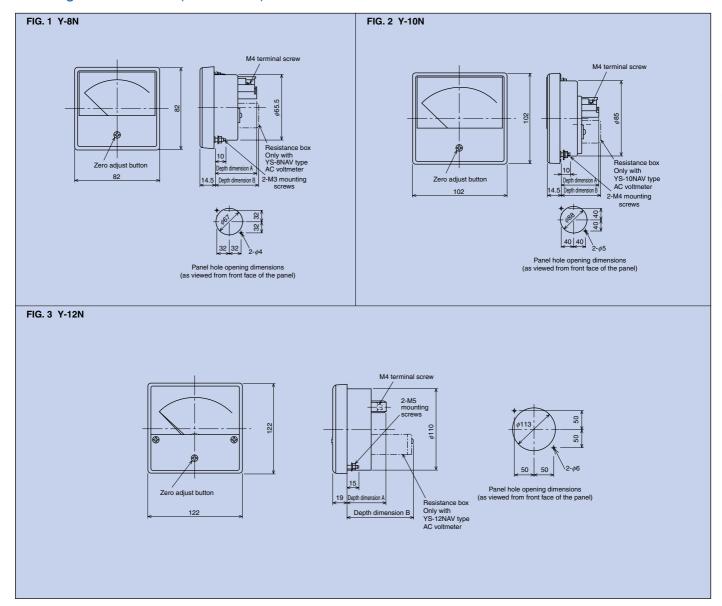

Depth dimension details


| | Indicator | tuno | Y-8 | BN | | Y-1 | 0N | | Y-1 | 2N | |
|----|--------------|---------------|-----------|-------------|-------------|-----------|-------------|-------------|-----------|-------------|-------------|
| | mulcator | type | Type name | A dimension | B dimension | Type name | A dimension | B dimension | Type name | A dimension | B dimension |
| DC | Amm | eters | YM-8NDA | 41 | _ | YM-10NDA | 41 | _ | YM-12NDA | 50 | _ |
| ВС | | eters | YM-8NDV | 41 | _ | YM-10NDV | 41 | _ | YM-12NDV | 50 | _ |
| | Amm | eters | YS-8NAA | 41 | _ | YS-10NAA | 41 | | YS-12NAA | 50 | _ |
| | | Uniform scale | YR-8NAA | 41 | _ | YR-10NAA | 41 | _ | YR-12NAA | 50 | _ |
| | Voltm | eters | YS-8NAV | 41 | 43 | YS-10NAV | 41 | 43 | YS-12NAV | 50 | 85 |
| | | Uniform scale | YR-8NAV | 41 | _ | YR-10NAV | 41 | _ | YR-12NAV | 50 | _ |
| AC | Wattmeters | | YP-8NW | 41 | _ | YP-10NW | 41 | _ | YP-12NW | 100 | _ |
| | Varm | eters | YP-8NVAR | 41 | _ | YP-10NVAR | 41 | | YP-12NVAR | 100 | _ |
| | Power-factor | Balanced | YP-8NPF | 81 | _ | YP-10NPF | 81 | | YP-12NPF | 50 Note | _ |
| | meters | Unbalanced | YP-8NPFU | 41 | _ | YP-10NPFU | 41 | _ | YP-12NPFU | 100 | _ |
| | Frequenc | y meters | YP-8NF | 81 | _ | YP-10NF | 81 | _ | YP-12NF | 50 | _ |
| | Receiving | DC indicators | YM-8NRI | 41 | _ | YM-10NRI | 41 | _ | YM-12NRI | 50 | _ |
| | indicators | AC indicators | YR-8NRI | 41 | _ | YR-10NRI | 41 | | YR-12NRI | 50 | _ |

Note. 100mm in the case of a model for 1-phase 2-wire systems.



Outer Dimensional Drawings (Refer to the specification tables regarding models other than the Y-2N series, Y-N series, and L-N series.)


Wide-angle indicators (L-N Series)

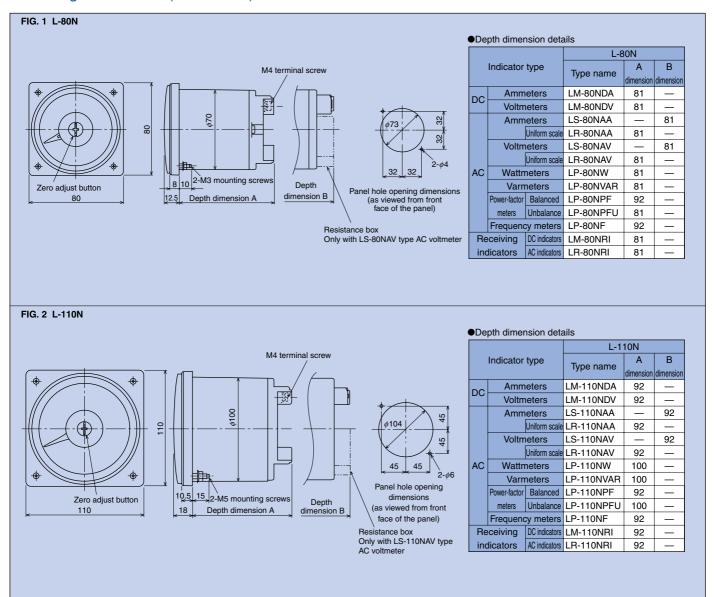



Overall Connection Examples


1. 1-phase, 3-wire circuit

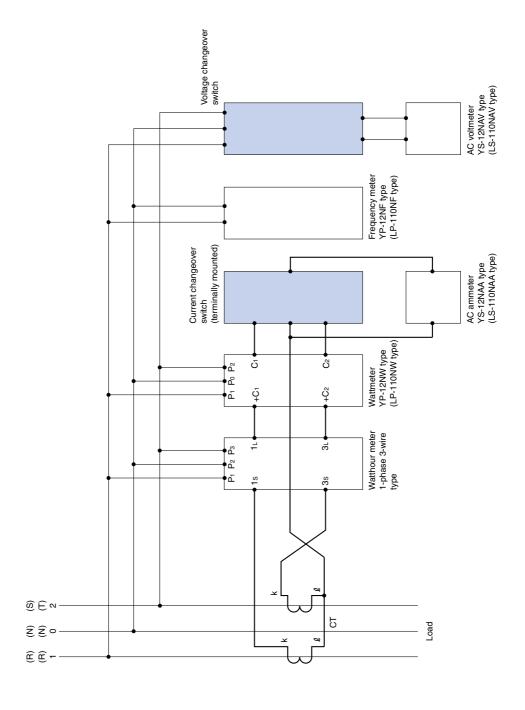




Overall Connection Examples

2. 3-phase, 3-wire circuit (2CT)

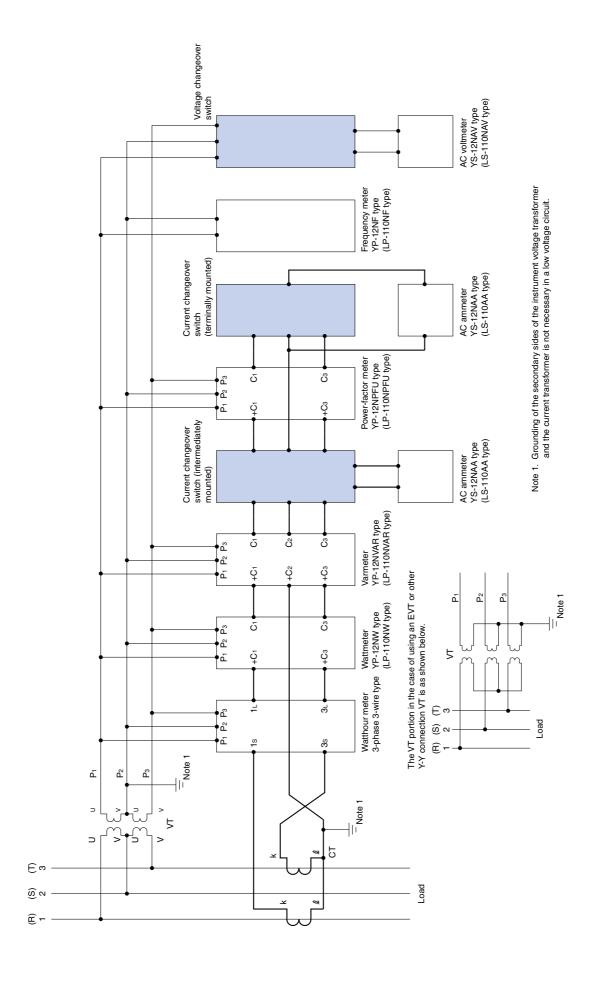


3. 3-phase, 3-wire circuit (3CT)

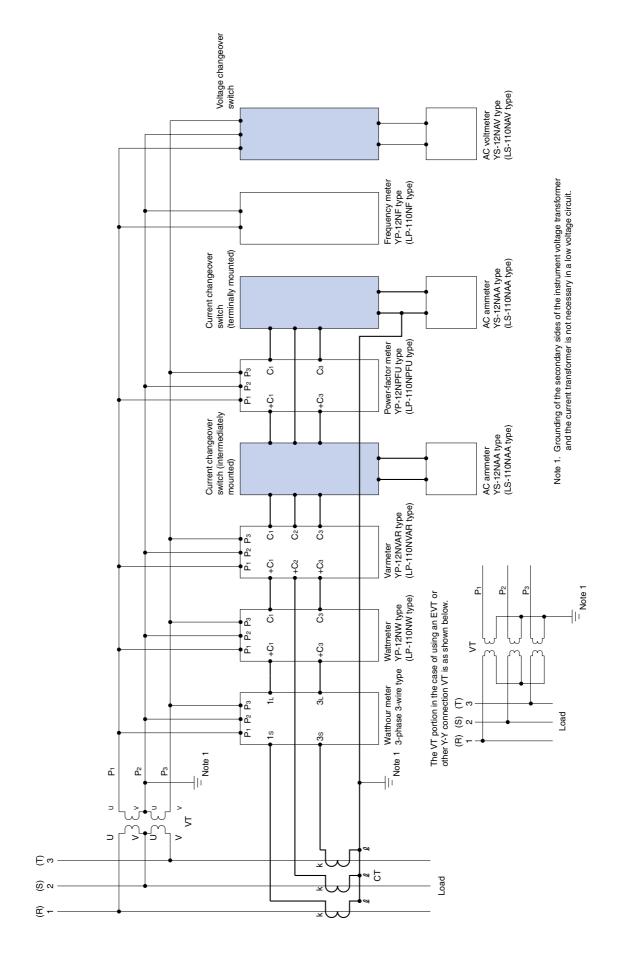

Overall Connection Examples

4. 3-phase, 4-wire circuit

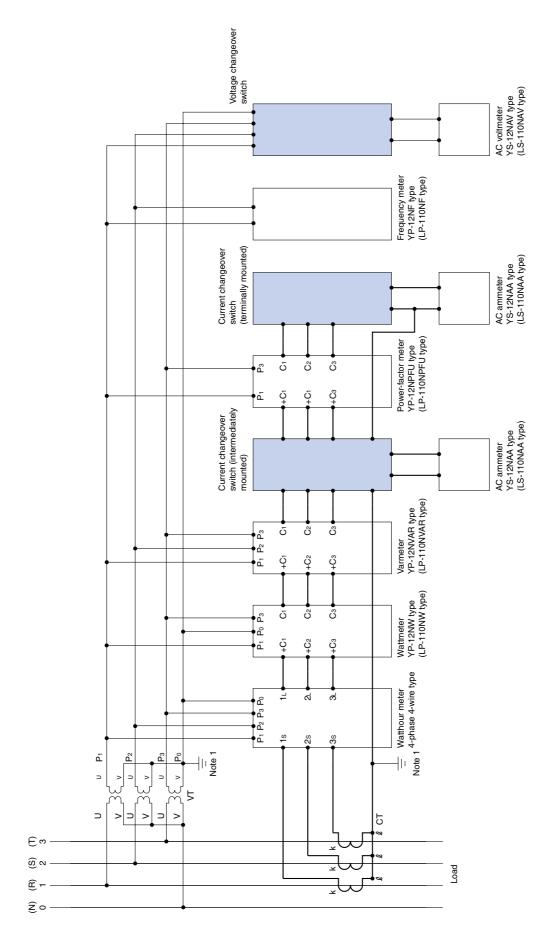

Note 1. Grounding of the secondary sides of the instrument voltage transformer and the current transformer is not necessary in a low voltage circuit.

DC Ammeters







■Specifications

YM-206NDA

YM-8NDA

LM-110NDA

| | | | | | | Rectangula | r indicators | | | Wide-angle indicators | | | |
|------------------|--|--|--------------------|-----------|--------------------|------------|--------------|-------------------|----------------|-----------------------|--------------------|--|--|
| | | | | | Y-2N Series | | | Y-N Series | | L-N S | Series | | |
| Siz | e (width > | < height) | mm | 64×60 | 85×75 | 100×85 | 82×82 | 102×102 | 122×122 | 80×80 | 110×110 | | |
| Мо | del name | | | YM-206NDA | YM-208NDA | YM-210NDA | YM-8NDA | YM-10NDA | YM-12NDA | LM-80NDA | LM-110NDA | | |
| Ope | eration pr | inciple | | | Movable coil | | | Movable coil | | Movable coil | | | |
| Acc | curacy (gr | ade) | | | 2.5 | | 2. | 5 | 2.5 | 1.5 | | | |
| Sca | ale length | | (mm) | 55 | 70 | 85 | 70 | 90 | 100 | 124 | 175 | | |
| We | ight | | (kg) | 0.07 | 0.1 | 0.1 | 0.1 | 0.15 | 0.3 | 0.4 | | | |
| | | num scale /alue | Delivery period | | | ор | | | | | | | |
| . Ε 100μΑ Δ | | | Δ | | 2000Ω | | 200 | Ω0 | 5000Ω | _ | _ | | |
| ifica | 200μΑ Δ | | | | 1200Ω | | 120 | Ω | 5000Ω | - | _ | | |
| assi | 8 300μA | | Δ | | 1000Ω | | 100 | Ω | 1550Ω | 92 | 0Ω | | |
| d C | d cla | 500μA | Δ | | 730Ω | | 730Ω 780Ω | | | 58 | 0Ω | | |
| erio | Note | 1mA | 0 | | 200Ω | | 200 | ΩΩ | 250Ω | 18 | 0Ω | | |
| ry p | tor | 3mA | 0 | | 70Ω | | 70 | Ω | 85Ω | 60 | Ω | | |
| live | dice | 5mA | 0 | | 8Ω | | 8: | Ω | 50Ω | 8 | Ω | | |
| g de | <u>.⊆</u> # | 10mA | 0 | | 2Ω | | 2: | Ω | 25Ω | | | | |
| and |)ire | 20mA | 0 | | Ω8.0 | | 0.8 | ΒΩ | 0.8Ω | | | | |
| Indicator rating | cator rati | 50, 100mA 200, 500mA 1, 2, 5, 7.5A 10, 15, 20, 30A | 0 | | 60mV | | | 60mV | | 60mV | | | |
| | Combined | | Δ | | 60mV, 100mV | Note 2 | | 60mV, 100mV | Note 2 | 60mV, | 100mV Note 2 | | |
| | with shunt 1A~7500A \(\triangle \triangle \) | | Δ | (consump | tion current: appr | ox. 20mA) | (consumpt | ion current: appr | ox. 20mA) | (consumption cur | rent: approx. 5mA) | | |
| | Special Specification With lead wire adjustment resistor | | 0 | | Manufacturable | | | Manufacturable | Manufacturable | | | | |
| Pag | Page with outer dimensions drawing | | | | 35 | | | 36 | | 37 | | | |

Note 1. The operating circuit voltage is 300V or less with the Y-2N Series, and 600V or less with the Y-N Series and L-N Series.

Note 2. In the case of combined use with a shunt, refer to "DC Ammeter Combined with Shunt" on p.44, and specify the lead wire thickness and one-way length or round-trip resistance.

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | ∆Special | | | |
|---------------------------|--------------------|-----------------|---------------|--|--|--|
| Syllibol | product | product | product | | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | | |

- Remarks (1) In the case of a bidirectional deflection indicator, determine the specifications according to the following.
 - Direct-rating models can be manufactured if the larger of the left and right scales is 30A or less.
 - For combined use with a shunt, select a scale so that the sum of the absolute values of the indicator ratings is 60mV or more.


Example: In the case of a shunt with ratings of 100A and 60mV


Ammeter scale -50~0~+100A

Ammeter rating -30~0~+60mV

- (Sum of absolute values=90mV≥60mV)(2) Refer to "Receiving Indicators" on p.67 concerning zerosuppressed indicators.
- (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

■Connection diagrams





■Ordering method

The items in must be specified. •Indicator combined with shunt Shunt rating + Thickness and length of lead Number of wire + required/not-required

lead wire 3.5mm² 3m,
not required

Special specifications

Double scale, colored lines, etc. Model name required/not required Indicator rating Scale Cover type units SHT 200A 60mV, required YM-206NDA 60mV 0-200A В 10 With lead wire adjustment resistor Direct indicators Number of Cover type Special specifications

Double scale, colored Model name units YM-206NDA 0-20A 10

DC ammeter combined with shunt

For DC ammeters combined with a shunt, the measured value changes according to the resistance value of the lead wire. Thus, please refer to the following tables and specify the thickness and one-way length or round-trip resistance value of the lead wire connecting the indicator and the shunt.

The lead wire resistance value must be within the "maximum allowable value."

Table of maximum allowable values of lead wires for DC ammeters combined with shunts

| | DC ammeter combined with shun | t | Maximum one-way length (m) in the case of a 2mm² lead wire (Mitsubishi | Maximum one-way length (m) in the |
|-----------------------|-------------------------------|--|--|--|
| Model name | Indicator rating (mV) | Maximum allowable resistance value of lead wire (Ω) | Electric standard lead wire) | case of a 3.5mm ² lead wire |
| VAA OOONDA VAA OOONDA | 60 or more less than 75 | 0.72 | 39 | 69 |
| YM-206NDA, YM-208NDA | 75 or more less than 100 | 1.55 | 84 | 149 |
| YM-210NDA | 100 or more less than 150 | 2.37 | 128 | 227 |
| YM-8NDA, YM-10NDA | 150 or more | 4.02 | 217 | 384 |
| | 60 or more less than 75 | 0.40 | 21 | 38 |
| YM-12NDA | 75 or more less than 100 | 0.90 | 48 | 86 |
| YW-12NDA | 100 or more less than 150 | 1.40 | 70 | 134 |
| | 150 or more | 2.40 | 135 | 230 |
| | 60 or more less than 75 | 1.00 | 54 | 96 |
| LM-80NDA | 75 or more less than 100 | 1.50 | 80 | 144 |
| LM-110NDA | 100 or more less than 150 | 2.40 | 135 | 230 |
| | 150 or more | 4.00 | 217 | 384 |

Remarks (1) In the case of a bidirectional deflection indicator, the indicator rating is the sum of the absolute values of the respective ratings.

■Table of round-trip resistance values according to lead wire thicknesses and one-way lengths

| One-way length | | Round-trip resistance value (Ω) (length: one-way) | | | | | | | | | | | | |
|----------------------|-------|--|-------|-------|-------|-------|-------|--------|--|--|--|--|--|--|
| Cross-sectional area | 1m | 2m | 3m | 4m | 5m | 10m | 20m | (Ω/km) | | | | | | |
| 1.25mm ² | 0.033 | 0.066 | 0.099 | 0.132 | 0.165 | 0.330 | 0.660 | 16.5 | | | | | | |
| 2mm ² | 0.018 | 0.037 | 0.055 | 0.074 | 0.092 | 0.184 | 0.368 | 9.2 | | | | | | |
| 3.5mm ² | 0.010 | 0.021 | 0.031 | 0.042 | 0.052 | 0.104 | 0.208 | 5.2 | | | | | | |
| 5.5mm ² | 0.007 | 0.013 | 0.020 | 0.027 | 0.033 | 0.066 | 0.132 | 3.3 | | | | | | |

Lead wires for shunt connection

Lead wires for connecting an indicator with a shunt can be manufactured according to specifications as accessories to the indicator.

The standard is: two 2mm² - 2m (one-way) 1500V heat-resistant vinyl wires (blue) for electric equipment.

Remarks (1) Only wires with a cross-sectional area of 2mm² are provided; other types of wires are to be prepared by the customer.

DC ammeter with lead wire adjustment resistor

If a DC ammeter combined with a shunt is to be arranged in advance with the lead wire length being indeterminate, use a DC ammeter with a lead wire adjustment resistor, which can be adjusted according to the lead wire resistance after installation of the indicator.


Adjustment range of lead wire resistance

The lead wire resistance adjustment range is the same as the maximum allowable resistance value of lead wire in the "Table of maximum allowable values of lead wires."

Adjustment method

Adjustment by voltage application

Disconnect the lead wires connected to the voltage terminals of the shunt, and adjust with the lead wire adjustment resistor so that the indicator deflects fully when a voltage corresponding to the indicator rating is applied to the respective ends of the lead wires.

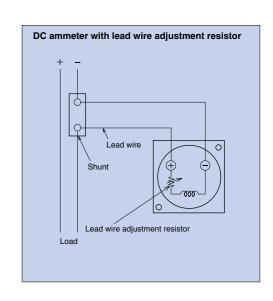

⁽²⁾ If a lead wire length exceeding the values in the above table is required, use a lead wire with a large cross-sectional area or use a shunt with a high rated voltage.



Accessories

Shunt for DC ammeter

■Specifications

| Accuracy | Grade 0.5 Percentage with respect to the rated voltage drop between voltage terminals or the shunt resistance value when the consumption current of the indicator is ignored. |
|-----------------------|---|
| Rated voltage | 60mV (standard), 100mV (quasi-standard) |
| Rated current | 1~7500A |
| Structure | Shunt with base for 150A or less, shunt without base for 200A or more. |
| Voltage test | 3320VAC for 5s (applies only to shunts with base) |
| Insulation resistance | 10MΩ or more at test voltage of 500V (applies only to shunts with base) |

Remarks (1) For low-current shunts, the influence of the consumption current may be significant in some cases. If a shunt is ordered separately, it may be necessary to adjust the indicator that is used in combination with it.

- (2) Shunts are designed for a temperature rise limit of 80°C at a current that is 80% of the rated current. For this reason, adequate care is required when tightening the bus lines in high-current, large-loss applications.
- (3) Shunts with an insulating base can also be manufactured for rated currents greater than 150A and 600A or less.

■Rating selection and mounting

1. Rating selection


For the shunt rating, select a current value with adequate allowance, taking into consideration that a shunt is a heat source. (As a general rule, use a shunt for values approximately 1.5 times or more of the continuous operating current.)

2. Mounting attitude


Mount the shunt as shown in the diagram.


3. Voltage terminals


Two voltage terminals are provided at one side block for shunts with a voltage of 2000A or more. In this case, use the diagonally positioned voltage terminal. (Error may increase by approximately 0.5% when the voltage terminals are used in parallel.)




■Outer dimensions

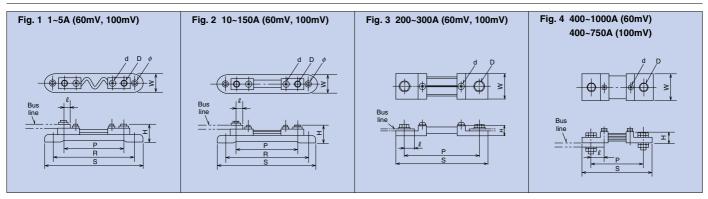







● Table of dimension variations (rated voltage: 60 mV)

| | Rated | Outer | | | | | | e dimensior | | | | | | Delivery |
|--------------------|---------|-----------|---------------|-----------|---------------------|---------------------|-------|---------------------|----------------|--------------------------|----------|--------|-------------|----------------|
| Rated current | voltage | dimension | Interval | between | Current terminal | Voltage terminal | Block | Shunt base mounting | Width of shunt | Shunt base mounting hole | Height | Total | Contacting | period |
| Α | mV | drawing | current t | erminals | bolt | screw | width | hole interval | | diameter | rioigiit | length | part length | classification |
| | IIIV | No. | Р | Q | D | d | Е | R | W | ϕ | Н | S | l | Ciassilication |
| 1, 2, 3, 5 | 60 | FIG. 1 | 85 | _ | M5 | M4 | _ | 120 | 26 | 4.5 | 25 | 140 | 10 | |
| 10, 15, 20, 25, 30 | | | | | M5 | | | | | 4.5 | 25 | | | |
| 40, 50 | 60 | FIG. 2 | 85 | | M6 | M4 | | 120 | 26 | 4.5 | 25 | 140 | 10 | |
| 60, 75, 100 | 60 | FIG. 2 | | _ | M8 | IVI4 | _ | | | 4.5 | 30 | | | |
| 150 | | | 110 | | IVIO | | | 150 | 30 | 5.5 | 30 | 175 | 15 | |
| 200 | | | | | M8 | M4 | | | 33 | | | | | |
| 250 | 60 | FIG. 3 | 110 | _ | IVIO | M5 | _ | _ | 38 |] _ | 15 | 135 | 15 | |
| 300 | | | | | M12 | | | 43 | | | | | . o | |
| 400 | 60 | FIG. 4 | 115 | | M12 | M5 | | | 45 | _ | 20 | 155 | 35 | |
| 500 | 60 | FIG. 4 | 115 | _ | IVIIZ | CIVI | _ | _ | 43 | _ | 20 | 155 | 42.5 | |
| 600 | | | 130 | | | | | | 45 | | | | 42.5 | |
| 750 | 60 | FIG. 4 | 130 | _ | M12 | M5 | _ | _ | 43 | _ | 30 | 175 | 45 | |
| 1000 | | | 135 | | | | | | 60 | | | | 45 | |
| 1200 | 60 | FIG. 5 | 140 | 35 | M12 | M5 | | | 70 | | 35 | 185 | 47 | |
| 1500 | 60 | FIG. 5 | 140 | 35 | IVIIZ | CIVI | _ | _ | 70 | _ | 35 | 185 | 52.5 | |
| 2000 | 60 | FIG. 6 | 175 | 45 | Mao | ME | | | 85 | | 55 | 230 | 20 | |
| 2500, 3000 | 60 | FIG. 6 | 180 | 50 | WI12 | M12 M5 | | _ | 100 | 1 - 1 | 70 | 240 | 30 | Δ |
| 4000 | | | 180 | | | | 150 | | | | 80 | 250 | 70 | |
| 5000 | 60 | FIG. 7 | FIG. 7 220 90 | 1 00 1440 | Mag | 2 M5 150 160 | 150 | | 150 | | 100 | 280 | 85 | |
| 6000 | 60 | FIG. 7 | | 90 | M12 | | 160 | | _ 150 | _ | 110 | 310 | 100 | |
| 7500 | | | 235 | | | | 0 | | | 110 | 330 | 100 | | |

● Table of dimension variations (rated voltage: 100mV)

| | | | | ` | | | | | | | | | | | | | | | | | | | | | | | |
|--------------------|----------|-----------|-----------|----------|---------------------|---------------------|---------|---------------------|----------------|--------------------------|------------|--------|-------------|----------------|--|-----|--|-----|-----|-----|--|--|--|--|--|------|--|
| | Rated | Outer | | | | | Variabl | e dimensior | - | | | | | Delivery | | | | | | | | | | | | | |
| Rated current | voltage | dimension | Interval | between | Current terminal | Voltage terminal | Block | Shunt base mounting | Width of shunt | Shunt base mounting hole | Height | Total | Contacting | period | | | | | | | | | | | | | |
| Α | mV | drawing | current t | erminals | bolt | screw | width | hole interval | | diameter | - Tiolgill | length | part length | classification | | | | | | | | | | | | | |
| | IIIV | No. | Р | Q | D | d | Е | R | W | φ | Н | S | l | Ciassilication | | | | | | | | | | | | | |
| 1, 2, 3, 5 | | FIG. 1 | 85 | _ | M5 | M4 | _ | 120 | 26 | 4.5 | 25 | 140 | 10 | | | | | | | | | | | | | | |
| 10, 15, 20, 25, 30 | 100 | FIG. 2 | 85 | _ | M5 | M4 | _ | 120 | 26 | 4.5 | 25 | 140 | 10 | | | | | | | | | | | | | | |
| 40, 50 | | 110.2 | | | M6 | IVIT | | 120 | 20 | 4.5 | 28 | 140 | 10 | | | | | | | | | | | | | | |
| 60, 75, 100 | 100 | FIG. 2 | 125 | _ | M8 | M4 | _ | 180 | 30 | 5.5 | 30 | 200 | 10 | | | | | | | | | | | | | | |
| 150 | 100 | 110.2 | 120 | | IVIO | IVIT | | 100 | | 0.0 | 35 | 200 | 10 | | | | | | | | | | | | | | |
| 200 | | | | | M8 | M4 | | | 33 |] | | | | | | | | | | | | | | | | | |
| 250 | 100 | FIG. 3 | 135 | _ | IVIO | M5 | _ | _ | 36 |] - | 15 | 165 | 15 | | | | | | | | | | | | | | |
| 300 | | | | | M12 | IVIO | | | 43 | | | | | | | | | | | | | | | | | | |
| 400 | | | 145 | _ | M12 | M5 | _ | _ | 45 | _ | 20 | 185 | 35 | | | | | | | | | | | | | | |
| 500 | 100 | FIG 4 | 165 | _ | M12 | M5 | _ | _ | 45 | _ | 30 | 210 | 42.5 | | | | | | | | | | | | | | |
| 600 | 100 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | FIG. 4 | 110.4 | | | | | | | | | | | | | 12.0 | |
| 750 | | | 170 | _ | M12 | M5 | | _ | 60 | _ | 30 | 210 | 45 | | | | | | | | | | | | | | |
| 1000 | 100 | FIG. 5 | 175 | 35 | | | | | 70 | | 35 | 220 | 47 | | | | | | | | | | | | | | |
| 1200 | 100 | FIG. 5 | | | M12 | M5 | _ | _ | | - | | | ., | | | | | | | | | | | | | | |
| 1500 | | 110.0 | 195 | 40 | | | | | 80 | | 45 | 250 | 52.5 | | | | | | | | | | | | | | |
| 2000 | | FIG. 6 | 205 | 45 | M12 | M5 | _ | _ | 85 | _ | 55 | 260 | 30 | | | | | | | | | | | | | | |
| 2500, 3000 | | | 210 | 50 | 50 M12 | | | | 100 | | 70 | 270 | | | | | | | | | | | | | | | |
| 4000 | 100 | FIG. 7 | 210 | | M12 | M5 | 150 | | 150 | | 80 | 280 | 70 | | | | | | | | | | | | | | |
| 5000 | <u> </u> | | 250 | 90 | | | 100 | _ | | _ | 100 | 310 | 85 | | | | | | | | | | | | | | |
| 6000 | | | 90 M12 | M12 M5 | 160 | | 150 | | 100 | 340 | 100 | | | | | | | | | | | | | | | | |
| 7500 | | FIG. 7 | 265 | 265 | 265 | 265 | 265 | 265 | 265 | 265 | | | | 100 | | 150 | | 100 | 360 | 100 | | | | | | | |

Delivery period classification

| Symbol | Standard product | OQuasi-standard product | △Special product |
|---------------------------|--------------------|-------------------------|------------------|
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

DC Voltmeters







■Specifications

YM-206NDV

YM-8NDV


LM-110NDV


| | | | | | | Rectangula | r indicators | | | Wide-angle | e indicators |
|--------------------------------|---------------------|------------|--------------------|------------|--------------|------------|--------------|--------------|------------|------------|--------------|
| | | | | | Y-2N Series | J | | Y-N Series | | L-N S | |
| Size | e (width × h | eight) | mm | 64×60 | 85×75 | 100×85 | 82×82 | 102×102 | 122×122 | 80×80 | 110×110 |
| Mod | del name | | | YM-206NDV | YM-208NDV | YM-210NDV | YM-8NDV | YM-10NDV | YM-12NDV | LM-80NDV | LM-110NDV |
| Оре | eration princ | iple | | | Movable coil | | | Movable coil | | Movab | ole coil |
| Accuracy (grade) 2.5 | | | | | | | 2. | 5 | 1.5 | 2.5 | 1.5 |
| Sca | le length | | (mm) | 55 | 70 | 85 | 70 | 90 | 100 | 124 | 175 |
| Wei | ght | | (kg) | 0.07 | 0.1 | 0.3 | 0.3 | 0.4 | | | |
| delivery period classification | Maximum scale value | Accessory | Delivery period | | | ١) | | | | | |
| ıssif | 1, 3, 5V | _ | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| ol cle | 10, 15, 30V | _ | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| erio | 50, 100V | _ | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| y pe | 150, 300V | _ | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| live | 500, 600V | _ | 0 | (1) Note 1 | (1) Note 1 | (1) Note 1 | 1 | 1 | 1 | 1 | 1 |
| d de | 750V | GR-2 | 0 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 |
| and | 1000V | multiplier | 0 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 | (1) Note 1 |
| ating | 1200V | KR-1 | 0 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 |
| or 16 | 1500V | 3-terminal | 0 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 |
| Indicator rating | 1800V | multiplier | 0 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 |
| <u>lu</u> | 2000V | munipher | 0 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 | (2) Note 1 |
| Page | e with outer d | limensions | drawing | | 35 | | | 36 | 37 | | |


- Remarks (1) If, with a maximum scale of 600V or less, an externally mounted multiplier is desired, the voltmeter Delivery period classification will be manufactured with the GR-2 multiplier as an accessory.
 - (2) Indicators with both positive and negative readings on the scale can be manufactured if the larger of the left and right scales is 2000V or less.
 - The table above shows whether or not a multiplier is provided.
 - (3) If a high sensitivity (high input resistance) indicator is desired as a DC voltmeter with a maximum scale of 100V or less, please specify the maximum scale and sensitivity current of the indicator. Voltmeters can be manufactured with a sensitivity current within the range shown for DC ammeters on p.45.
 - There may be a maximum difference of approximately ±5% with respect to the value specified for the sensitivity current.
 - (4) The GR-2 and KR-1 multipliers are dedicated accessories (non-compatible). They can only be used in combination with the indicators specified.
 - (5) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Note 1. These voltmeters do not have a JIS mark.

■Connection diagrams








| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

Dual-range indicators

Dual-range indicators with a maximum scale of 600V or less are manufactured with the GR-2 multiplier as an accessory.


[Example] In the case of a dual-range indicator with $0\sim150V$ and $0\sim75V$ indicator scales.






Example of double rating scale diagram (YM-208NDV)

■Outer dimensions of the accessories

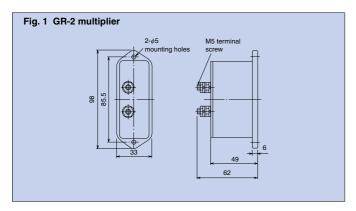

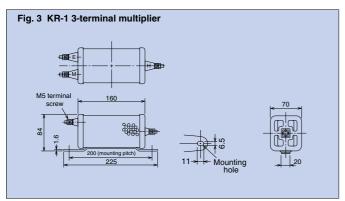

■Ordering method

AC Ammeters





YS-8NAA LS-110NAA ■Specifications

| | _ | | | | | | Re | ctangula | r indicat | ors | | | | | Wide-angle indicators | | | |
|---|------------------------------------|--|-------|-----|---------|-----------|-------|----------|---------------------------|--------|-------|----------|---|----------|-----------------------|----------|-----------|------------|
| | | | | | Y-2N | Series | | | | | Y-N S | Series | | | | L-N S | Series | |
| | | dth × height) mm | 64> | <60 | 85 | ×75 | | ×85 | 82×82 102×102 122×122 | | | | | 80×80 | | 110> | | |
| Mod | | | YS-20 | | | AA//8 | YS-21 | ONAA | YS-8NAA YS-10NAA YS-12NAA | | | | | 2NAA | LS-80NAA LS-110NA | | | |
| Ope | ratio | on principle | | ľ | Movable | iron core | ! | | Movable iron core | | | | | | | Movable | iron core | ; |
| Acc | urac | ry (grade) 2.5 | | | | | | | | 2. | | | 1 | .5 | 2 | .5 | 1. | 5 |
| Frequency | | | | | | | | | | 50 and | | | | | | | | |
| | | ength (mm) | 5 | - | 7 | 0 | | 5 | - | 0 | 9 | 0 | | 00 | 1: | 24 | 17 | ′ 5 |
| | | nption VA (VA) | | .0 | | .0 | | .0 | 1 | | | .0 | | .0 | | .0 | 2. | |
| Wei | | (kg) | 0 | | 0 | | | 15 | 0 | | | 15 | | .3 | | .3 | 0. | _ |
| ioi | | Maximum scale value | | | | Expanded | | | | | | <u> </u> | | <u> </u> | Ordinary | Expanded | Ordinary | Expanded |
| icat | Direct indicator | 500mA | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | | |
| ıssif | | 1, 3A | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| iod cla | Direct | 5, 10, 15, 20, 30A | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| Indicator rating and delivery period classification | Indicator combined with CT | 5/5, 10/5, 15/5, 20/5, 30/5A 40/5, 50/5, 60/5, 75/5A 100/5, 150/5, 200/5, 250/5A 300/5, 400/5, 500/5A | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| ator ratir | cator col | /5A (indicator rating 5A) | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indic | Sipul Signal (Indicator rating 1A) | | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Page with outer dimensions drawing 35 | | | | | | 36 | | | | | 37 | | | | | | | |

Remarks Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to Delivery period classification assist in selecting the model and use specifications suited to the application.

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

Expanded scale indicator

Use expanded scale indicators in motor circuits or other locations where overcurrents flow temporarily.

The effective measurement range is up to the indicator rating value (1x value). The expanded scale part is for reference only, and the scale numerals are indicated in red.

Remarks Ensure that a current exceeding the rating is applied such that (the applied current (A)/rated current (A)/2×application duration does not exceed 500.



Example of expanded scale diagram (YS-206NAA)

■Specifications

| | - | | | |
|---------------------|----------------------|--------------|-----------------|--------------|
| | Rated scale | Ex | oanded scale va | lue |
| | value | Expanded 2x | Expanded 3x | Expanded 5x |
| | 1A | 2A | 3A | 5A |
| | ЗА | 6A | 9A | 15A |
| ;; | 5A | 10A | 15A | 25A |
| Direct | 10A | 20A | 30A | 50A |
| | 15A | 30A | 45A | 75A |
| | 20A | 40A | 60A | _ |
| | 30A | 60A | 90A | _ |
| Combined with CT | Indicator rating: 5A | CT ratio×10A | CT ratio×15A | CT ratio×25A |
| Some | Indicator rating: 1A | CT ratio×2A | CT ratio×3A | CT ratio×5A |

Recommended ammeter scale values for motor circuits

200V 3-phase induction motor

| NA-+ | Rated current | Recommended sca | le |
|-------------------|---------------------|-----------------------------|----------|
| Motor output (kW) | (reference value A) | Ammeter scale (Expanded 3x) | CT ratio |
| 0.2 | 1.8 | 0-3-9A | _ |
| 0.4 | 3.2 | 0-5-15A | 5/5A |
| 0.75 | 4.8 | 0-7.5-22.5A | 7.5/5A |
| 1.5 | 8 | 0-10-30A | 10/5A |
| 2.2 | 11.1 | 0-15-45A | 15/5A |
| 3.7 | 17.4 | 0-25-75A | 20/5A |
| 5.5 | 26 | 0-30-90A | 30/5A |
| 7.5 | 34 | 0-50-150A | 40/5A |
| 11 | 48 | 0-60-180A | 60/5A |
| 15 | 65 | 0-75-225A | 75/5A |
| 18.5 | 79 | 0-100-300A | 100/5A |
| 22 | 93 | 0-120-360A | 120/5A |
| 30 | 125 | 0-150-450A | 150/5A |
| 37 | 160 | 0-200-600A | 200/5A |

Mitsubishi Electric uses a three-fold expanded scale indicator as the standard specification.

Uniform scale





YR-206NAA YR-8NAA ■Specifications

| | _ | | | | | | Re | ctangula | r indicat | ors | | | | | W | ide-angle | e indicate | ors |
|-----------|--|---------------------------|----------|----------|----------|----------|----------|----------|-----------|------------------------------------|----------|----------|----------|----------|----------|-----------|------------|----------|
| | | | | | Y-2N | Series | | | | | Y-N S | Series | | | | L-N S | Series | |
| Siz | e (wi | dth × height) mm | 64> | <60 | 85> | <75 | 100 | ×82 | 823 | K82 | 102 | ×102 | 122 | ×122 | 80 | ≺80 | 110 | ×110 |
| Мо | del n | ame | YR-20 | 6NAA | YR-20 | AA//8 | YR-21 | 0NAA | YR-8 | NAA | YR-1 | 0NAA | YR-1 | 2NAA | LR-8 | ONAA | LR-110NAA | |
| Ор | eratio | on principle | | | Rec | tifier | | | | | Rec | tifier | | | | Rec | tifier | |
| Acc | curac | y (grade) | | | 2 | .5 | | | | 2 | .5 | | 1 | .5 | 2 | .5 | 1 | .5 |
| Fre | quer | су | | | | | | | | 50 and | d 60Hz | | | | | | | |
| Sca | ale le | ngth (mm) | 5 | 5 | 7 | 0 | 8 | 5 | 7 | 0 | 9 | 0 | 10 | 00 | 12 | 24 | 1 | 75 |
| We | ight | (kg) | 0. | .1 | 0. | .1 | 0. | 15 | 0 | .1 | 0. | 15 | 0 | .3 | 0 | .3 | 0 | .5 |
| | ١, | Maximum scale value | | | | | | | Consun | nption VA | or volta | ige drop | | | | | | |
| | | viaximum scale value | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded |
| | | 200, 300μA | _ | _ | 1.7V | _ | 1.7V | _ | 1.7V | _ | 1.7V | _ | 1.7V | _ | _ | _ | _ | _ |
| _ | Note 1 | 500 <i>μ</i> A | 1.4V | _ | 1.4V | - | 1.4V | _ | 1.4V | _ | 1.4V | _ | 1.4V | _ | _ | _ | _ | _ |
| rating | | 1, 3, 5mA | 1.4V | | 1.4V | _ | 1.4V | _ | 1.4V | _ | 1.4V | _ | 1.4V | _ | 1.4V | _ | 1.4V | _ |
| or ra | indicator | 10, 20, 30, 50, 75mA | 1.2V | _ | 1.2V | _ | 1.2V | _ | 1.2V | _ | 1.2V | _ | 1.2V | _ | 1.2V | _ | 1.2V | |
| Indicator | indi | 100, 200, 500mA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.2VA | 0.2VA | 0.2VA | 0.2VA |
| Indi | Direct | 1, 3A | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.2VA | 0.2VA | 0.2VA | 0.2VA |
| | ä | 5, 10, 15, 20A | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.2VA | 0.2VA | 0.2VA | 0.2VA |
| | | 30A | 0.2VA | _ | 0.2VA | - | 0.2VA | _ | 0.2VA | _ | 0.2VA | _ | 0.2VA | _ | 0.2VA | 0.2VA | 0.2VA | 0.2VA |
| | Sator | /5A (indicator rating 5A) | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.1VA | 0.3VA | 0.1VA | 0.1VA 0.3VA 0.1VA 0.3VA 0.1VA 0.3V | | | | 0.3VA | 0.2VA | 0.2VA | 0.2VA | 0.2VA |
| | Comp | /1A (indicator rating 1A) | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.06VA | 0.3VA | 0.2VA | 0.2VA | 0.2VA | 0.2VA |
| D | elive | ry period classification | | | |) | |) | (|) | |) | |) | (|) | (|) |
| Pag | Page with outer dimensions drawing 35 36 | | | | | | | | | 3 | 37 | | | | | | | |

Remarks (1) Error may occur due to waveform distortion.


- (2) LR-110NAA and LR-80NAA models rated 100mA to 30A incorporate an approximate effective value rectifying circuit.
- (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Note 1. The operating circuit voltage is 300V or less for the Y-2N Series, and 600V or less for the Y-N Series and L-N Series.

Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Syllibol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |


■Connection diagrams



20A

0-20-60A





Note 2. For low-voltage circuits, grounding of the secondary side of the current transformer is unnecessary.

Ordering method

The items in must be specified. ●Indicator combined with current transformer Number of Model name Indicator rating Special specifications
Double scale, colored lines, etc. Scale CT ratio Cover type units YS-8NAA 5A 0-100-300A 100/5A 5 Direct indicators Number of Special specifications

Double scale, colored lines, etc. Model name Indicator rating Cover type units YS-8NAA GR 5

AC Voltmeters





■Specifications YS-8NAV LS-110NAV


| | _ | | | | | | Wide-angle indicators | | | | | | | |
|------------------|----------------------------|--------------------------|--------------------|-----------|-------------------|-----------|-----------------------|-------------------|----------|-------------------|-----------|--|--|--|
| | | | | | Y-2N Series | | | Y-N Series | | L-N S | Series | | | |
| Size | e (wi | $dth \times height)$ | mm | 64×60 | 85×75 | 100×85 | 82×82 | 102×102 | 122×122 | 80×80 | 110×110 | | | |
| Мо | del n | ame | | YS-206NAV | YS-208NAV | YS-210NAV | YS-8NAV | YS-10NAV | YS-12NAV | LS-80NAV | LS-110NAV | | | |
| Оре | eratio | on principle | | ı | Movable iron core | e | | Movable iron core |) | Movable iron core | | | | |
| Acc | urac | cy (grade) | | | 2.5 | | 2 | .5 | 1.5 | 2.5 | 1.5 | | | |
| Fre | quer | ncy | | | | | 50 and | d 60Hz | | | | | | |
| Sca | ıle le | ngth | (mm) | 55 | 70 | 85 | 70 | 90 | 100 | 124 | 175 | | | |
| Cor | nsun | nption VA | (VA) | 3 | 3 | 3 | 3 | 3 | 6 | 3 | 3 | | | |
| Wei | ight | | (kg) | 0.1 | 0.1 | 0.15 | 0.15 | 0.15 | 0.4 | 0.4 | 0.5 | | | |
| | ı | Maximum sca | ale value | | | | Delivery period | d classification | | | | | | |
| | | 50V | | 0 | 0 | 0 | 0 | 0 | 0 | _ | _ | | | |
| | ō | 75, 100, 110 |)V | 0 | 0 | 0 | 0 | 0 | 0 | _ | _ | | | |
| | Direct indicator | 150V | | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | |
| _ | ij | 190, 260V | | 0 | 0 | 0 | 0 | 0 | 0 | _ | _ | | | |
| ting | iec | 300V | | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | |
| or re | | 400, 500V | | | _ | _ | _ | _ | 0 | _ | _ | | | |
| Indicator rating | | 600V | | _ | _ | _ | _ | _ | 0 | 0 | 0 | | | |
| Indi | ۶ | VT ratio | Scale | | | | | | | | | | | |
| | # K | 440/110V | 600V | 0 | 0 | 0 | | | 0 | 0 | 0 | | | |
| | pipe | 3300/110V | 00/110V 4500V | | | | | | | | | | | |
| | 00. | 6600/110V | 9000V | | | | | | | | | | | |
| | Indicator combined with VT | Besides the above □/110V | VT ratio X 150V | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | |
| Page | e with | n outer dimens | sions drawing | | 36 37 | | | | | | | | | |


- Remarks (1) A specially rated AC voltmeter with a rectifier indicator and a maximum scale of 600V or less is manufactured.
 - (2) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.
- Note 1. The LS-110NAV and LS-NAV direct 600V indicators are provided with the KR-1 multiplier as an accessory (power consumption is approximately 6VA). The KR-1 multiplier is a dedicated accessory (non-compatible accessory), and thus cannot be used in combinations other than those designated for the indicators.


Delivery period classification


| Svmbol | ⊚Standard | OQuasi-standard | ∆Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

■Connection diagrams









Note 2. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

■Ordering method

The items in must be specified.


Indicator combined with instrument voltage transformer

Number of Special specifications

Double scale, colored lines, etc. VT ratio YS-8NAV 150V 0-9000V 6600/110V 10

| • | Direct indica | tor | | | | | Number of | |
|---|---------------|------------------|--------|---|------------|-----------------------------------|-----------|--|
| | Model name | Indicator rating | Scale | | Cover type | Special specifications | units | |
| | YS-8NAV | 300V | 0-300V | ŀ | В | Double scale, colored lines, etc. | 10 | |

Outer dimensions of accessory



Uniform scale





YR-206NAV ■Specifications

| _ | | _ | | | | | Re | ctangula | r indicat | ors | | | | | Wi | ide-angle | e indicato | ors | | |
|---------------|---------------------|---|---------------------------------|--------------------|---------------------------------|-----------------|---------------------------------|--------------------|---------------------------------|--------------------|---------------------------------|--------------------|---------------------------------|--------------------|----------------------------------|--------------------|----------------------------------|--------------------|--|--|
| | | Y-2N Series Y-N Series | | | | | | | | | L-N S | Series | | | | | | | | |
| Size | e (width > | (height) mm | 64> | <60 | 85> | <75 | 100 | ×85 | 82> | 82×82 | | <102 | 122> | <122 | 80> | <80 | 110×110 | | | |
| Mod | del name | | YR-20 | 6NAV | YR-20 | 8NAV | YR-21 | IONAV | YR-8 | NAV | YR-1 | ONAV | YR-1 | 2NAV | LR-80 | ONAV | LR-110NAV | | | |
| Оре | eration pr | inciple | | | Rec | tifier | | | | | Rec | tifier | | | | Rec | tifier | | | |
| Acc | curacy (gr | ade) | | | 2. | .5 | | | | 2 | .5 | | 1. | .5 | 2. | .5 | 1. | .5 | | |
| Fre | quency | | | | | | | | | 50 and | d 60Hz | | | | | | | | | |
| Sca | ale length | (mm) | 5 | 5 | 7 | 0 | 8 | 5 | 7 | 0 | 9 | 0 | 10 | 00 | 12 | 24 | 17 | 75 | | |
| Wei | ight | (kg) | 0.0 | 07 | 0. | .1 | 0. | .1 | 0. | .1 | 0. | 15 | 0. | .5 | 0.4 | | | .5 | | |
| | | | | | | | | | | | | eriod cla | | | | | | | | |
| | Maxir | mum scale value | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | | |
| g | | E 40 00\/ | 4 4 | _ | | _ | | | | | | | | | | | | | | |
| | | 5, 10, 30V | 1mA | 0 | 1mA | 0 | 1mA | 0 | 1mA | 0 | 1mA | 0 | 1mA | 0 | 0.1VA | 0 | 0.1VA | 0 | | |
| rating | | 5, 10, 30V 50V | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 0.1VA 0.2VA | 0 | 0.1VA 0.2VA | - | | |
| | | | | | | _ | | _ | | _ | | | | | | _ | | 0 | | |
| | Direct | 50V 75, 100, 110V 150V | 1mA | 0 | 1mA | 0 | 1mA | 0 | 1mA | 0 | 1mA | 0 | 1mA | 0 | 0.2VA | 0 | 0.2VA | 0 | | |
| Indicator rat | | 50V 75, 100, 110V 150V | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 1mA 1mA | 0 | 0.2VA 0.5VA | 0 | 0.2VA 0.5VA | 0 | | |
| | Direct indicator | 50V 75, 100, 110V 150V | 1mA 1mA 2mA | 0 | 1mA 1mA 2mA | 0 | 1mA 1mA 2mA | 0 | 1mA 1mA 2mA | 0 | 1mA 1mA 2mA | 0 | 1mA 1mA 2mA | 0 | 0.2VA 0.5VA 0.6VA | 0 0 | 0.2VA 0.5VA 0.6VA | 0 0 | | |
| Indicator | Direct indicator | 50V 75, 100, 110V 150V 190, 260V | 1mA 1mA 2mA 1mA | 0 0 | 1mA 1mA 2mA 1mA | 0 0 | 1mA 1mA 2mA 1mA | 0 0 | 1mA 1mA 2mA 1mA | 0 0 | 1mA 1mA 2mA 1mA | 0 0 | 1mA 1mA 2mA 1mA | 0 0 | 0.2VA 0.5VA 0.6VA 1.2VA | 0 0 | 0.2VA 0.5VA 0.6VA 1.2VA | 0 0 0 | | |
| Indicator | Direct indicator | 50V 75, 100, 110V 150V 190, 260V 300V | 1mA 1mA 2mA 1mA 2mA | 0 0 0 | 1mA 1mA 2mA 1mA 2mA | 0 0 0 0 | 1mA 1mA 2mA 1mA 2mA | 0 0 0 | 1mA 1mA 2mA 1mA 2mA | 0 0 0 | 1mA 1mA 2mA 1mA 2mA | 0 0 0 | 1mA 1mA 2mA 1mA 2mA | 0 0 0 | 0.2VA 0.5VA 0.6VA 1.2VA | 0 0 0 | 0.2VA 0.5VA 0.6VA 1.2VA | 0 0 0 0 0 | | |

Remarks (1) Although the scale of the rectifier AC voltmeter is substantially uniform with an indicator having a Delivery period classification maximum scale value of 10V or less, the divisions are slightly reduced near "0".

- (2) Error may occur due to waveform distortion.
- (3) LR-110NAV and LR-80NAV models rated 75V to 300V incorporate an approximate effective value rectifying circuit.
- (4) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Note 1. These models do not have a JIS mark.

| . , , , , . | | | |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | ⊚Standard | OQuasi-standard | △Special |
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

Wattmeters





YP-208NW

YP-10NW

■Specifications

| | _ | | | | | | | | | | | | R | ectar | ngula | r indicato | ors | | | | | | | | | |
|--------------------------------------|-------------------|---------------------------------|--------------------------|--------------------------|--------------|-------|-----------|-----------------------------------|-----------------|-------------------------------|-----------|--------------------------------|-----------------|----------|----------------|---|--------------------------------|-----------------|-----------------|-----------|--------------------------------|-----------------|----------|----------------|-----------|--------------------------------|
| | | | | | Y-2N Series | | | | | | | | | | | | | , | Y-N S | Serie | s | | | | | |
| Size | e (wie | dth × height) | mm | 64×60 85×75 100×85 82×82 | | | | | | | | | | | | < 82 | | | | 102> | <102 | | | | | |
| Мо | del n | ame | | | Υ | ′P-20 | 6NW | | | YP-2 | WN80 | | | ١ | /P-21 | ONW | | | YP- | BNW | | | ` | YP-1 | WNO | |
| Оре | eratio | n principle | | | | | | | | Trans | ducer | | | | | | | | | 7 | Trans | duce | er | | | |
| Acc | urac | y (grade) | | | | | | | | 2 | .5 | | | | | | | | | | 2 | .5 | | | | |
| Fre | quen | су | | | | | | | | | | | | 50 | 0 and | 60Hz | | | | | | | | | | |
| Sca | le le | ngth | (mm) | | | 5 | 5 | | | 7 | 0 | | | | 8 | 5 | | | 7 | 0 | | | | 9 | 0 | |
| We | ght | | (kg) | | 0.07 0.1 0.1 | | | | | | | | | | | | 0.1 | | | | 0.15 | | | 15 | | |
| ation | iį | Ratir | ng | _ | umptio | on VA | sory | eriod | | umption VA Current circuit | sory | eriod | | | | | | | | | | | umptio | | sory | eriod |
| od classification | Circuit | Secondary rating | Indicator rating (Po) kW | Voltage circuit | I1 I3 | l2 | Accessory | Delivery period classification | Voltage circuit | I1 I2 | Accessory | Delivery period classification | Voltage circuit | I1 I3 | I ₂ | Accessory | Delivery period classification | Voltage circuit | Current circuit | Accessory | Delivery period classification | Voltage circuit | I1 I3 | l ₂ | Accessory | Delivery period classification |
| peric | 1-phase 2-wire | 110V 5A | 0.4~0.6 | 2.2 | 1. | .0 | T-150 | 0 | 2.2 | 1.0 | T-150 | 0 | 2.2 | 1 | .0 | T-150 | 0 | 2.2 | 1.0 | T-150 | 0 | 2.2 | 1. | .0 | T-150 | 0 |
| /ery | | 220V 5A | 0.8~1.2 | 4.4 | 1. | .0 | T-150 | 0 | 4.4 | 1.0 | T-150 | 0 | 4.4 | 1 | .0 | T-150 | 0 | 4.4 | 1.0 | T-150 | 0 | 4.4 | 1. | .0 | T-150 | 0 |
| deli | 1-phase 3-wire | 100/200V 5A | 0.8~1.2 | 1.6 | 0. | .5 | T-150 | 0 | 1.6 | 0.5 | T-150 | 0 | 1.6 | 0 | .5 | T-150 | 0 | 1.6 | 0.5 | T-150 | 0 | 1.6 | 0. | .5 | T-150 | 0 |
| and | 3-phase 3-wire | 110V 5A | 0.8~1.2 | 1.6 | 0. | .5 | T-150 | 0 | 1.6 | 0.5 | T-150 | 0 | 1.6 | 0 | .5 | T-150 | 0 | 1.6 | 0.5 | T-150 | 0 | 1.6 | 0. | .5 | T-150 | 0 |
| ting | 3-pt 3-v | 220V 5A | 1.6~2.4 | 3.2 | 0. | .5 | T-150 | 0 | 3.2 | 0.5 | T-150 | 0 | 3.2 | 0 | .5 | T-150 O 3.2 0.5 T-150 O 3.2 0.5 T-150 O | | | | | | | | | | 0 |
| Indicator rating and delivery period | 9.0 | $\frac{110}{\sqrt{3}}$ /110V 5A | 0.8~1.2 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 |
| icatc | 3-phase 4-wire | 110/190V 5A | 1.4~2.0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 |
| Pul | ε, | 220/380V 5A | 2.8~4.0 | 3.5 | 0.5 | 1.0 | T-150 | 0 | 3.5 | 0.5 1.0 | T-150 | 0 | 3.5 | 0.5 | 1.0 | T-150 | 0 | 3.5 | 0.5 1.0 | T-150 | 0 | 3.5 | 0.5 | 1.0 | T-150 | 0 |
| Pag | e with | outer dimension | ons drawing | | 35 | | | | | | | | | | | 36 | | | | | | | | | | |

Remarks (1) In regards to "Indicator rating (Po) kW" in the "Rating" column:

(Po=0.4 to 0.6kW, taking into account adjustment range multiplying factors of 0.8 to 1.2) 1-phase, 2-wire \[Po=110V\times5A=550\times0.5kW wattmeters $Po=220V \times 5A=1100 \approx 1.0 kW$ (Po=0.8 to 1.2kW, taking into account adjustment range multiplying factors of 0.8 to 1.2) 3-phase, 3-wire $\int P_0 = \sqrt{3} \times 110 \times 5A = 953 \approx 1 \text{ kW}$ (Po=0.8 to 1.2kW, taking into account adjustment range multiplying factors of 0.8 to 1.2) wattmeters Po=√3×220V×5A=1906≃2kW (Po=1.6 to 2.4kW, taking into account adjustment range multiplying factors of 0.8 to 1.2) Po=3× $\frac{110}{\sqrt{3}}$ V×5A= $\sqrt{3}$ ×110V×5A=953 \simeq 1kW (Po=0.8 to 1.2kW, taking into account adjustment range multiplying factors of 0.8 to 1.2) 3-phase, 4-wire $Po=3\times110V\times5A=\sqrt{3}\times190V\times5A=1650\simeq1.7kW \hspace{0.5cm} (Po=1.4\ to\ 2.0kW,\ taking\ into\ account\ adjustment\ range\ multiplying\ factors\ of\ 0.8\ to\ 1.2)$ wattmeters Po=3X220VX5A= $\sqrt{3}$ X380VX5A=3300 \simeq 3.4kW (Po=2.8 to 4.0kW, taking into account adjustment range multiplying factors of 0.8 to 1.2)

- (2) Bidirectional deflection indicators can also be manufactured.
- (3) Models with a 1A current rating can also be manufactured; the power consumption is basically the same as that of a 5A model. The indicator rating value in this case is calculated by substituting 1A in place of 5A in the equations of Remarks (1).
- (4) The T-150 rectifier is a dedicated accessory (non-compatible accessory), and thus cannot be used in combinations other than those designated for the indicators. The distance between the indicator and the T-150 rectifier must be 5m or less, or the round-trip lead wire resistance must be 0.5Ω or less.
- (5) The weight of the T-150 accessory rectifier is approximately 1kg.
- (6) Use a wattmeter with an input voltage in the range of 85 to 115% of the rated value (rated voltage ±15%).

 The indication may be unstable when used with an input voltage of 85% or less of the rating or the input voltage is switched on and off.
- (7) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Scale calculation formula for wattmeter

| Phase-wire system | Secondary rating | Scale calculation formula for wattmeter | Remarks |
|-------------------|------------------|---|----------------------------------|
| 1 whose O wire | 110V 5A | Indicator scale P (kW)=VT ratio X CT ratio X Po (0.4~0.6) | ●The value at the left is |
| 1-phase 2-wire | 220V 5A | Indicator scale P (kW)=CT ratio × Po (0.8~1.2) | multiplied by 1/5 in the case of |
| 1-phase 3-wire | 100/200V 5A | Indicator scale P (kW)=CT ratio × Po (0.8~1.2) | a CT secondary current of 1A. |
| 0 0 | 110V 5A | Indicator scale P (kW)=VT ratio X CT ratio X Po (0.8~1.2) | |
| 3-phase 3-wire | 220V 5A | Indicator scale P (kW)=CT ratio × Po (1.6~2.4) | |
| | 110 √3 /110V 5A | Indicator scale P (kW)=VT ratio X CT ratio X Po (0.8~1.2) | |
| 3-phase 4-wire | 110/190V 5A | Indicator scale P (kW)=VT ratio × CT ratio × Po (1.4~2.0) | |
| | 220/380V 5A | Indicator scale P (kW)=VT ratio X CT ratio X Po (2.8~4.0) | |

Calculation example: In the case of a 3-phase, 3-wire circuit, VT 6600/110V and CT 100/5A

Indicator scale P (kW)=
$$\frac{6600}{110}$$
× $\frac{100}{5}$ ×Po (0.8~1.2) = 960~1440kW

Therefore, wattmeters can be manufactured with a scale of 960-1440kW.

This varies slightly according to the rating. Refer to the Wattmeter Scale Selection Reference Table on p.58 for details.





■Specifications


YP-12NW LP-110NW

| | _ | | | | Rectan | ıgular ind | icators | | | | | V | /ide-angle | e indicato | rs | | | |
|-----------------------|-------------------|---------------------------------|--------------------------------|--------------------|----------|------------|-----------|--------------------------------------|--------------------|----------|------------|-----------|--------------------------------------|--------------------|----------|-----------|-----------|--------------------------------------|
| | | | | | Υ | '-N Series | 5 | | | | | | L-N S | Series | | | | |
| Size | e (wi | dth × height) | mm | | | 122×122 | | | | | 80×80 | | | | | 110×110 | ١ | |
| Мо | del n | ame | | | ` | /P-12NW | 1 | | | ı | _P-80NW | 1 | | | L | .P-110NV | ٧ | |
| Оре | eratio | n principle | | | Т | ransduce | r | | | | | | Trans | ducer | | | | |
| Acc | curac | y (grade) | | | | 1.5 | | | | | 2.5 | | | | | 1.5 | | |
| Fre | quen | су | | | | | | | | 50 | and 60h | Ηz | | | | | | |
| Sca | ale le | ngth | (mm) | | | 100 | | | | | 124 | | | | | 175 | | |
| We | ight | | (kg) | | | 0.5 | | | | | 0.3 | | | | | 0.6 | | |
| ioi | | Ratir | ng. | Con | sumption | ı VA | > | on | Con | sumption | · VA | > | on | Con | sumption | ı VA | 7 | on |
| fical | Circuit | rialii | ŭ | e ± | Curren | t circuit | SSO | very iod icati | e ± | Curren | t circuit | ssol | Delivery period ssificati | je it | Curren | t circuit | ssol | ver) iod icati |
| period classification | تَّ | Secondary rating | Indicator rating (Po) kW | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l 2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification |
| peric | 1-phase 2-wire | 110V 5A | 0.4~0.6 | 2.2 | 1. | 0 | _ | 0 | 2.2 | 1. | 0 | T-150 | 0 | 2.2 | 1 | .0 | | 0 |
| delivery | 1. | 220V 5A | 0.8~1.2 | 4.4 | 1. | .0 | _ | 0 | 4.4 | 1. | 0 | T-150 | 0 | 4.4 | 1 | .0 | | 0 |
| de⊫ | 1-phase 3-wire | 100/200V 5A | 0.8~1.2 | 1.6 | 0. | 5 | _ | 0 | 1.6 | 0. | 5 | T-150 | 0 | 1.6 | 0 | .5 | _ | 0 |
| and | 3-phase 3-wire | 110V 5A | 0.8~1.2 | 1.6 | 0. | 5 | _ | 0 | 1.6 | 0. | 5 | T-150 | 0 | 1.6 | 0 | .5 | | 0 |
| rating and | 3-ph | 220V 5A | 1.6~2.4 | 3.2 | 0. | 5 | _ | 0 | 3.2 | 0. | 5 | T-150 | 0 | 3.2 | 0 | .5 | _ | 0 |
| | 9 0 | $\frac{110}{\sqrt{3}}$ /110V 5A | 0.8~1.2 | 1.6 | 0.5 | 1.0 | _ | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | - | 0 |
| Indicator | 3-phase 4-wire | 110/190V 5A | 1.4~2.0 | 2.8 | 0.5 | 1.0 | _ | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | - | 0 |
| Indi | ε, ₄ | 220/380V 5A | 2.8~4.0 | 3.5 | 0.5 | 1.0 | _ | 0 | 3.5 | 0.5 | 1.0 | T-150 | 0 | 3.5 | 0.5 | 1.0 | | 0 |
| Pag | e with | outer dimension | ns drawing | | | 36 | | | | | | | 3 | 7 | | | | |


Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

■Outer dimensions of accessories

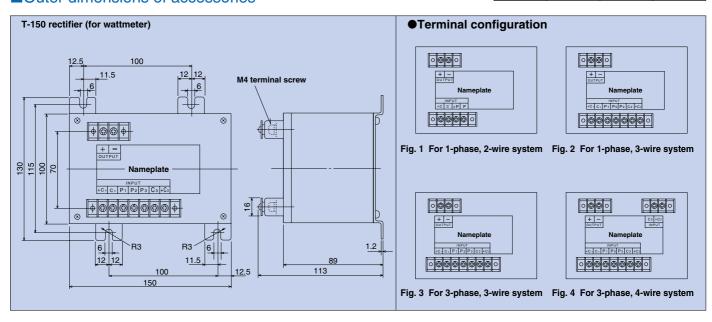


■Ordering method





Wattmeters


■Connection diagrams

●1-phase, 2-wire system













●1-phase, 3-wire system







●3-phase, 3-wire system













●3-phase, 4-wire system









Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

■Wattmeter Scale Selection Reference Table

Although the maximum scale of a wattmeter can be determined by VT ratio \times CT ratio \times indicator rating (Po), the following table shows the manufacturable scale values (minimum, standard and maximum) for various VT ratios and CT ratios.

If a scale value other than the standard value is desired, please specify a suitable scale within the manufacturable range.

• Table of manufacturable maximum scales for wattmeters

| Table | of manu | factura | able m | aximu | m scale | es for | wattme | eters | | | : Scale unit | s kW 🔲 | : Scale | units MW |
|-------------------------|-----------------------------------|---------|------------|----------|----------------|------------|----------|---------|------------|--------------|--------------|--------------|--------------|----------|
| Phase-wi | ire system | 1- | phase 2-w | ire | 1-phase 3-wire | | | | 3-phase 3 | 3-wire/3-ph | ase 4-wire | | | |
| Me | Voltage Ranufacturable VT ratio | 110 | 220 | 440 | 100/200 | 110 | 220 | 440 | 3300 | 6600 | 11000 | 22000 | 33000 | 66000 |
| | VT ratio | _ | 220/110 | 440/110 | _ | _ | 220/110 | 440/110 | 3300 | 6600 | 11000 | 22000 | 33000 | 66000 |
| CT ratio | 1700 90% | | 220/110 | 440/110 | | | 220/110 | 440/110 | /110 | /110 | /110 | /110 | /110 | /110 |
| | Minimum | 2 | 4 | 8 | 4 | 4 | 8 | 15 | 120 | 240 | 400 | 800 | 1200 | 2400 |
| 25/5 | Standard | 2.5 | 5 | 10 | 5 | 5 | 10 | 20 | 150 | 300 | 500 | 1000 | 1500 | 3000 |
| | Maximum | 3 | 6 | 12 | 6 | 6 | 12 | 25 | 180 | 350 | 600 | 1200 | 1800 | 3500 |
| | Minimum | 4 | 8 | 15 | 8 | 8 | 15 | 30 | 240 | 450 | 800 | 1500 | 2400 | 4500 |
| 50/5 | Standard | 5 | 10 | 20 | 10 | 10 | 20 | 40 | 300 | 600 | 1000 | 2000 | 3000 | 6000 |
| | Maximum | 6 | 12 | 25 | 12 | 12 | 25 | 50 | 350 | 750 | 1200 | 2500 | 3500 | 7500 |
| 75/5 | Minimum | 6 | 12 | 24 | 12 | 12 | 24 | 45 | 350 | 700 | 1200 | 2400 | 3500 | 7000 |
| 75/5 | Standard | 7.5 | 15 | 30 | 15 | 15 | 30 | 60 | 450 | 900 | 1500 | 3000 | 4500 | 9000 |
| | Maximum Minimum | 9 8 | 18 15 | 35 | 18 15 | 18 | 35 | 75 | 500 | 1000 | 1800 | 3500 | 5000 | 10 |
| 100/5 | Standard | 10 | 20 | 30 40 | 20 | 15 20 | 30 40 | 60 | 450 | 900 | 1500 | 3000 | 4500 | 9000 |
| 100/3 | Maximum | 12 | 24 | 50 | 24 | 25 | 50 | 100 | 600 750 | 1200 | 2000 2500 | 4000 | 6000 | 12 |
| | Minimum | 12 | 24 | 45 | 24 | 24 | 45 | 90 | 700 | 1500 1400 | 2400 | 5000 | 7500 7000 | 15 |
| 150/5 | Standard | 15 | 30 | 60 | 30 | 30 | 60 | 120 | 900 | 1800 | 3000 | 4500 6000 | 9000 | 14 |
| 130/3 | Maximum | 18 | 35 | 75 | 35 | 35 | 75 | 150 | 1000 | 2000 | 3500 | 7500 | 10 | 20 |
| | Minimum | 16 | 30 | 60 | 30 | 30 | 60 | 120 | 900 | 1800 | 3000 | 6000 | 9000 | 18 |
| 200/5 | Standard | 20 | 40 | 80 | 40 | 40 | 80 | 160 | 1200 | 2400 | 4000 | 8000 | 12 | 24 |
| | Maximum | 25 | 50 | 100 | 50 | 50 | 100 | 180 | 1500 | 3000 | 5000 | 10 | 15 | 30 |
| | Minimum | 24 | 45 | 90 | 45 | 45 | 90 | 180 | 1400 | 2800 | 4500 | 9000 | 14 | 28 |
| 300/5 | Standard | 30 | 60 | 120 | 60 | 60 | 120 | 240 | 1800 | 3600 | 6000 | 12 | 18 | 36 |
| | Maximum | 35 | 75 | 150 | 75 | 75 | 150 | 300 | 2000 | 4000 | 7500 | 15 | 20 | 40 |
| | Minimum | 30 | 60 | 120 | 60 | 60 | 120 | 250 | 1800 | 3800 | 6000 | 12 | 18 | 38 |
| 400/5 | Standard | 40 | 80 | 160 | 80 | 80 | 160 | 320 | 2400 | 4800 | 8000 | 16 | 24 | 48 |
| | Maximum | 50 | 100 | 180 | 100 | 100 | 180 | 350 | 3000 | 6000 | 10 | 18 | 30 | 60 |
| | Minimum | 45 | 90 | 180 | 90 | 90 | 180 | 380 | 2800 | 6000 | 9000 | 18 | 28 | 60 |
| 600/5 | Standard | 60 | 120 | 240 | 120 | 120 | 240 | 480 | 3600 | 7200 | 12 | 24 | 36 | 72 |
| | Maximum | 75 | 150 | 300 | 150 | 150 | 300 | 600 | 4000 | 8500 | 15 | 30 | 40 | 85 |
| | Minimum | 60 | 120 | 250 | 120 | 120 | 250 | 500 | 3800 | 7500 | 12 | 25 | 38 | 75 |
| 800/5 | Standard | 80 | 160 | 320 | 160 | 160 | 320 | 640 | 4800 | 9600 | 16 | 32 | 48 | 96 |
| | Maximum | 100 | 180 | 350 | 180 | 180 | 350 | 750 | 6000 | 12 | 18 | 35 | 60 | 120 |
| | Minimum | 90 | 180 | 380 | 180 | 180 | 380 | 750 | 6000 | 12 | 18 | 38 | 60 | 120 |
| 1200/5 | Standard | 120 | 240 | 480 | 240 | 240 | 480 | 960 | 7200 | 14 | 24 | 48 | 72 | 140 |
| | Maximum | 150 | 300 | 600 | 300 | 300 | 600 | 1200 | 8500 | 18 | 30 | 60 | 85 | 180 |
| 4500/5 | Minimum | 120 | 240 | 450 | 240 | 240 | 450 | 900 | 7000 | 14 | 24 | 45 | 70 | 140 |
| 1500/5 | Standard | 150 | 300 | 600 | 300 | 300 | 600 | 1200 | 9000 | 18 | 30 | 60 | 90 | 180 |
| | Maximum | 180 | 350 | 750 | 350 | 350 | 750 | 1500 | 10 | 20 | 35 | 70 | 100 | 200 |
| 2000/5 | Minimum | 160 | 300 | 600 | 300 | 300 | 600 | 1200 | 9000 | 18 | 30 | 60 | 90 | 180 |
| 2000/5 | Standard Maximum | 200 | 400 | 1000 | 400 500 | 400 | 1000 | 1600 | 12 | 24 | 40 | 80 | 120 | 240 |
| | Minimum | 240 | 500 450 | 1000 | 450 | 500 | 1000 | 1800 | 15 | 30 | 50 | 100 | 150 | 300 |
| 3000/5 | Standard | 300 | 600 | 900 | 600 | 450 600 | 900 | 1800 | 14 | 28 | 45 | 90 | 140 | 280 |
| 3000/3 | Maximum | 350 | 750 | 1500 | 750 | 750 | | 2400 | 18 | 36 | 60 | 120 | 180 | 360 |
| | IVIGAIIIUIII | 550 | 750 | 1300 | 7.50 | 730 | 1500 | 3000 | 20 | 40 | 75 | 150 | 200 | 400 |

Note 1. Some of the maximum scale values in the table deviate from the VT ratio X CT ratio X adjustment range multiplying factor. This is because the best values are selected, and the values in the table are given priority.

Varmeters





YP-208NVAR

YP-10NVAR

■Specifications

| | _ | | | | | | | | | | | | | Re | ectar | ngula | r indicato | ors | | | | | | | | | | |
|---|-------------------|---------------------------------|----------------------------|-----------------|----------------|-------|-----------|--------------------------------|-----------------|-------------------|-------|-----------|--------------------------------|-----------------|------------------|-------|----------------|--------------------------------|-----------------|----------|--------------------|-----------|--------------------------------|-----------------|-------------------|------|-----------|--------------------------------|
| | | | | | | | | | | Y- | 2N S | Series | | | | | | | | | | , | Y-N S | Series | 3 | | | |
| Siz | e (wi | dth × height) | mm | | | 64> | <60 | | | | 85× | (75 | | | | 100> | < 85 | | | | 82× | (82 | | | | 102× | (102 | |
| Мо | del n | ame | | | YF | 206 | SNVAR | | | YF | -208 | BNVAR | | | YF | P-210 | NVAR | | | Υ | 'P-8N | IVAR | | | Y | P-10 | NVAR | |
| Op | eratio | n principle | | | | | | | | Т | ranso | ducer | | | | | | | | | | 1 | Frans | duce | r | | | |
| Acc | curac | y (grade) | | | | | | | | | 2. | 5 | | | | | | | | | | | 2 | .5 | | | | |
| Fre | quen | су | | | | | | | | | | | | | 50 | and | 60Hz | | | | | | | | | | | |
| Sca | ale le | ngth | (mm) | | | 5 | 5 | | | | 70 | 0 | | | | 85 | 5 | | | | 70 | 0 | | | | 9 | 0 | |
| We | ight | | (kg) | | | 0.0 | 07 | | | | 0. | 1 | | | | 0. | 1 | | | | 0. | 1 | | | | 0.1 | 15 | |
| ssification | ä | Ratir | ng | | umptio | on VA | sory | period | | umptic Current | | sory | period | | umptio Curren | | sory | period | _ | umptio | on VA t circuit | sory | period | Cons | umptic Current | - | sory | period |
| Indicator rating and delivery period classification | Circuit | Secondary rating | Indicator rating (Po) kvar | Voltage circuit | l ₁ | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification |
| d deliv | 3-phase 3-wire | 110V 5A | 0.8~1.2 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 |
| ing an | 3-ph | 220V 5A | T-150 | 0 | 3.2 | 0.5 | 1.0 | T-150 | 0 | 3.2 | 0.5 | 1.0 | T-150 | 0 | 3.2 | 0.5 | 1.0 | T-150 | 0 | 3.2 | 0.5 | 1.0 | T-150 | 0 | | | | |
| ator rat | 3-phase 4-wire | $\frac{110}{\sqrt{3}}$ /110V 5A | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | | | | |
| Indic | 9-ph | 110/190V 5A | 1.4~2.0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 |
| Pag | e with | outer dimension | ons drawing | | | | | • | | | 3 | 5 | | | | | | | | | • | | 3 | 6 | | | | |

Remarks (1) The varmeters are bidirectional deflection indicators. Unidirectional deflection indicators can be manufactured upon request.

(2) In regards to "Indicator rating (Po) kvar" in the "Rating" column:

3-phase, 3-wire $\begin{cases} Po = \sqrt{3} \times 110V \times 5A = 953 \cong 1 \text{kvar} & (Po = 0.8 \text{ to } 1.2 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = \sqrt{3} \times 220V \times 5A = 1906 \cong 2 \text{kvar} & (Po = 0.8 \text{ to } 1.2 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ 3-\text{phase, } 4-\text{wire} \\ \text{Varmeters} \end{cases} \\ Po = 3 \times \frac{110}{\sqrt{3}} V \times 5A = \sqrt{3} \times 110V \times 5A = 953 \cong 1 \text{kvar} & (Po = 0.8 \text{ to } 1.2 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = \sqrt{3} \times 190V \times 5A = 1650 \cong 1.7 \text{kvar} & (Po = 1.4 \text{ to } 2.0 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = \sqrt{3} \times 190V \times 5A = 1650 \cong 1.7 \text{kvar} & (Po = 1.4 \text{ to } 2.0 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = \sqrt{3} \times 190V \times 5A = 1650 \cong 1.7 \text{kvar} & (Po = 1.4 \text{ to } 2.0 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = \sqrt{3} \times 190V \times 5A = 1650 \cong 1.7 \text{kvar} & (Po = 1.4 \text{ to } 2.0 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = \sqrt{3} \times 190V \times 5A = 1650 \cong 1.7 \text{kvar} & (Po = 1.4 \text{ to } 2.0 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = \sqrt{3} \times 190V \times 5A = 1650 \cong 1.7 \text{kvar} & (Po = 1.4 \text{ to } 2.0 \text{kvar}, \text{ taking into account adjustment range multiplying factors of } 0.8 \text{ to } 1.2) \\ Po = 3 \times 110V \times 5A = 10.0 \times 10.$

- (3) Regarding the maximum scale of a varmeter
 - With a bidirectional deflection indicator, the left side is LEAD and the right side is LAG with respect to "zero" as the central division, and the standard scale indicates up to 1/2 of the maximum scale value. A scale indicating up to the maximum scale value can also be manufactured.
 - With a unidirectional deflection indicator (with "zero" at the left end), the scale indicates up to the maximum scale value. Please specify LEAD or LAG; the standard is LAG.
- (4) Models with a 1A current rating; can also be manufactured; the power consumption is basically the same as that of a 5A model.
- (5) The T-150 rectifier is a dedicated accessory (non-compatible accessory), and thus cannot be used in combinations other than those designated for the indicators. The distance between the indicator and the T-150 rectifier must be 5m or less, or the round-trip lead wire resistance must be 0.5Ω or less.
- (6) Use a varmeter with an input voltage in the range of 85 to 115% of the rated value (rated voltage $\pm 15\%$).
 - The indication may be unstable when used with an input voltage of 85% or less of the rating or the input voltage is switched on and off.
- (7) The weight of the T-150 rectifier is approximately 1kg.
- (8) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Scale calculation formula for varmeter

| Phase-wire system | Secondary rating | Scale calculation formula for varmeter | Remarks |
|-------------------|---------------------------------|--|----------------------------------|
| 3-phase 3-wire | 110V 5A | Indicator scale P (kvar)=VT ratio \times CT ratio \times Po (0.8~1.2) \times 1/2 | ●The value at the left is |
| 5-priase 5-wire | 220V 5A | Indicator scale P (kvar)=CT ratio \times Po (1.6~2.4) \times 1/2 | multiplied by 1/5 in the case of |
| 3-phase 4-wire | $\frac{110}{\sqrt{3}}$ /110V 5A | Indicator scale P (kvar)=VT ratio X CT ratio X Po (0.8~1.2) X 1/2 | a CT secondary current of 1A. |
| 5-priase 4-wire | 110/190V 5A | Indicator scale P (kvar)=VT ratio X CT ratio X Po (1.4~2.0) X 1/2 | |

Calculation example: In the case of a 3-phase, 3-wire circuit, VT 6600/110V and CT 100/5A, and a bidirectional deflection indicator with a scale indicating up to 1/2 the maximum scale value.

Indicator scale P (kvar)= $\frac{6600}{110} \times \frac{100}{5}$ ×Po (0.8~1.2)×1/2 = 480~720kvar

The manufacturable range of the varmeter scale is thus LEAD (480 to 720) ~ 0 ~ LAG (480 to 720) kvar.

The manufacturable range differs slightly according to the rating. For details, refer to the "Varmeter Scale Selection Reference Table" (p.60).





■Specifications

YP-12NVAR


LP-110NVAR

| _ | _ | | | | Rectar | ngular ind | licators | | | | | V | /ide-angle | indicato | rs | | | |
|---|-------------------|-------------------|----------------------------------|--------------------|----------|------------|-----------|--------------------------------------|--------------------|----------|-----------|-----------|--------------------------------------|--------------------|----------|-----------|-----------|--------------------------------------|
| | | | | | ١ | /-N Serie | s | | | | | | L-N S | Series | | | | |
| Siz | e (wi | dth × height) | mm | | | 122×122 | 2 | | | | 80×80 | | | | | 110×110 |) | |
| Мо | del n | ame | | | Υ | P-12NVA | .R | | | L | P-80NVA | R | | | LF | P-110NV | AR | |
| Ор | eratio | n principle | | | Т | ransduce | er | | | | | | Trans | ducer | | | | |
| Acc | curac | y (grade) | | | | 1.5 | | | | | 2.5 | | | | | 1.5 | | |
| Sca | ale le | ngth | (mm) | | | 100 | | | | | 124 | | | | | 175 | | |
| We | eight | | (kg) | | | 0.5 | | | | | 0.3 | | | | | 0.6 | | |
| ation | | D-# | | Con | sumption | ı VA | > | , no | Con | sumption | n VA | > | on | Con | sumption | n VA | > | , lo |
| assilic | Circuit | Ratir | ng | je it | Curren | t circuit | ssor | /ery iod icati | je it | Curren | t circuit | ssor | very iod icati | it Je | Curren | t circuit | SSOI | /ery iod icati |
| Indicator rating and delivery period classification | Ö | Secondary rating | Indicator rating (Po) kvar | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification |
| d deliv | 3-phase 3-wire | 110V 5A | 0.8~1.2 | 1.6 | 0.5 | 1.0 | _ | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | _ | 0 |
| ting an | 9-ph | 220V 5A | 1.6~2.4 | 3.2 | 0.5 | 1.0 | _ | 0 | 3.2 | 0.5 | 1.0 | T-150 | 0 | 3.2 | 0.5 | 1.0 | _ | 0 |
| ator rai | 3-phase 4-wire | 110 √3/110V 5A | 0.8~1.2 | 1.6 | 0.5 | 1.0 | _ | 0 | 1.6 | 0.5 | 1.0 | T-150 | 0 | 1.6 | 0.5 | 1.0 | _ | 0 |
| Indica | 3-pt | 110/190V 5A | | 2.8 | 0.5 | 1.0 | _ | 0 | 2.8 | 0.5 | 1.0 | T-150 | 0 | 2.8 | 0.5 | 1.0 | _ | 0 |
| Pac | ge with | outer dimension | ons drawing | | | 36 | | | | | | | 3 | 7 | - | | | |


Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Syllibol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

■Outer dimensions of accessory

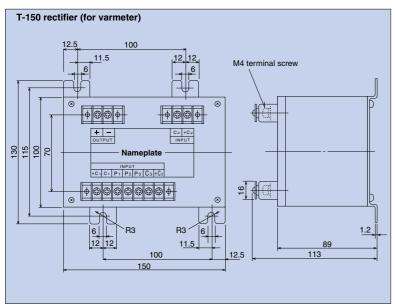


■Ordering method





Varmeters


■Connection diagrams

●3-phase, 3-wire system

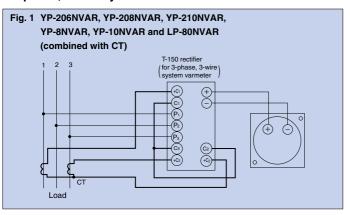


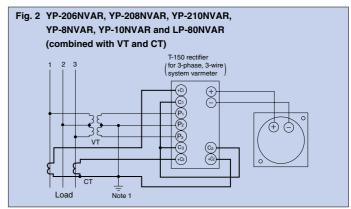


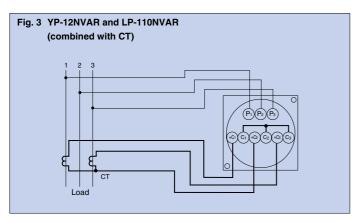


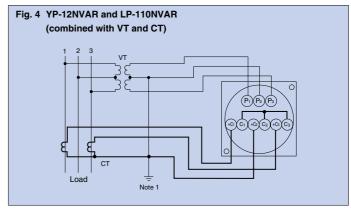


●3-phase, 4-wire system

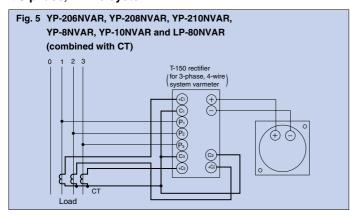

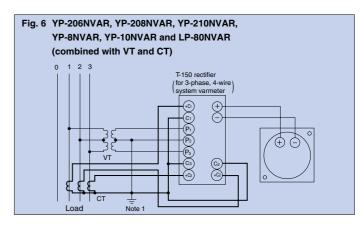

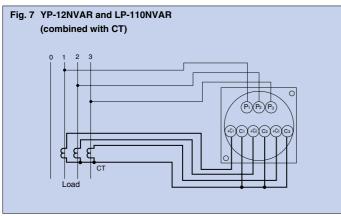

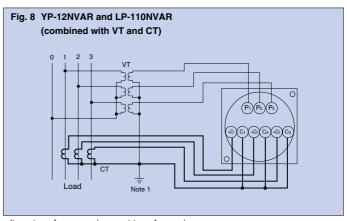

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

■Varmeter Scale Selection Reference Table

Although the maximum scale of a varmeter can be determined by VT ratio \times CT ratio \times indicator rating (Po), the following table shows the manufacturable scale values (minimum, standard and maximum) for various VT and CT ratios.

If a scale value other than the standard scale value is desired, specify a suitable scale within the manufacturable range.

● Table of manufacturable maximum scales for varmeters : Scale units kvar : Scale units Mvar : Scale units

| Indicat | or scale | When th | ne indicato up to | | | ional defle m scale va | | | indicate | When th | to indi | or scale of cate up to | the maxir | ctional def mum scale deflection | lection ince value | |
|----------|------------------------|---------|----------------------|----------|-------------|---------------------------|-------------|-------|----------|---------|---------|---------------------------|-----------|--|-----------------------|-------|
| Phase-w | ire system | | 3-p | hase 3-w | rire/3-phas | se 4-wire | (line volta | ge) | | | 3-phase | e 3-wire/3 | -phase 4- | wire (line | voltage) | |
| 1/4 | Voltage VT ratio | 220 | 440 | 3300 | 6600 | 11000 | 22000 | 33000 | 66000 | 220 | 440 | 3300 | 6600 | 22000 | 33000 | 66000 |
| 5 | ratio | 220 | 440 | 3300 | 6600 | 11000 | 22000 | 33000 | 66000 | 220 | 440 | 3300 | 6600 | 22000 | 33000 | 66000 |
| CT ratio | 96 "96 \ | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 | /110 |
| | Minimum | 4 | 8 | 60 | 120 | 200 | 400 | 600 | 1200 | 8 | 15 | 120 | 240 | 800 | 1200 | 2400 |
| 25/5 | Standard | 5 | 10 | 75 | 150 | 250 | 500 | 750 | 1500 | 10 | 20 | 150 | 300 | 1000 | 1500 | 3000 |
| | Maximum | 6 | 12 | 90 | 180 | 300 | 600 | 900 | 1800 | 12 | 25 | 180 | 350 | 1200 | 1800 | 3500 |
| | Minimum | 8 | 15 | 120 | 240 | 400 | 800 | 1200 | 2400 | 15 | 30 | 240 | 450 | 1500 | 2400 | 4500 |
| 50/5 | Standard | 10 | 20 | 150 | 300 | 500 | 1000 | 1500 | 3000 | 20 | 40 | 300 | 600 | 2000 | 3000 | 6000 |
| | Maximum | 12 | 24 | 180 | 350 | 600 | 1200 | 1800 | 3500 | 25 | 50 | 350 | 750 | 2500 | 3500 | 7500 |
| | Minimum | 12 | 24 | 180 | 350 | 600 | 1200 | 1800 | 3500 | 24 | 45 | 350 | 700 | 2400 | 3500 | 7000 |
| 75/5 | Standard | 15 | 30 | 220 | 450 | 750 | 1500 | 2200 | 4500 | 30 | 60 | 450 | 900 | 3000 | 4500 | 9000 |
| | Maximum | 18 | 35 | 270 | 500 | 900 | 1800 | 2700 | 5000 | 35 | 75 | 500 | 1000 | 3500 | 5000 | 10 |
| | Minimum | 16 | 30 | 240 | 450 | 800 | 1600 | 2400 | 4500 | 30 | 60 | 450 | 900 | 3000 | 4500 | 9000 |
| 100/5 | Standard | 20 | 40 | 300 | 600 | 1000 | 2000 | 3000 | 6000 | 40 | 80 | 600 | 1200 | 4000 | 6000 | 12 |
| | Maximum | 24 | 50 | 350 | 750 | 1200 | 2400 | 3500 | 7500 | 50 | 100 | 750 | 1500 | 5000 | 7500 | 15 |
| | Minimum | 24 | 45 | 350 | 700 | 1200 | 2400 | 3500 | 7000 | 45 | 90 | 700 | 1400 | 4500 | 7000 | 14 |
| 150/5 | Standard | 30 | 60 | 450 | 900 | 1500 | 3000 | 4500 | 9000 | 60 | 120 | 900 | 1800 | 6000 | 9000 | 18 |
| | Maximum | 35 | 75 | 500 | 1000 | 1800 | 3500 | 5000 | 10 | 75 | 150 | 1000 | 2000 | 7500 | 10 | 20 |
| | Minimum | 30 | 60 | 450 | 900 | 1600 | 3000 | 4500 | 9000 | 60 | 120 | 900 | 1800 | 6000 | 9000 | 18 |
| 200/5 | Standard | 40 | 80 | 600 | 1200 | 2000 | 4000 | 6000 | 12 | 80 | 160 | 1200 | 2400 | 8000 | 12 | 24 |
| | Maximum | 50 | 100 | 750 | 1500 | 2400 | 5000 | 7500 | 15 | 100 | 180 | 1500 | 3000 | 10 | 15 | 30 |
| | Minimum | 45 | 90 | 700 | 1400 | 2400 | 4500 | 7000 | 14 | 90 | 180 | 1400 | 2800 | 9000 | 14 | 28 |
| 300/5 | Standard | 60 | 120 | 900 | 1800 | 3000 | 6000 | 9000 | 18 | 120 | 240 | 1800 | 3600 | 12 | 18 | 36 |
| | Maximum | 75 | 150 | 1000 | 2000 | 3500 | 7500 | 10 | 20 | 150 | 300 | 2000 | 4000 | 15 | 20 | 40 |
| | Minimum | 60 | 120 | 900 | 1800 | 3000 | 6000 | 9000 | 18 | 120 | 250 | 1800 | 3800 | 12 | 18 | 38 |
| 400/5 | Standard | 80 | 160 | 1200 | 2400 | 4000 | 8000 | 12 | 24 | 160 | 320 | 2400 | 4800 | 16 | 24 | 48 |
| | Maximum | 90 | 180 | 1500 | 3000 | 5000 | 10 | 15 | 30 | 180 | 350 | 3000 | 6000 | 18 | 30 | 60 |
| | Minimum | 90 | 180 | 1400 | 2800 | 4500 | 9000 | 14 | 28 | 180 | 380 | 2800 | 6000 | 18 | 28 | 60 |
| 600/5 | Standard | 120 | 240 | 1800 | 3600 | 6000 | 12 | 18 | 36 | 240 | 480 | 3600 | 7200 | 24 | 36 | 72 |
| | Maximum | 150 | 300 | 2000 | 4000 | 7500 | 15 | 20 | 40 | 300 | 600 | 4000 | 8500 | 30 | 40 | 85 |
| | Minimum | 120 | 250 | 1800 | 3800 | 6000 | 12 | 18 | 38 | 250 | 500 | 3800 | 7500 | 25 | 38 | 75 |
| 800/5 | Standard | 160 | 320 | 2400 | 4800 | 8000 | 16 | 24 | 48 | 320 | 640 | 4800 | 9600 | 32 | 48 | 96 |
| | Maximum | 180 | 350 | 3000 | 6000 | 10 | 18 | 30 | 60 | 350 | 750 | 6000 | 12 | 35 | 60 | 120 |
| | Minimum | 180 | 380 | 2800 | 6000 | 9000 | 18 | 28 | 60 | 380 | 750 | 6000 | 12 | 38 | 60 | 120 |
| 1200/5 | Standard | 240 | 480 | 3600 | 7200 | 12 | 24 | 36 | 72 | 480 | 960 | 7200 | 14 | 48 | 72 | 140 |
| | Maximum | 300 | 600 | 4000 | 8500 | 15 | 30 | 40 | 85 | 600 | 1200 | 8500 | 18 | 60 | 85 | 180 |
| | Minimum | 240 | 450 | 3500 | 7000 | 12 | 24 | 35 | 70 | 450 | 900 | 7000 | 14 | 45 | 70 | 140 |
| 1500/5 | Standard | 300 | 600 | 4500 | 9000 | 15 | 30 | 45 | 90 | 600 | 1200 | 9000 | 18 | 60 | 90 | 180 |
| | Maximum | 350 | 750 | 5000 | 10 | 18 | 35 | 50 | 100 | 750 | 1500 | 10 | 20 | 75 | 100 | 200 |
| | Minimum | 300 | 600 | 4500 | 9000 | 16 | 30 | 45 | 90 | 600 | 1200 | 9000 | 18 | 60 | 90 | 180 |
| 2000/5 | Standard | 400 | 800 | 6000 | 12 | 20 | 40 | 60 | 120 | 800 | 1600 | 12 | 24 | 80 | 120 | 240 |
| | Maximum | 500 | 1000 | 7500 | 15 | 24 | 50 | 75 | 150 | 1000 | 1800 | 15 | 30 | 100 | 150 | 300 |
| | Minimum | 450 | 900 | 7000 | 14 | 24 | 45 | 70 | 140 | 900 | 1800 | 14 | 28 | 90 | 140 | 280 |
| 3000/5 | Standard | 600 | 1200 | 9000 | 18 | 30 | 60 | 90 | 180 | 1200 | 2400 | 18 | 36 | 120 | 180 | 360 |
| | Maximum | 750 | 1500 | 10 | 20 | 35 | 75 | 100 | 200 | 1500 | 3000 | 20 | 40 | 150 | 200 | 400 |

Remarks (1) The standard indicator rating (Po) is 1kvar.

⁽²⁾ For CT ratio scales not shown in the above table, multiply the ten-fold CT ratio scale values by 0.1 and the 1/10 CT ratio scale values by 10.

Note 1. Some of the maximum scale values in the table deviate from the VT ratio X CT ratio X adjustment range multiplying factor. This is because the best values are selected, and the values in the table are given priority.

Power Factor Meters

For balanced circuits





YP-12NPF

LP-110NPF

Specifications

| | | | | | | | | | | | R | ectangula | r indicato | ors | | | | | | | | |
|-------------------------------|--------------------|----------------|---------------------|----------------------------|-----------|--------------------------------|-----------------------|--------------------------------|-----------|--------------------------------|---------------------|-----------------|------------|--------------------------------|---------------------|----------------------------|-----------|--------------------------------|-----------------|--------------------------------|-----------|--------------------------------|
| | | | | | | | | Y-2N S | Series | | | | | | | | | Y-N S | Serie | s | | |
| Siz | e (width × heigl | ht) mm | | 64> | (60 | | | 85> | <75 | | | 100 | ×85 | | | 82× | (82 | | | 102> | <102 | |
| Мс | del name | | | YP-20 | 6NPF | | | YP-20 | 8NPF | | | YP-21 | 0NPF | | | YP-8 | NPF | | | YP-10 | NPF | |
| Op | eration principle |) | | | | | | Trans | ducer | | | | | | | | | Trans | duce | er | | |
| Ac | curacy (grade) | | | | | | | 5 | 5 | | | | | | | | | | 5 | | | |
| Sc | ale | | | | | | LE | AD 0.5~ | 1~0.5 l | _AG | | | | | | | LEAD | 0.5~ | -1~0 | .5 LAG | | |
| Fre | equency | | | | | | | 50 and | 60Hz | | | | | | | | 5 | 0 an | d 60l | Ηz | | |
| Sc | ale length | (mm) | | 5 | 5 | | | 7 | 0 | | | 8 | 5 | | | 70 |) | | | 9 | 0 | |
| We | eight | (kg) | | 0.0 |)7 | | | 0. | .1 | | | 0. | 1 | | | 0. | 2 | | | 0. | 2 | |
| Indicator rating and delivery | Circuit | Rating | Voltage circuit suo | umption VA Current circuit | Accessory | Delivery period classification | Voltage circuit suo 2 | cumption VA Current circuit | Accessory | Delivery period classification | Voltage circuit Suo | Current circuit | Accessory | Delivery period classification | Voltage circuit suo | umption VA Current circuit | Accessory | Delivery period classification | Voltage circuit | cumption VA Current circuit | Accessory | Delivery period classification |
| cator | 3-phase 3-wire | 110V 5A | 1 | 1 | T-100 | 0 | 1 | 1 | T-100 | 0 | 1 | 1 | T-100 | 0 | 1 | 1 | _ | 0 | 1 | 1 | _ | 0 |
| Indi | balanced circuit | 220V 5A | 2 | 1 | T-100 | 0 | 2 | 1 | T-100 | 0 | 2 | 1 | T-100 | 0 | 2 | 1 | _ | 0 | 2 | 1 | _ | 0 |
| Pag | ge with outer dime | nsions drawing | | | | | | 3 | 5 | | | | | | | | | 3 | 36 | | | |

| | | | | Rectangular ind | icators | | | | V | /ide-angle | e indicato | ors | | |
|---|--------------------|----------------|------------|---------------------|-----------|--------------------------------|------------|-----------------|-----------|-----------------------------------|-----------------|-----------------|-----------|-------------------------------|
| | | | | Y-N Series | S | | | | | L-N S | Series | | | |
| Siz | e (width × heigl | nt) mm | | 122×122 | | | | 80×80 | | | | 110×110 | 1 | |
| Мо | del name | | | YP-12NPI | = | | | LP-80NPF | = | | | LP-110NP | F | |
| Ор | eration principle | | | Transduce | er | | | | | Trans | ducer | | | |
| Acc | curacy (grade) | | | 5 | | | | | | į | 5 | | | |
| Sca | ale | | | LEAD 0.5~1~0. | 5 LAG | | | | LE | AD 0.5~ | √1~0.5 L | .AG | | |
| F | | | 1-pha | ase 2-wire: specify | 50Hz or | 60Hz | | 1 | l-phase 2 | 2-wire: sp | ecify 50H | lz or 60Hz | | |
| Fre | equency | | 3 | 3-phase 3-wire: 50 | and 60H | lz | | | 3-pha | ase 3-wire | e: 50 and | 60Hz | | |
| Sca | ale length | (mm) | | 100 | | | | 124 | | | | 175 | | |
| We | eight | (kg) | | 0.4 | | | | 0.4 | | | | 0.5 | | |
| p | | | Con | sumption VA | 7 | p _c | Coi | nsumption VA | > | p _C | Cor | nsumption VA | > | p _c _u |
| peric | Circuit | Rating | circuit | Current circuit | SSOI | / peri | circuit | Current circuit | SSOI | y peri | rouit | Current circuit | Ioss | / peri |
| rating and delivery period classification | Ollicuit | riamig | Voltage ci | l ₁ | Accessory | Delivery period classification | Voltage ci | l1 | Accessory | Delivery period classification | Voltage circuit | l1 | Accessory | Delivery period dassification |
| ng ar lassifi | 1-phase 2-wire | 110V 5A | 1.3 | 0.5 | | Δ | | | | | 1.3 | 0.5 | _ | Δ |
| | 1-priase 2-wire | 220V 5A | 2.6 | 0.5 | ı | Δ | | _ | | | 2.6 | 0.5 | _ | Δ |
| Indicator | 3-phase 3-wire | 110V 5A | 1 | 1 | I | 0 | 1 | 1 | _ | 0 | 1 | 1 | _ | 0 |
| Ē | balanced circuit | 220V 5A | 2 | 1 | | 0 | 2 | 1 | _ | 0 | 2 | 1 | _ | 0 |
| Pag | ge with outer dime | nsions drawing | | 36 | | | | | | 3 | 7 | | | |

Remarks (1) Indicators with a LEAD 0-1-0 LAG scale can also be manufactured; however, measured values for

power factors of 0.5 or less are for reference only

(2) Use with an input current of 1/5 (e.g. 1A) or more of the rated current (e.g. 5A). The error increases as the input current decreases.

(3) In a power OFF or no-load state, the pointer of the power factor meter stops at the mechanical zero


point; black point near the power factor of 1.

The T-100 rectifier is a dedicated accessory (non-compatible accessory), and thus cannot be used in combinations other than those designated for the indicators.

- Models with a current rating of 1A can also manufactured; the power consumption is basically the same as that of a 5A model.
- (6) Four-quadrant power factor meters can also be manufactured for LI-1NPF 3-phase, 3-wire balanced circuits. Please contact a Mitsubishi Electric representative for details.
- The weight of the T-100 rectifier is approximately 0.9kg.
- Cannot use with unbalanced loads.

 Please specify the frequency in the case of the power factor meter for 1-phase, 2-wire systems.
- (11) In the case of a negative phase sequence input with a 3-phase, 3-wire circuit, LEAD and LAG are indicated in an inverted manner. Indicators return to normal operation when the connections of the P2 and P3 circuits of the voltage input terminals are interchanged.
- (12) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Ordering method



Delivery period classification

product

Immediate delivery

Symbol


product

Within 20 days

product


21 to 60 days


■Outer dimensions of accessory

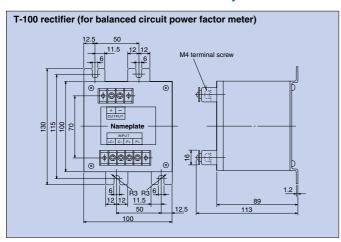


■Connection diagrams


●1-phase, 2-wire systems








●3-phase, 3-wire systems














Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

Power Factor Meters

For unbalanced loads





YP-208NPFU

YP-10NPFU

■Specifications

| | | | | | | | | | | | | | Re | ctar | ngula | r indicate | ors | | | | | | | | | | |
|---|-------------------|-----------------|------------|----------------|----------------|-----------|--------------------------------|-----------------|------------|----------|-----------------|---------------|-----------------|----------|----------------|------------|--------------------------------|-----------------|----------|----------------|-----------|--------------------------------|-----------------|----------|----------------|-----------|--------------------------------|
| | | | | | | | | | Y-2 | N Series | | | | | | | | | | | , | Y-N S | Serie | s | | | |
| Siz | e (width × heig | ht) mm | | | 64> | <60 | | | 8 | 35×75 | | | | | 100 | ×85 | | | | 82> | <82 | | | | 102> | (102 | |
| Мо | del name | | | YF | P-206 | SNPFU | | | YP- | 208NPF | J | | | YF | P-210 | NPFU | | | Υ | 'P-81 | NPFU | | | Υ | P-10 | NPFU | |
| Оре | eration principle |) | | | | | | | Tra | ınsduceı | | | | | | | | | | | ٦ | Trans | duce | er | | | |
| Acc | uracy (grade) | | | | | | | | | 5 | | | | | | | | | | | | 5 | 5 | | | | |
| Sca | le | | | | | | | LE/ | AD 0 | .5~1~0.5 | LAC | 3 | | | | | | | | | LEAD | 0.5~ | 1~0. | 5 L | .AG | | |
| Fre | quency 50 or 60Hz | | | | | | | | | | | | | | | 5 | 50 or | 60H | z | | | | | | | | |
| Sca | le length | (mm) | | | 70 | | | | | 8 | 5 | | | | 7 | 0 | | | | 9 | 0 | | | | | | |
| We | ght | (kg) | | | 0.0 | 07 | | | | 0.1 | | | | | 0. | .1 | | | | 0 | .1 | | | | 0. | 15 | |
| p | | | Cons | umpti | on VA | у | po u | Cons | umption | VA > | р | ٦ | Consi | ımptio | on VA | у | p c | Cons | umptio | on VA | У | po u | Cons | umpti | on VA | Σ. | р _с |
| peric | Circuit | Rating | circuit | Curren | t circuit | ssol | / peri | rcuit | Current ci | rcuit S | / peri | icatio | rcuit | Curren | t circuit | Ioss | / peri | rouit | Current | t circuit | loss | / peri | rcuit | Curren | t circuit | SSOI | / peri |
| Indicator rating and delivery period classification | Circuit | nauiig | Voltage ci | l ₁ | l ₂ | Accessory | Delivery period classification | Voltage circuit | l1 l3 | Paccess | Delivery period | classif | Voltage circuit | l1 Iз | l ₂ | Accessory | Delivery period classification | Voltage circuit | l1 I3 | l ₂ | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l ₂ | Accessory | Delivery period classification |
| y and ssifica | 3-phase 3-wire | 110V 5A | 1 | | 2 | T-150 | 0 | 1 | 2 | T-15 | 0 | $\frac{1}{2}$ | 7 | | 2 | T-150 | 0 | 1 | 13 | | T-150 | 0 | 1 | | 2 | T-150 | 0 |
| rating | unbalanced loads | | 2 | | - 2 | T-150 | 0 | 2 | 2 | T-15 | - | - | 2 | | - 2 | T-150 | 0 | 2 | 2 | | T-150 | 0 | 2 | | 2 | T-150 | 0 |
| cator | 3-phase | 110/110V 5A | | 1 | 2 | T-150 | 0 | 0.7 | | 2 T-15 | - | + | 0.7 | 1 | 2 | T-150 | 0 | 0.7 | 1 | 2 | T-150 | 0 | 0.7 | 1 | 2 | T-150 | |
| Ind | 4-wire | 110/190V 5A | 1 | 1 | 2 | T-150 | 0 | 1 | | 2 T-15 | _ | 5 | 1 | 1 | 2 | T-150 | 0 | 1 | 1 | 2 | T-150 | 0 | 1 | 1 | 2 | T-150 | 0 |
| Pag | e with outer dime | ensions drawing | | • | | | | | | 35 | | | | | | | | | | | • | 3 | 6 | | | | |


- Remarks (1) A LEAD 0~1~0 LAG scale can also be manufactured; however, the measured power factor values of 0.5 or less are for reference only.
 - (2) Please specify the frequency.
 - (3) Use with an input current of 1/5 (e.g. 1A) or more of the rated current (e.g. 5A). The error increases as the input current decreases.
 - (4) In the power off or no-load state, the needle of the power factor meter stops at the mechanical zero point; black point near the power factor of 1.
 - (5) The T-150 rectifier is a dedicated accessory (non-compatible accessory), and thus cannot be used in combinations other than those designated for the indicators. The distance between the indicator and the T-150 rectifier must be 5m or less, or the round-trip lead wire resistance must be 0.5Ω or less.
 - (6) Models with a current rating of 1A can also manufactured; the power consumption is basically the same as that of a 5A model.
 - (7) The weight of the T-150 rectifier is approximately 1.4kg.
 - (8) Can also be used for balanced circuits.
 - (9) Use with a positive phase sequence.

For the following models, indicators will not be function normally when a negative-phase sequence is input. Return the indicators to normal operation by interchanging the voltage and current circuits.

| Model name | Indication state | Reset indicator for normal operation |
|--|-----------------------------------|--|
| YP-206NPFU, YP-208NPFU YP-210NPFU YP-8NPFU, YP-10NPFU LP-80NPFU | The indicator reading is unclear. | Change the voltage and current circuit connections as follows: · Switch P1 and P3 · Switch +C1 and +C3 · Switch C1 and C3 |

(10) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

■Ordering method







YP-12NPFU


NPFU LP-110NF


| | | | | Rectar | ngular ind | licators | | | | | V | Vide-angle | e indicato | rs | | | |
|---|------------------------------------|---|--------------------|----------|------------|-----------|--------------------------------------|----------------------|-----------------|----------------|-----------|--------------------------------------|-----------------|----------|------------|-----------|--------------------------------------|
| | | | | ` | /-N Series | s | | | L-N Series | | | | | | | | |
| Size | e (width × heig | ht) mm | 122×122 | | | | | 80×80 110×110 | | | | | | | | | |
| Mod | del name | | | Y | P-12NPF | :U | | LP-80NPFU LP-110NPFU | | | | | | | | | |
| Оре | eration principle |) | | 7 | ransduce | er | | Transducer | | | | | | | | | |
| Accuracy (grade) 5 | | | | | | | | | | | 5 | 5 | | | | | |
| Sca | ıle | | LEAD | 0.5~1~0. | 5 LAG | | | | | LE | AD 0.5~ | 1~0.5 L | .AG | | | | |
| Fre | quency | | | 5 | 0 or 60H | z | 50 or 60H | | | | | | 60Hz | | | | |
| Sca | Scale length (mm) | | | | 100 | | | | | 124 | 175 | | | | | | |
| Wei | ight | (kg) | | | 0.5 | | | | | 0.3 | | | | | 0.6 | | |
| ō | | | Con | sumption | ı VA | > | . uo | Cor | sumption | n VA | > | . 6 | Cor | sumptio | on VA | > | . uo |
| peric | Circuit | Rating | <u>a</u> + | Curren | t circuit | ssor | ery iod cati | ф + | Current circuit | | ssor | Delivery period ssificati | e ± | Currer | nt circuit | ssor | very iod cati |
| Indicator rating and delivery period classification | Ollicuit | naung | Voltage circuit | l1 l3 | l 2 | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l ₂ | Accessory | Delivery period classification | Voltage circuit | l1 l3 | l2 | Accessory | Delivery period classification |
| ng ar assifi | 3-phase 3-wire | 110V 5A | 1.5 | 0 | .5 | _ | 0 | 1 | : | 2 | T-150 | 0 | 1.5 | О | .5 | _ | 0 |
| or rati | unbalanced loads | 220V 5A | 3 | 0 | .5 | _ | 0 | 2 | : | 2 | T-150 | 0 | 3 | О | .5 | _ | 0 |
| dicate | 3-phase | ¹¹⁰ ⁄ _{√3} /110V 5A | 1 | 0.5 | 1 | _ | 0 | 0.7 | 1 | 2 | T-150 | 0 | 1 | 0.5 | 1 | _ | 0 |
| Ē | 4-wire | 110/190V 5A | 2 | 0.5 | 1 | _ | 0 | 1 | 1 | 2 | T-150 | 0 | 2 | 0.5 | 1 | _ | 0 |
| Pag | Page with outer dimensions drawing | | | | 36 | | | | | | | 3 | 7 | | | • | |

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | ∆Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Symbol | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |

■Outer dimensions of accessories

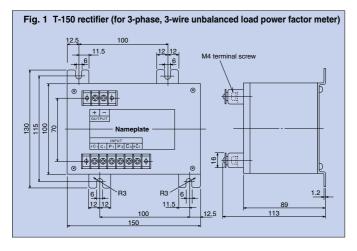

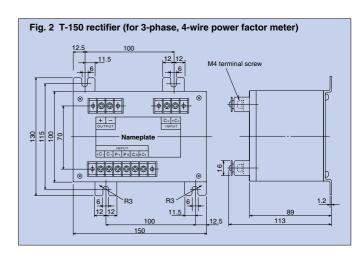






Power Factor Meters


■Connection diagrams

●3-phase, 3-wire systems (unbalanced loads)

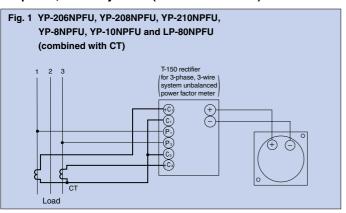


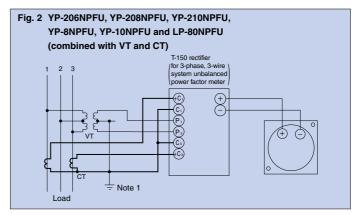


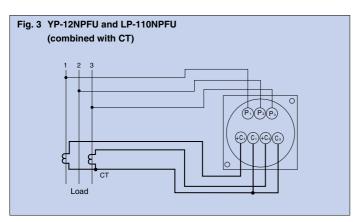


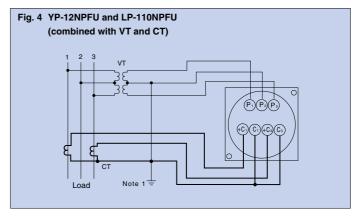


●3-phase, 4-wire systems

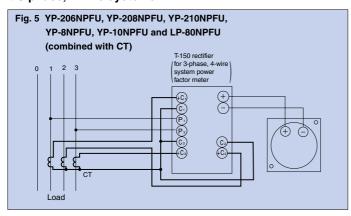

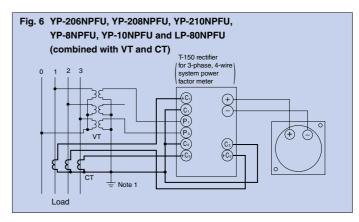

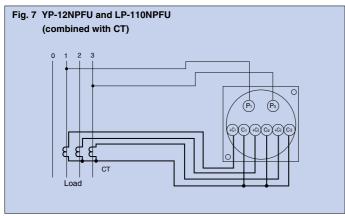

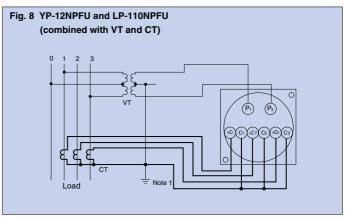

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

Frequency Meters





■Specifications YP-8NF LP-110NF

| | | | | | | | Re | ctangula | r indicat | ors | | | | | Wi | ide-angle | e indicato | ors |
|----------------|---------------------------------------|--------|-------------|--------------------|-------------|--------------------|-------------|---------------------|-------------|---------------------|-------------|--------------------|-------------|--------------------|-------------|--------------------|-----------------|--------------------|
| | | | | , | Y-2N Sei | ries | | | | | Y-N S | eries | | | L-N Series | | | |
| Size | e (width $	imes$ heigh | nt) mm | 64> | <60 | 85> | 85×75 100×85 | | 823 | K82 | 102> | <102 | 122> | <122 | 80> | <80 | 110> | < 110 | |
| Mod | Model name YP-206NF | | | | | YP-208NF YP-210NF | | | YP- | 8NF | YP-1 | 0NF | YP-1 | 2NF | LP-8 | ONF | LP-1 | 10NF |
| Оре | Operation principle Transducer | | | | | | | | | Trans | ducer | | | | Trans | ducer | | |
| Acc | Accuracy (grade) 1 | | | | | | | | - | 1 | | 0. | .5 | | 0 | .5 | | |
| Sca | le length | 5 | 5 | 7 | 0 | 8 | 5 | 7 | 0 | 9 | 0 | 10 | 00 | 12 | 24 | 17 | 75 | |
| Wei | Weight (kg) | | | .1 | 0. | 15 | 0. | 15 | 0. | 15 | 0 | .2 | 0. | .3 | 0. | .3 | 0 | .5 |
| ion | Rated voltage | Scale | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period | Consumption | Delivery period |
| classification | V | Hz | VA | classification | VA | classification | VA | classification | VA | classification | VA | classification | VA | classification | VA | classification | VA | classification |
| class | | 45~55 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 1.5 | 0 | 1.5 | 0 |
| period | 110 | 55~65 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 1.5 | 0 | 1.5 | 0 |
| delivery p | | 45~65 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 2.5 | 0 | 1.5 | 0 | 1.5 | 0 |
| deli) | | 45~55 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 3 | 0 | 3 | 0 |
| ratingand | 220 | 55~65 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 3 | 0 | 3 | 0 |
| ratin | | 45~65 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 5 | 0 | 3 | 0 | 3 | 0 |
| Indicator | Special | ecale | | | | | | | 45 | ~75Hz, ⁻ | 170~190 | Hz | | | | | | |
| pu | Special soule | | | | | | | 85~110Hz, 360~440Hz | | | | | | | | | | |
| Page | Page with outer dimensions drawing 35 | | | | | | | 36 | | | | | 37 | | | | | |

Remarks (1) Allowable voltage variation ranges for 110V: 90~130V; for 220V: 180~260V.


- (2) The mechanical zero point of the needle is the black point at the left end of the meter (see scale example below).
- (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | ∆Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Syrribor | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |



■Connection diagrams






Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

■Ordering method



Receiving Indicators

Receiving indicators indicate the quantity measured when an electrical signal is received from the transmitter of a detector of a power/instrumentation transducer. Receiving indicators are used to measure industrial quantities, including remote measurements.

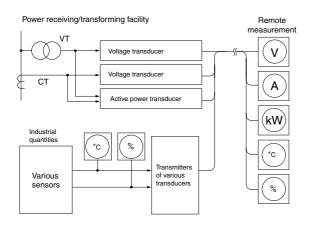

- Measurement of pressure, temperature, speed, rpm and other industrial quantities
- Telemetry measurement (remote measurement) in combination with transducers

Refer to p.151 onward of this catalog regarding the transducers to be used with receiving indicators.





YM-8NRI

LM-110NRI

■Specifications

ODC indicators

| | _ | _ | | | | | Rectangula | ar indicators | | | Wide-angle indicators | | |
|--|--|-----------|-------------------------------|--------------------|--------------|--------------|--------------|----------------------|------------------|----------|-----------------------|-----------|--|
| | | | | | | Y-2N Series | | | Y-N Series | | L-N S | Series | |
| Siz | e (wi | dth × | height) | mm | 64×60 | 85×75 | 100×85 | 82×82 | 102×102 | 122×122 | 80×80 | 110×110 | |
| Мо | del n | ame | | | YM-206NRI | YM-208NRI | YM-210NRI | YM-8NRI | YM-10NRI | YM-12NRI | LM-80NRI | LM-110NRI | |
| Ор | eratio | on pri | nciple | | | Movable coil | | Movable coil | | | Movab | ole coil | |
| Acc | curac | y (gra | ade) | | | 2.5 | | 2. | 5 | 1.5 | 2.5 | 1.5 | |
| Sca | Scale length (mm) | | mm) | 55 | 70 | 85 | 70 90 | | 100 | 124 | 175 | | |
| We | ight | | | (kg) | 0.07 0.1 0.1 | | 0.1 0.15 | | 0.3 | 0.3 | 0.4 | | |
| Indicator rating Delivery period | | | Delivery period | | | | Internal res | istance (Ω) | | | | | |
| 100 <i>μ</i> A Δ | | | | 2000Ω | | 200 | Ω0 | 5000Ω | _ | _ | | | |
| 200μA Δ | | | 1200Ω | | 120 | Ω0 | 5000Ω | _ | _ | | | | |
| 300μA Δ | | | 1000Ω | | 100 | Ω0 | 1550Ω | 920Ω | | | | | |
| ifice | <u>Θ</u> 500μA Δ | | | 730Ω | | 73 | ΩΩ | 780Ω | 58 | 0Ω | | | |
| ass | Single Single | | 0 | | 200Ω | | 20 | ΩΩ | 250Ω | 18 | ΩΩ | | |
| D | | | 0 | | Ω 8 | | 8: | Ω | 50Ω | 8 | Ω | | |
| eric | | | 10mA | 0 | | 2Ω | | 2: | Ω | 25Ω | 6 | Ω | |
| Ϋ́ | 8 | | 20mA | 0 | 0.8Ω | | | 0.8 | ΒΩ | Ω8.0 | 3Ω | | |
| live | | ₫ | ±0.5mA Note 1 | 0 | | 200Ω | | 20 | ΩΩ | 250Ω | 180Ω | | |
| d de | | | ±1mA | 0 | | 100Ω | | 10 | ΩΩ | 125Ω | 90Ω | | |
| and | | peg | 1~5mA | 0 | | 10Ω | | 10 | Ω | 25Ω | 50 | Ω | |
| ıting | |) bre | 2~10mA | 0 | | 4Ω | | 4: | Ω | 5Ω | 15 | iΩ | |
| Table Description Descri | | | 1Ω | | 1: | Ω | 5Ω | 10 | Ω | | | | |
| 2g Cap Com A | | | 2Ω | | 2: | Ω | 3Ω | 4 | Ω | | | | |
| Indi | ge | Ind | licator rating | Delivery period | | | | Consumption cur | rent (approx. mA |) | | | |
| | DC voltage | | 3, 5, 10, 15V 50, 60, 100V | 0 | | 1mA | | 1mA | | 1mA | 1mA | | |
| | ۵ | Z supp | ero- pressed 1~5V | 0 | | 1.25mA | 1.25mA | | | 1.25mA | 1.25mA | | |
| Pag | e with | oute | r dimensions d | rawing | | 35 | | | 36 | | 37 | | |

Note 1. A 500Ω internal resistance indicator can also be manufactured for models with indicator ratings of 1mA and ±0.5mA.

Please specify an internal resistance of 500Ω .

Note 2. In the case of scales with units of electricity (A, V, W, var, cosø, Hz), AC/DC and three-phase circuit symbols are not displayed. For receiving indicators, the symbol for the quantity input is displayed.

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Symbol | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |

- Remarks (1) With a zero-suppressed indicator, the zero point of the needle is suppressed mechanically to eliminate the zero point.
 - Zero-suppressed indicators can be manufactured for values of 20% or lower of the maximum rating of the indicator.
 - (2) For cases when the indicator input is DC voltage, an indicator with an adjustment resistor, where the adjustment resistor is added internally to the indicator, can be manufactured. (This type can be used in combination with specific scales.)
 - The range of adjustment by the adjustment resistor is $\pm 5\%$ to $\pm 20\%$ with respect to the maximum scale value.
 - The adjustment resistor is mounted on the rear face (i.e., face with terminals) of the indicator.
 - (3) rpm detectors and other industrial quantity detectors are to be prepared by the customer.
 - (4) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

AC indicators

| | _ | | | | | Rectangula | r indicators | | | Wide-angle | e indicators | | |
|------------------------------------|---------------------------------------|----------------------|-----------------|-----------|-------------|------------|-------------------|-------------------|-------------|------------|--------------|--|--|
| | | | | | Y-2N Series | | | Y-N Series | | L-N S | Series | | |
| Size | e (wi | dth × height) | mm | 64×60 | 85×75 | 100×85 | 82×82 | 102×102 | 122×122 | 80×80 | 110×110 | | |
| Мо | del n | ame | | YR-206NRI | YR-208NRI | YR-210NRI | YR-8NRI | YR-10NRI | YR-12NRI | LR-80NRI | LR-110NRI | | |
| Operation principle | | | | Rectifier | | | Rectifier | | Red | tifier | | | |
| Accuracy (grade) | | | | | 2.5 | | 2 | .5 | 1.5 | 2.5 | 1.5 | | |
| Sca | Scale length (mm) | | | 55 | 70 | 85 | 70 90 100 | | | 124 | 175 | | |
| tion | | Indicator rating | Delivery period | | | Consumpt | ion current, cons | umption VA, or vo | oltage drop | | | | |
| and delivery period classification | | 200, 300μA | Δ | _ | 1.7 | 7V | 1.7V | | 1.7V | _ | | | |
| class | Ħ | 500μA, 1, 3, 5mA | Δ | 1.4V | 1.4 | 1.4V | | 4V | 1.4V | 1. | 4V | | |
| io | current | 10, 20, 30, 50, 75mA | Δ | 1.2V | 1.2V | | 1.2V | | 1.2V | 1.3 | 2V | | |
| уре | AC CL | 100, 200, 500mA | Δ | 0.06VA | 0.06VA | | 0.06VA | | 0.06VA | 0.06VA | | | |
| eliver | ₹ | 1, 3A | 0 | 0.06VA | 0.00 | 6VA | 0.06VA | | 0.06VA | 0.06VA | | | |
| ab br | | 5, 10, 15, 20A | 0 | 0.1VA | 0.1 | VA | 0.1 | VA | 0.1VA | 0.1VA | | | |
| ng ar | <u>e</u> | 5, 10, 30, 50V |) | 4 4 | 4 | - ^ | 1 | nA | 1mA | 1 | nA | | |
| ratii | Itaç | 9 5, 10, 30, 50V | | " | пА | Ima | " | пА | | | | | |
| Indicator rating | \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ | 150V | | | | | Ο Δ | | | | | | |
| lndj | 3 | | IA | 2mA | | 2mA | 2mA | | | | | | |
| Page | e with | outer dimensions dra | awing | | 35 | | | 36 | | | 37 | | |


Remarks (1) Industrial quantity detectors are to be prepared by the customer.


(2) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification

| | Symbol | ⊚Standard | OQuasi-standard | ∆Special | | |
|--|---------------------------|--------------------|-----------------|---------------|--|--|
| | | product | product | product | | |
| | Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |

■Connection examples








Note 1. Use a shielded wire or twisted wire for connectiing the transducer or other components to the indicator.

Scale units of receiving indicators (representative examples)

| Element | Scale | units | Element | Scale | units | | Element | Scale units | Element | | Scale units | | |
|---------------|------------|-------|----------------|------------|-----------------------|--------|-------------|-------------|---------------|---------------|-------------|---------------|-------|
| DC/AC current | AC augment | | A kA | | Active power | kW | MW | | Percent | % | Speed | meters/minute | m/min |
| DC/AC current | А | KA. | Active power | KVV | IVIVV | Te | emperature | °C | Speed | meters/second | m/s | | |
| DC/AC valtage | V | kV | Desetive newer | lavor | Mvar Length centimete | | centimeters | cm | Revolutions | | min-1 | | |
| DC/AC voltage | V KV | | Reactive power | kvar | ivivar | Length | meters | m | Pressure | | MPa | | |
| F | | | Danier factor | | - / | \A/-: | kilograms | kg | | Flow rate | L/min | | |
| Frequency | Н | IZ | Power factor | $\cos\phi$ | | Weight | tons | t | Concentration | | ppm | | |

Models with various types of units besides the above can also be manufactured.

■Ordering method





Indicators with Changeover Switch

AC ammeters

Using AC ammeters with changeover switches, the currents of the respective phases of a 3phase, 3-wire system (or 1-phase, 3-wire system) circuit can be measured by a single meter.

• Equipped with a protective circuit to protect the CT secondary circuit.





YR-8UNAA YR-10UNAA ■Specifications

| | | Size (width X h | eight) mn | n | 82> | <99 | 102> | <119 | 122> | ×139 | | |
|-----------|----------------------------|------------------------|--|----------------|----------|-------------------|----------|-----------|-----------|----------|--|--|
| | | Model name | | | YR-8l | JNAA | YR-10 | UNAA | YR-12UNAA | | | |
| | | Operation princ | iple | | | Rectifier (movabl | Rec | Rectifier | | | | |
| | | Accuracy (grade | e) | | 2. | 2.5 2.5 1.5 | | | | | | |
| | | Frequency | | | | | 50 and | d 60Hz | | | | |
| | | Scale length | (mm |) | 7 | 0 | 9 | 0 | 10 | 00 | | |
| | | Weight | (kg |) | 0. | .2 | 0.3 | 25 | 0 | .4 | | |
| ation | | Terminal configuration | Maximum scale | Consumption VA | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | | |
| ssifica | | | 1A | | Δ | Δ | Δ | Δ | Δ | Δ | | |
| od cla | | | 5A | 0.2 | 0 | 0 | 0 | 0 | 0 | Δ | | |
| y peri | Direct | 4-terminal | 10A | 0.2 | Δ | Δ | Δ | Δ | Δ | | | |
| eliver | Direct Combined a with CT | 4-terminai | 15A | | Δ | Δ | Δ | | | | | |
| and d | | | 20A | 0.3 | Δ | Δ | Δ | Δ | Δ | _ | | |
| ating | | | 30A | 0.3 | Δ | Δ | Δ | Δ | Δ | | | |
| Indicator | Combined with CT | 3-terminal Note 2 | /5A (indicator rating: 5A) /1A (indicator rating: 1A) | 1.5 | 0 | 0 | 0 | 0 | 0 | 0 | | |


Note 1. With YR-8UNAA and 10UNAA, the 3-terminal-combined-with-CT model is of the movable iron core type. Note 2. The 4-terminal configuration can be manufactured for models combined with CT. Please designate as "4-terminal." However, the operation principle will be the rectifying type.

Remarks (1) A switch nameplate for 1-phase, 3-wire systems can be manufactured. Please specify "with 1-3 nameplate.

Nameplate examples: OFFRNS OFFRNT Make sure to specify the indication contents when ordering.

- (2) Expanded scale refers to scales expanded three-fold.
- (3) Supplementary anti-corrosion treatment is not possible
- (4) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Outer dimensions

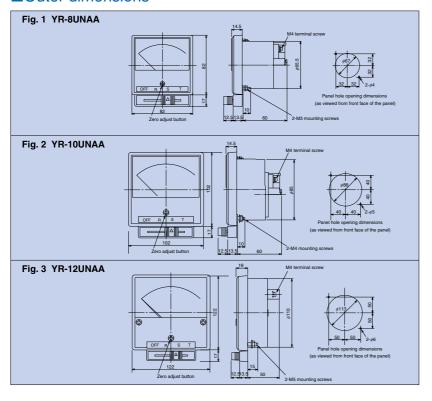

■Connection diagrams

Symbol

Reference delivery period

Delivery period classification

product

Immediate delivery

Standard Ouasi-standard


product

Within 20 days

△Special


product

21 to 60 days

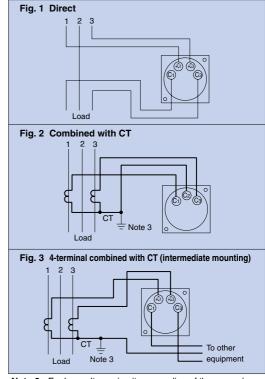

Note 3. For low-voltage circuits, grounding of the secondary side of the current transformer is unnecessary

Ordering method



AC voltmeters

■Specifications

Using AC voltmeters with changeover switches, the voltages between the respective wires of a 3-phase, 3-wire system (or 1-phase, 3-wire system) circuit can be measured by a single meter.

• Equipped with a protective circuit to protect the VT secondary circuit.





YR-8UNAV

YR-10UNAV

| | - | | | | | | | | | |
|---------|----------------------------------|------------------------------|-----------------|-----|----------|--------------------------------|-----------|--|--|--|
| | | Size (width × height) | mm | | 82×99 | 102×119 | 122×139 | | | |
| | | Model name | | | YR-8UNAV | YR-10UNAV | YR-12UNAV | | | |
| | | Operation principle | | | | Rectifier | | | | |
| | | Accuracy (grade) | | | 2.5 | 2.5 | 1.5 | | | |
| | | Frequency | | | | 50 and 60Hz | | | | |
| | Scale length (mm) | | | | 70 | 90 | 100 | | | |
| | Weight (kg) | | | | 0.15 | 0.2 0.4 | | | | |
| ation | | Maximum scale Consumption VA | | | | Delivery period classification | | | | |
| ssifice | Direct | 150V | 150V | | 0 | 0 | 0 | | | |
| od cla | Direct | 300V | | 1.2 | © | © | © | | | |
| / peri | | 600V | | 2.4 | 0 | 0 | 0 | | | |
| eliver | Direct Direct Combined with VT | VT ratio | Scale | | | | | | | |
| andd | | 440/110V | 0-600V | 0.5 | 0 | 0 | 0 | | | |
| ating | with VT | 3300/110V | 0-4500V | 0.5 | | | | | | |
| ator | Wiul VI | 6600/110V | 0-9000V | | | | | | | |
| 를 | | hesides the above □110V | VT ratio X 150V | 0.5 | 0 | 0 | 0 | | | |


Remarks (1) In the case of a 1-phase, 3-wire system circuit (100/200V), use a model rated at 300V direct.

- (2) A switch nameplate for 1-phase, 3-wire systems can be manufactured. Please specify "with 1-3 nameplate."
 - Nameplate examples: OFF R-N N-S R-S OFF R-N N-T R-T Make sure to specify the indication contents when ordering.
- (3) Supplementary anti-corrosion treatment is not possible.
- (4) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Symbol | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |

■Outer dimensions

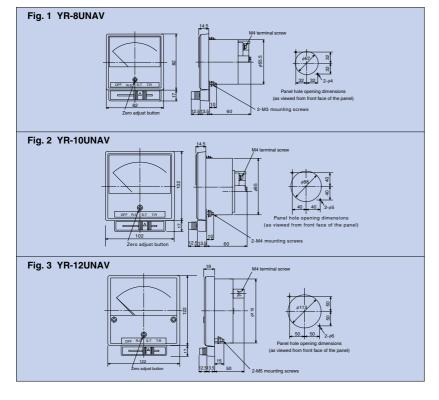


■Connection diagrams

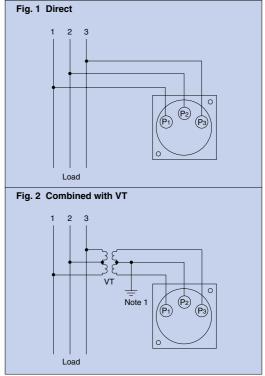

Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

■Ordering method





Mechanical Demand Meters

Demand meters measure electricity demand and have marker needles that display the maximum and/or minimum values measured.




LB-11ZNAA (AC current demand meter with max. value marker needle)



LB-11ZRMNAA (AC current demand meter relay)

Telemetry measurement (remote measurement) is possible

Receiving indicators can be combined with various transducers to perform remote measurement.



Terminal cover (standard equipment)

Conducting parts are protected to prevent electrical shock.




| | | Demand meters | | | | | Demand meter relays |
|-----------------------|-----------------|------------------------|-----------|---|---|---|---|
| | | With max. value needle | | With max. and min. value marker needles | With max. value marker needle and instantaneous meter | With max. and min. value marker needles and instantaneous meter | With max. value marker needle and instantaneous meter, with alarm setting needle |
| Appearance | | 150 200 A a | | 500 2000 | 300 400 200 500 0 500 0 0 0 0 0 0 0 0 0 0 0 0 0 0 | 9000 - | 40 80 100 - 100 |
| Size (width × height) | | 80×80 | 110×110 | 110×110 | 110×110 | 110×110 | 110×110 |
| AC ammeters | | LB-8ZNAA | LB-11ZNAA | _ | LB-11ZRNAA | _ | LB-11ZRMNAA |
| AC voltmeters | | LB-8ZNAV | LB-11ZNAV | _ | _ | LB-11YRNAV | _ |
| Wattmeters | 1-phase, 2-wire | _ | LB-11ZNW | LB-11YNW | LB-11ZRNW | LB-11YRNW | _ |
| | 1-phase, 3-wire | | | | | | |
| | 3-phase, 3-wire | | | | | | |
| | 3-phase, 4-wire | | | | | | |
| Receiving indicators | | | LB-11ZNRI | LB-11YNRI | LB-11ZRNRI | LB-11YRNRI | _ |

Demand meter needles



- Min. value marker needle (green)
- Driving needle (black)
- Max. value marker needle (red)
- Zero adjuster (driving needle)
- Manual marker needle reset button
- Instantaneous meter needle (black)

Demand meter relay needles

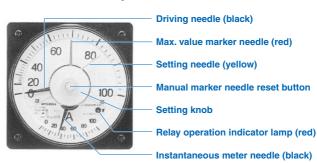

Mechanical Demand meter and demand meter relay usage precautions

- (1) Precautions concerning overload As malfunctions may occur when an overload input is applied continuously, select a rating that does not cause the demand meter indicator to exceed the scale.
- (2) Instantaneous meters do not have a zero adjuster (when combined with an indicator). In addition, demand meter relays do not have a zero adjuster for either demand meters (driving needle) or instantaneous meters.
- (3) Although the demand-meter-relay alarm setting needle (yellow) follows the driving needle (black), when the driving needle exceeds the preset alarm value, the alarm setting needle returns to the original state (setting value) when the driving needle returns to the alarm setting value or less.
- (4) The demand-meter-relay contact output turns off regardless of the state when the auxiliary power supply is interrupted and returns to normal operation immediately after power is restored.

- (5) When transporting a demand meter relay, make sure to move the setting needle (yellow) to 70% or more of the maximum scale value.
 - (The contact adjustment value may change or a malfunction may occur due to vibration or shock during transport if the needle is close to the zero point.)
- (6) When the ambient temperature changes suddenly, the zero point of the demand meter may change (1 to 2mm) temporarily. However, this will return to normal after a few hours.
- (7) To reset electromagnetic marker needles, use a switch that "opens" when released. In addition, set the duration of electricity supply to the reset terminal to within five seconds. The maximum/minimum value marker needles can be moved to the position of the driving needle manually or by resetting the electromagnetic marker needle.

AC ammeters/AC voltmeters

- ●AC ammeters Time intervals: 2, 5, 10 and 15 minutes (LB-8ZNAA: 2 and 15 minutes)
 - The demand current and instantaneous current can be measured and maximum demand current can be recorded. AC ammeters can also be used for load monitoring; for example, monitoring the load of voltage transformers or feeders.

●AC voltmeters Time interval: 2 minutes

The average and instantaneous voltages can be measured, and maximum and minimum voltages can be recorded. AC voltmeters can also be used to monitor voltage fluctuation in low-voltage bus lines and high-voltage circuits.



I R-117RNΔΔ (with max, value marker needle and instantaneous meter)



I R-11YRNAV (with max, and min, value marker needles and instantaneous meter)

■Specifications


| I | Indicator ty | pe AC ammeters | | | | | | AC voltmeters | | | | | | | |
|-----------------------------------|--------------|------------------|-----------------|-----------|--------|---------|---------|---------------|------------|--------|---------|-------------------|--------------------------|------------------------|-----------|
| | Model nam | ne | LB-8 | LB-11ZNAA | | | | L | LB-11ZRNAA | | A | LB-8ZNAV | LB-11ZNAV | LB-11YRNAV | |
| | Marker | Max. value | (| • | | (| • | | | • | | | • | • | • |
| Needles | needles | Min. value | - | _ | | - | _ | | | _ | _ | | _ | _ | • |
| | Instantan | eous meter | - | _ | | - | _ | | | | | | _ | _ | • |
| Оре | eration prir | ciple | | Bimetal (| Rectif | iying i | nstant | taneo | us me | ter) | | | Bimetal (| Rectifying instantaneo | us meter) |
| Accuracy (driving needle) (grade) | | | 2.5 1. | | | | .5 | | | | 2.5 | 1 | 1.5 | | |
| Scale | | | | 107 1 | | | | 50 107 | | | 107 | 15 | 50 | | |
| length (mm) | Instantan | eous meter | _ | | | | | 5 | 0 | | _ | _ | 50 | | |
| Ir | ndicator rat | ing | 5A, 50 and 60Hz | | | | | | | | | 150V, 50 and 60Hz | | | |
| Tim | ne interval | (min) | 2 | 15 | 2 | 5 | 10 | 15 | 2 | 5 | 10 | 15 | 2 | 2 | 2 |
| Consumption | Main indic | ator unit (VA) | 4 | 9 | 4 | 8.5 | 9 | 9 | 4.5 | 9 | 9.5 | 9.5 | 4 | 4 | 4.5 |
| VA Electromagnetic reset (VA) | | netic reset (VA) | appr | ox. 15 | | appı | rox. 5 | | | appr | ox. 5 | | approx. 15 | approx. 5 | approx. 5 |
| Marker needle reset | | | | | Man | ual ar | nd elec | ctroma | agneti | c rese | et (ele | ctrom | agnetic reset rating: 10 | 00-110VAC/DC ±10%) | |
| Weight (kg) | | | 1 | .3 | 1.4 | | | 1.5 | | | 1.3 | 1.4 | 1.8 | | |
| Delivery period classification | | | | Δ | | (| С | | | |) | | Δ | 0 | 0 |

- Remarks (1) The instantaneous meter of the AC ammeter has an ordinary scale.
 - (2) The scale of the instantaneous meter of the AC voltmeter is magnified for the rated voltage range from approx. 80V to 150V.
 - (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | ∆Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

Outer dimensions

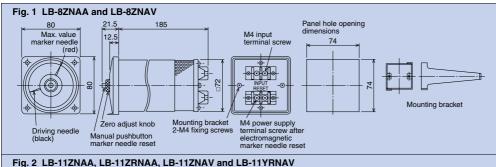


Max. value marker needle (red)

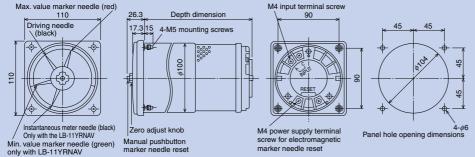

| ●Depth | AC | ammeters | | AC voltmeters | | | | |
|-----------|---------------|-----------|------------|---------------|-----------|------------|--|--|
| dimension | Time interval | LB-11ZNAA | LB-11ZRNAA | Time interval | LB-11ZNAV | LB-11YRNAV | | |
| | 2min/15min | 175 | 195 | Omin | 175 | 005 | | |
| | 5min/10min | 202 | 225 | 2min | 1/5 | 225 | | |
| | | | | | | | | |

■Connection diagrams

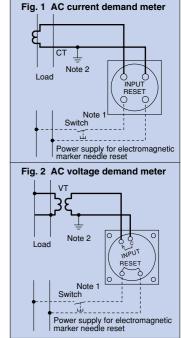

- Connect if an electromagnetic Note 1. marker needle reset circuit is to be provided. Additionally, use a switch that "opens" when released.
- For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

■Ordering method

The items in must be specified Number of Cover type Special specifications
Colored lines, colored units Model name Time interval CT ratio or VT ratio LB-11ZNAA 2M 0-200A 200/5A bands, etc



Specifications

Mechanical Demand Meters

Wattmeters/Receiving indicators

- ●Wattmeters Time intervals: 2 and 15 minutes
- •The electricity demand, instantaneous electricity and maximum electricity demand can be recorded. In addition, wattmeters can be used to monitor transformer load and electricity.
- Receiving indicators Time intervals: 2 and 15 minutes
 - Receiving indicators are used in combination with various electrical transducers or instrumentation transducers, such as those for measuring temperature, to perform telemeter measurements (remote measurement).



LB-11YRNW (with max. and min. value marker needles and instantaneous meter)



LB-11YNRI (with max. and min. value marker needles)

| | Indicator ty | rpe | | | | Watte | meters | | | | | Receiving indicators | | | | | | | |
|--------------|---------------------------|---------------------------------------|--------------------------------------|-----------------|-----------|---------------------|---------------------------|----------------|-----------------|----------------------|------|---------------------------------|------------|-----------|-----------|-----------|----------|----------|------|
| | Model nan | | LB-11ZNW LB-11YNW | | | LB-11ZRNW LB-11YRNW | | | v | LB-11 | ZNRI | | 1YNRI | LB-11 | | LB-11 | YRNRI | | |
| | Marker | Max. value | • | • | | • | • | • | | • | | • | | | • | | • | | • |
| Needles | needles | Min. value | _ | _ | | | _ | | | • | | _ | _ | • | | _ | _ • | | • |
| | Instantane | eous meter | _ | _ | - | _ | • | | | • | | _ | _ | - | _ | | • | | • |
| 0 | peration pri | nciple | Bin | netal (M | ovable co | oil instan | taneous r | neter) · | + trans | ducer | | | Bime | etal (Mov | able coil | instanta | neous n | neter) | |
| Accuracy | y (driving nee | edle) (grade) | | | | 1 | .5 | | | | | | | | 1 | .5 | | | |
| | Frequenc | :y | | | | 50 an | d 60Hz | | | | | | | | _ | _ | | | |
| Scale length | Demar | nd meter | | | | 1: | 50 | | | | | | | | 15 | 50 | | | |
| (mm) | Instantane | eous meter | | - 50 | | | | | - 50 | | | | | | | | | | |
| Ti | ime interval | (min) | 2 | 15 | 2 | 15 | 2 | 15 | 2 | 15 | | 2 | 15 | 2 | 15 | 2 | 15 | 2 | 15 |
| Phase- | In | put | Indicator rating (Po) | | | | | Consumption VA | | | | | | | Indicate | or rating | | | |
| wire | | , , , , , , , , , , , , , , , , , , , | maioator rating (r o) | | | Voltage circ | Voltage circuit I1, I3 I2 | | | | | | | | | | | | |
| 1-phase | 110\ | / 5A | | 0.4~0 |).6kW | | 3 | 3 | 3.2 | _ | _ | | | | | | | | |
| 2-wire | 220\ | / 5A | | 0.8~1 | I.2kW | | 6 | | 3.2 | | | | | | | | | | |
| 3-phase | 110\ | / 5A | | 0.8~1 | I.2kW | | 3 | | 3.2 | | _ | | | | | | | | |
| 3-wire | - | / 5A | | 1.6~2 | 2.4kW | | 6 | 3 | 3.2 | _ | _ | 1mA DC Internal resistance: 1kΩ | | | | | | | |
| 3-phase | $\frac{110}{\sqrt{3}}/11$ | | | 0.8~1 | I.2kW | | 1 | 1 | .2 | 2.4 | _ | | | | | | | | |
| 4-wire | 110/19 | 0V 5A | | 1.4~2 | 2.0kW | | 1.5 | 1 | .2 | 2.4 | | | | | | | | | |
| | | 80V 5A | | 2.8~4 | 1.0kW | | 1.5 | 1 | .2 | 2.4 | | | | | | | | | |
| Ma | arker needle | reset | I | | | | etic reset | ` | | etic rese | t ra | ting: 100 |)-110VA | | | | | prox. 5V | 4 |
| Accessories | Mode | l name | T-150 rectifier/T-150LB DC amplifier | | | | | | | T-150LB DC amplifier | | | | | | | | | |
| | Auxiliary p | ower supply | 110\ | / AC +10 c | %; 50 and | d 60Hz; | consumpt | ion VA: | appro | k. 12VA | | 110V | / AC +10 c | %; 50 an | d 60Hz; | consump | tion VA: | approx. | 12VA |
| Mai | in body wei | ght (kg) | 1. | .2 | 1 | .4 | 1.4 | 1 | | 1.5 | | 1. | .2 | 1 | .4 | 1 | .4 | 1 | .5 |
| Deliver | ry period cla | ssification | | Δ | | Δ | Δ | | | Δ | | Δ | 7 | | Δ | | 7 | 1 | Δ |


Remarks (1) Refer to the "Wattmeter Scale Selection Reference Table" (p.56) regarding the manufacturable maximum scale value of a wattmeter.


(2) The T-150 rectifier and T-150LB DC amplifier are dedicated accessories (non-compatible). They can only be used in combination with the indicators specified. The distance between the indicator and the T-150LB DC amplifier/T-150 rectifier must be 5m or less, or the round trip lead wire resistance must be 0.50 or less. **Delivery period classification**

| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |


- (3) Wattmeters cannot be manufactured with both positive and negative readings on the scale.
- For receiving indicators with a positive/negative scale, use a transducer to convert positive/negative input to positive output (e.g., convert input of -1,000 to 0 to +1,000W to output of 0 to 0.5 to 1mA).
- (4) For scales that measure in electrical units (A, V, W, var, cosø, Hz), AC/DC and three-phase circuit symbols are not displayed. For receiving indicators, the symbol for the quantity to be input is displayed.
- (5) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Outer dimensions

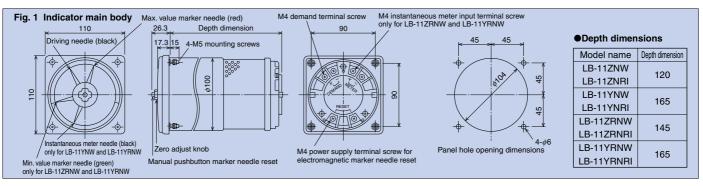




■Outer dimensions of accessories

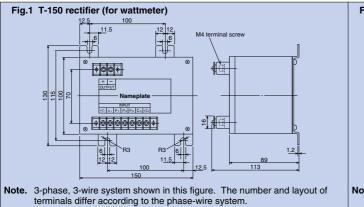

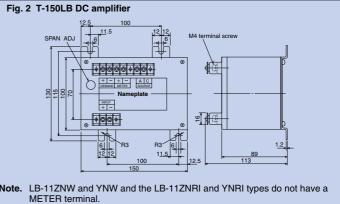


■Wattmeter connection diagrams

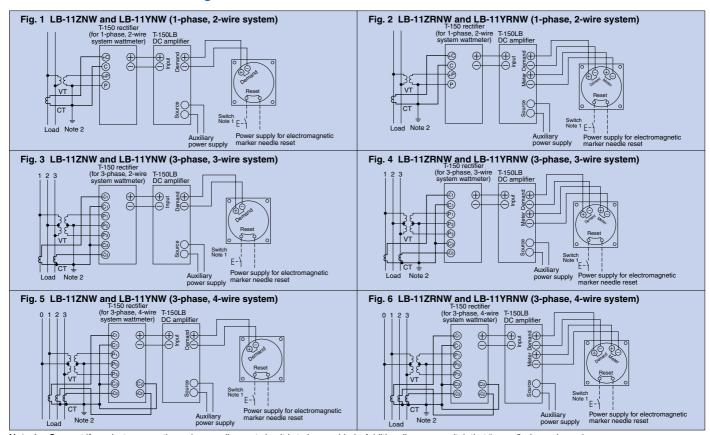



Note 1. Connect if an electromagnetic marker needle reset circuit is to be provided. Additionally, use a switch that "opens" when released.

Note 2. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

■Connection examples of receiving indicators







Note 1. Connect when an electromagnetic reset circuit is installed. Additionally, use a switch that opens when disconnected.

Note 2. For low-voltage circuits, secondary-side connections of current transformers/meter transformers are not required.



Mechanical Demand Meter Relays

AC ammeters


Time intervals: 10 and 15 minutes; the 10-minute model complies with the Fundamental Specifications for Electrical Construction of the Ministry of Land, Infrastructure, Transport and Tourism of Japan.

- These indicators are used to measure electricity demand and have a marker needle that displays the maximum value measured, which is used to output an alarm signal.
- ●AC ammeters can be used to measure electricity demand such as at electric power substations.
- Provided with relay operation indication (LED).

60 80 40 100

LB-11ZRMNAA

■Specifications ■ Needle and relay contact operations



| Needle state | State of contacts |
|--|-------------------|
| When the driving needle is at or below the setting needle. | a b c |
| When the driving needle pushes the max. value marker needle up and reaches the setting needle. | a b c |
| When input decreases and the driving needle drops to or below the setting needle. | a b c |


Remarks The indicator lamp (red LED) lights up when the relay contacts a-c are ON.

| Indicator type | | | type | AC am | meters | | | |
|--------------------------------------|----------------------------|-----------|--------------------|---|----------------------|--|--|--|
| | | Model n | <i>'</i> ' | | RMNAA | | | |
| | | | ue marker needle | • | | | | |
| Ne | Needle Instantaneous meter | | | • | | | | |
| | Operation principle | | | Bimetal (Rectifying i | nstantaneous meter) | | | |
| | • | curacy (| · · | | .5 | | | |
| | cale | | nand meter | 14 | 45 | | | |
| | ngth nm) | Instant | aneous meter | 5 | 0 | | | |
| Indicator rating | | | rating | 5A, 50 and 60Hz | | | | |
| Time interval (min) | | | al (min) | 10 | 15 | | | |
| Consumption Main indicator unit (VA) | | | dicator unit (VA) | 1 | 0 | | | |
| , | VA | Electrom | agnetic reset (VA) | Ę | 5 | | | |
| | Mar | ker need | dle reset | Manual and electromagnetic reset (electromagnetic reset rating: 100-110VAC/DC ±10%) | | | | |
| | | Output | t signal | No-voltage C contact (sustained output/built-in auxiliary relay) | | | | |
| <u>.=</u> | (| Operatio | n method | Needle passing contact method (with red LED operation indicator) | | | | |
| Relay unit | | Setting | g range | 25 to 100% of maximum scale value | | | | |
| lela | | Setting a | accuracy | ±1.5% (with respe | ect to scale length) | | | |
| <u> </u> | Co | ntact | Resistive load | 250VAC 3A, | 100VDC 0.2A | | | |
| | capacity Inductive load | | | 250VAC 1A, 100VDC 0.15A | | | | |
| | Auxiliary power supply | | | 100-110VAC/DC ±10% consumption VA: 1VA | | | | |
| | Weight (kg) | | | 2.5 | | | | |
| Delivery period classification | | | classification | 0 | 0 | | | |


Delivery period classification

| Donvery per | iou oiucoiiic | auon | | |
|--|---------------|-----------------|---------------|--|
| Symbol | ⊚Standard | OQuasi-standard | △Special | |
| Syllibol | product | product | product | |
| Reference delivery period Immediate delivery | | Within 20 days | 21 to 60 days | |

Outer dimensions

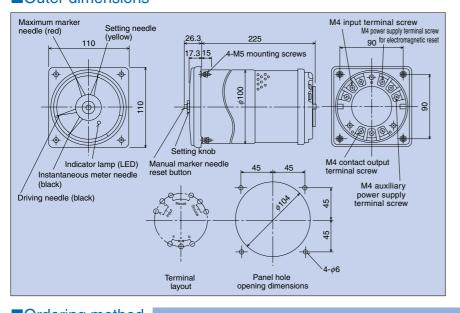

■Connection diagram



Note 1. Connect if an electromagnetic marker needle reset circuit is to be provided. Additionally, use a switch that "opens" when released.

Note 2. For low-voltage circuits, grounding of the

secondary side of the current transformer is unnecessary.

■Ordering method


The items in must be specified. Number of Special specifications
Colored lines, colored bands, etc. Indicator rating Model name Time interval CT ratio Cover type units LB-11ZRMNAA 5A 10M 0-200A 200/5A В 3




Demand Meters/Demand Meter Relays

■Time interval and indications of demand meters

●The time interval (to) of a demand meter refers to the time required for an indicated value (lo) to indicate 95% of a fixed input (I) when the input (I) is supplied continuously. Additionally, for 100% of the input (I) to be indicated, a time of approximately 3 times the time interval (to) is required.





- •For mechanical demand meters or demand meter relays, a coiled bimetal is heated by the input current and the thermal change of the bimetal is used for the indication (bimetal). The indicated value is the effective value of the input.
- •For electronic demand meters or demand meter relays, the same characteristics are realized via computation using a microcomputer.

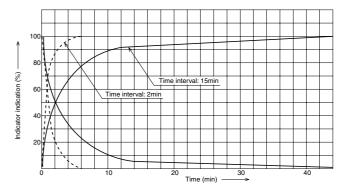

Indicated value of demand meters


- •As described above, demand meters operate over a comparatively long time, and unlike ordinary indicators, they are not directly influenced by factors such as short-time input fluctuations and flicker. Demand meters basically indicate the average value (of demand) for load fluctuation within the time interval.
- The maximum and minimum value marker needles record the maximum and or minimum values indicated by the driving needle, enabling the past maximum demand values to be obtained.



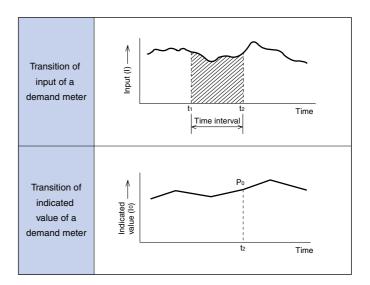

■Selecting the time interval of demand meters

• The time interval of a demand meter is selected according to the facility equipment to be monitored and the purpose of monitoring. (Demand meter selection example)

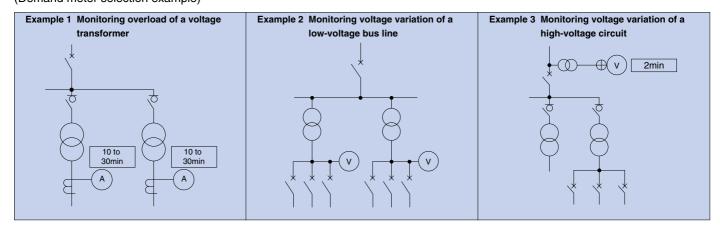

Meter Relays

Meter relays enable alarms to be issued and automatic control based on contact outputs at the same time as measurement of voltage, current and other items.





YR-210MRNAA

LR-11MRNAA

Sustained-output models covering the entire scale

Sustained-output needle-pass relays are incorporated, enabling output over the entire scale range to be covered.

100/200VAC switching auxiliary power supply

Can be used with either 100-110VAC or 200-220VAC.

Equipped with relay operation indication lamp

The operating state of the relay can be seen, even from a distance.

■Products list

| | | | | Ul | pper/Lowe | r-limit setting | | | Upper-lin | nit setting | | | |
|--------------------------|---|---|---------------------------|--|---|-----------------|-------------------|-----------------|------------------|-----------------|-----------------|--------|--|
| | | | | | Rectangular ind | icator | Wide-angle indi | icator | Rectangular ind | icator | Wide-angle indi | icator | |
| Size | e (wid | dth × | height) | mm | 100×83 | | 110×110 | | 100×83 | | 110×110 | | |
| Sca | ale lei | ngth | | (mm) | 72 | | 183 | | 72 | | 183 | | |
| | Indicator Operation principle | | Operation principle | Model name | Accessory | Model name | Accessory | Model name | Accessory | Model name | Accessory | | |
| DC | | Amr | meter | Movable coil | YM-210MRNDA | _ | LM-11MRNDA | _ | YM-210MRHNDA | _ | LM-11MRHNDA | _ | |
| О | Voltmeter | | meter | Movable coil | YM-210MRNDV | _ | LM-11MRNDV | _ | YM-210MRHNDV | _ | LM-11MRHNDV | _ | |
| | | Amr | meter | Rectifier | YR-210MRNAA | _ | LR-11MRNAA | _ | YR-210MRHNAA | _ | LR-11MRHNAA | _ | |
| | | Volt | meter | Rectifier | YR-210MRNAV | _ | LR-11MRNAV | _ | YR-210MRHNAV | _ | LR-11MRHNAV | _ | |
| | | | 1-phase 2-wire | | YM-210MRNW | T-150 | LM-11MRNW | T-150 | YM-210MRHNW | T-150 | LM-11MRHNW | T-150 | |
| | Watt | meter | 3-phase 3-wire | Transducer | YM-210MRNW | T-150 | LM-11MRNW | T-150 | YM-210MRHNW | T-150 | LM-11MRHNW | T-150 | |
| | | | 3-phase 4-wire | | YM-210MRNW | T-150 | LM-11MRNW | T-150 | YM-210MRHNW | T-150 | LM-11MRHNW | T-150 | |
| | Vor | neter | 3-phase 3-wire | Transducer | YM-210MRNVAR | T-150 | LM-11MRNVAR | T-150 | YM-210MRHNVAR | T-150 | LM-11MRHNVAR | T-150 | |
| AC | vaii | neter | 3-phase 4-wire | nansuucei | YM-210MRNVAR | T-150 | LM-11MRNVAR | T-150 | YM-210MRHNVAR | T-150 | LM-11MRHNVAR | T-150 | |
| | | | 3-phase 3-wire (balanced) | | YM-210MRNPF | T-100 | LM-11MRNPF | T-100 | YM-210MRHNPF | T-100 | LM-11MRHNPF | T-100 | |
| | Powe | ver factor meter 3-phase 3-wire (unbalanced) | | Transducer | YM-210MRNPFU | T-150 | LM-11MRNPFU | T-150 | YM-210MRHNPFU | T-150 | LM-11MRHNPFU | T-150 | |
| | | 3-phase 4-wire | | | YM-210MRNPFU | T-150 | LM-11MRPNFU | T-150 | YM-210MRHNPFU | T-150 | LM-11MRHNPFU | T-150 | |
| | Fre | equer | cy meter | Transducer | YM-210MRNF | T-100 | LM-11MRNF | T-100 | YM-210MRHNF | T-100 | LM-11MRHNF | T-100 | |
| R | Recei | ving i | ndicator | Movable coil | YM-210MRNRI | | LM-11MRNRI | _ | YM-210MRHNRI | _ | LM-11MRHNRI | _ | |
| | | | Outp | ut signal | Sustained output | | | | | | | | |
| | | | Operati | on method | Pointer passing type | | | | | | | | |
| | | 용 | | Туре | Upper limit (H): red; Lower limit (L): green Upper limit (H): red | | | | | | | | |
| | | Setting needle | Minimu | m setting width | | | | 5% of sc | ale length | | | | |
| _ | | ting | Setting ran | Upper limit | 5~100% | | 10~100% | | 5~100% | | 10~100% | | |
| nor | | Sel | | Lower limit | 0~95% 0~90% | | | | _ | | _ | | |
| Eo | l iil | | Pickı | up value | ±1.5% or less | | | | | | | | |
| Specifications in common | Relay unit | power supply | Ra | ted voltage | 100-110VAC/200-220VAC switching type | | | | | | | | |
| suc | Be | ower s | Allowable vo | oltage variation range | | | 100-11 | 0VAC terr | minal: 90-120VAC | | | | |
| cati | A Allowable voltage variation range | | | | 200-220 | OVAC term | ninal: 180-240VAC | | | | | | |
| ecifi | | Consumption VA Resistive load | | 3.6VA or les | ss | 4VA or less | 3 | 3.6VA or les | SS | 4VA or less | 3 | | |
| Spe | | | | Resistive load | 250VAC 3A | 4 | 250VAC 3A | 4 | 250VAC 3A | 4 | 250VAC 3A | 4 | |
| | Contact capacity Resistiv | | | 30VDC 3A, 100VD | C 0.2A | 30VDC 3A, 100VD | C 0.2A | 30VDC 3A, 100VD | C 0.2A | 30VDC 3A, 100VD | C 0.2A | | |
| | | | | Inductive load | 250VAC 2A | 4 | 250VAC 0.3 | Α | 250VAC 2A | 4 | 250VAC 0.3 | A | |
| | Contact configuration | | | Upper limit (H), lower limit (L): no-voltage C contacts Upper limit (H): no-voltage C contact | | | | | | | | | |
| | Withstand voltage (between terminal and case) | | | 2210VAC, 5sec (between input terminal and relay contact terminal: 1200VAC, 1min) | | | | | | | | | |
| | Usage temperature range | | | | | -5°C | ~50°C (re | ference: 23°C) | | | | | |

■Operation principles


Non-contact detection

Non-contact detection occurs when the needle reaches the meter relay pick-up value or drop-out value, and is based on changing to the state where the light beam is shielded. For this reason, a protective plate is attached to the needle axis.

Switching circuit/Output relay section

The signal from the non-contact detection section is amplified via the switching circuit, activating the output relay.


Names of components

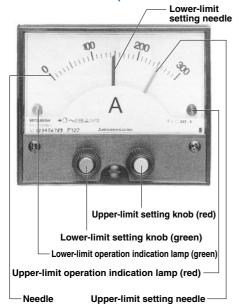


•Upper/Lower-limit operation indication light.

This light turns on as soon as the value set as the upper/lower-limit is reached and stays lit as long as this state is maintained.


Needle position and output relay operation

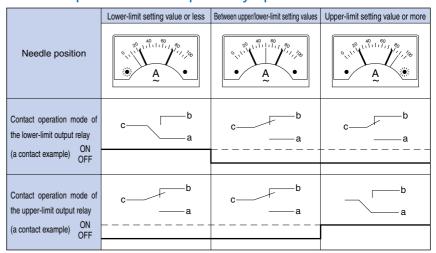

Remarks The needle position across the entire scale can be indicated by combining the contacts of the lower-limit and upper-limit output relays as shown in the diagram below.



■Outer dimensions

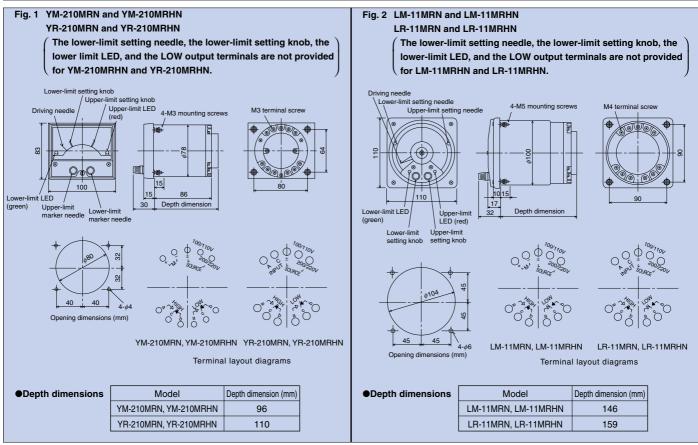

Note 1. A cover with red needle cannot be manufactured

Meter Relays

DC ammeters





YM-210MRNDA

LM-11MRNDA

■Specifications

| | | | | Rectangular | indicators | Wide-angle indicators | | | |
|--------------------------|---------------------|-------------|-----------------|---------------------------|----------------------------------|---|----|--|--|
| | | | | Upper/Lower-limit setting | Upper-limit setting | Upper/Lower-limit setting Upper-limit setting | | | |
| Size (width × height) mm | | | mm | 100× | (83 | 110×110 | | | |
| Model name | | | | YM-210MRNDA | YM-210MRHNDA | LM-11MRNDA LM-11MRHNDA | | | |
| Operation principle | | | | Movabl | e coil | Movable coil | | | |
| Accuracy (grade) | | | | 2.5 | 5 | 1.5 | | | |
| Scale length (mm) | | | (mm) | 72 | | 17 | 5 | | |
| Weight (kg) | | | (kg) | 0.7 | 7 | 1.0 | 8 | | |
| | Maximum | scale value | Delivery period | | Internal resistance (Ω) | or consumption current | | | |
| rating | | 1mA | 0 | 709 | Ω | 650Ω | | | |
| | Direct | 10mA | 0 | 3Ω | 3Ω | | 7Ω | | |
| Indicator | Direct | 20mA | 0 | 2.5Ω | | 10Ω | | | |
| Indi | | 1, 3, 5A | 0 | 60mV(10mA) | | 100mV(10mA) | | | |
| | Combined with shunt | 1~7500A | 0 | 60mV(1 | 0mA) | 100mV(10mA) | | | |

Note 1. In the case of combined use with a shunt, please refer to the table below and specify the lead wire thickness and one-way length or the round trip resistance.

- **Remarks** (1) In the case of a bidirectional deflection indicator, determine the specifications according to the following.
 - In the case of a direct rating model, manufacture is possible if the larger of the right and left scales is 5A or less.
 - In the case where a shunt is externally attached, determine the scale so that the sum of the absolute values of the indicator ratings is 60mV or more for YM-210MRN and 100mV or more for LM-11MRN.

Example: In the case of a shunt rating of 500A and 60mV

Ammeter scale -500~0~+500A

Ammeter rating -60~0~+60mV (sum of absolute values=120mV≥60mV)

(2) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Delivery period classification


| Svmbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

Table of maximum allowable values of lead wires for DC ammeter relay combined with shunt

| | DC ammeter relay combined with shunt | | | | | | | | | | |
|--------------|--------------------------------------|--|--|--|--|--|--|--|--|--|--|
| Model name | Indicator rating (mV) | Maximum allowable resistance value of lead wire (Ω) | | | | | | | | | |
| | 60 or more, less than 75 | 0.73 | | | | | | | | | |
| YM-210MRNDA | 75 or more, less than 100 | 1.16 | | | | | | | | | |
| YM-210MRHNDA | 100 or more, less than 150 | 1.88 | | | | | | | | | |
| | 150 or more | 3.33 | | | | | | | | | |
| LM-11MRNDA | 100 or more, less than 150 | 1.50 | | | | | | | | | |
| LM-11MRHNDA | 150 or more | 2.59 | | | | | | | | | |

Remarks (1) Refer to "DC ammeter combined with shunt" on p.44 regarding the round trip resistance according to the lead wire thickness and one-way length.

■Connection diagram




Lead wires for shunt connection

Lead wires for connecting an indicator with a shunt can be manufactured if specified.

The standard is: two 2mm² - 2m (one-way) 1500V heat-resistant vinyl wires (blue) for electric equipment.

Remarks (1) The customer is requested to prepare wires besides those of 2mm² cross-sectional area.

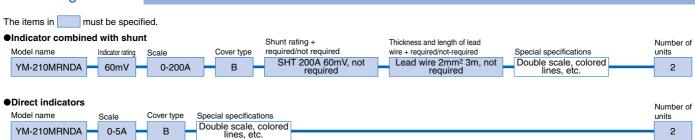

DC voltmeters





YM-210MRNDV

LM-11MRNDV

■Specifications

| | | | Rectangula | r indicators | Wide-angle indicators | | | | |
|-------------------------------------|--------------------|------|---------------------------|---------------------|---------------------------|---------------------|--|--|--|
| | | | Upper/Lower-limit setting | Upper-limit setting | Upper/Lower-limit setting | Upper-limit setting | | | |
| Siz | e (width × height) | mm | 100 | ×83 | 110×110 | | | | |
| Model name | | | YM-210MRNDV | YM-210MRHNDV | LM-11MRNDV LM-11MRHNDV | | | | |
| Ор | eration principle | | Movak | ole coil | Movable coil | | | | |
| Acc | curacy (grade) | | 2 | .5 | 1. | 5 | | | |
| Sca | ale length | (mm) | 7 | 2 | 175 | | | | |
| We | ight | (kg) | 0 | .7 | 1.8 | | | | |
| Maximum scale value Delivery period | | | | Consumpt | otion current | | | | |
| 1, 50, 100V 150, 300, 500V | | | 1n | nA | 1mA | | | | |


Remarks (1) If, with a maximum scale of 500V or less, an externally mounted multiplier is desired, the GR-2 multiplier can be attached as an accessory.


- (2) In the case of a bidirectional deflection indicator, manufacture is possible if the larger of the right and left scales is 500V or less.
- (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | ∆Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

■Connection diagram

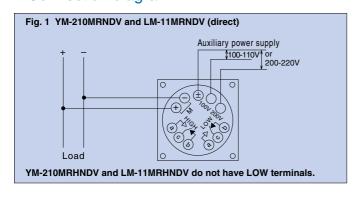

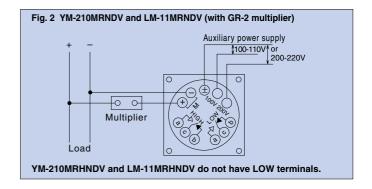

■Outer dimensions of accessory

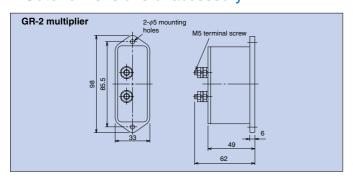



Meter Relays

AC ammeters





YR-210MRNAA

LR-11MRNAA

■Specifications

| | | | | | Rectangula | r indicators | | Wide-angle indicators | | | | | |
|---|---------------|-----------|-----------------------------|------------|-----------------|--------------|-------------|-----------------------|------------------|----------------|-------------|--|--|
| | | | | Upper/Lowe | r-limit setting | | nit setting | Upper/Lowe | r-limit setting | | nit setting | | |
| Size | e (width > | < height) | mm | 100×83 | | | | 110×110 | | | | | |
| Mod | del name | <u> </u> | | YR-210 | MRNAA | YR-210N | /IRHNAA | LR-11N | IRHNAA | | | | |
| Оре | eration pr | inciple | | | Rec | tifier | | | Rec | tifier | | | |
| Acc | uracy (gr | ade) | | | 2. | .5 | | | 1. | .5 | | | |
| Free | quency | | | | 50 and 60Hz | | | | | | | | |
| Sca | le length | | (mm) | | 7 | 2 | | 175 | | | | | |
| Cor | sumption | n VA | (VA) | | 0. | .2 | | 0.1 | (0.3 in the case | of expanded so | cale) | | |
| Wei | ght | | (kg) | | 0. | .7 | | | 1. | .8 | | | |
| ation | | Maximum | scale value | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | Ordinary | Expanded | | |
| Indicator rating and delivery period classification | Direct | 100 | , 200, 500mA | Δ | Δ | Δ | Δ | Δ | Δ | Δ | Δ | | |
| eriodo | Direct | | 1, 5, 10A | Δ | Δ | | | Δ | Δ | | Δ | | |
| very p | 5/5, 10 | | /5, 20/5, 30/5, 40/5, 60/5, | | | | | | | | | | |
| nd deli | 를 된 175/5, | | 150/5, 200/5, 250/5, | 0 | Δ | 0 | Δ | 0 | Δ | 0 | Δ | | |
| ting ar | E 300/5, 4 | | , 500/5 | | | | | | | | | | |
| ator ra | Combined with | Other | /5A (indicator rating 5A) | 0 | Δ | 0 | Δ | 0 | Δ | 0 | Δ | | |
| ig | tg Other 1/1/ | | /1A (indicator rating 1A) | Δ | Δ | Δ | Δ | Δ | Δ | Δ | Δ | | |


Remarks (1) The standard expanded scale is the 3x expanded scale. A 2x expanded scale and 5x expanded scale can also be manufactured.


- (2) Error may occur due to waveform distortion.
- (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Syllibol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

■Connection diagram

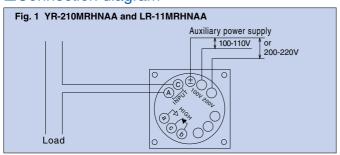


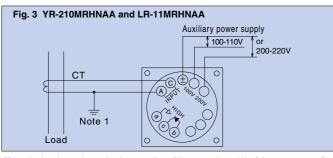

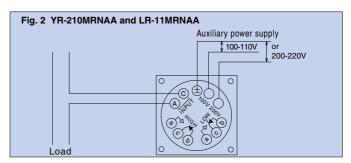

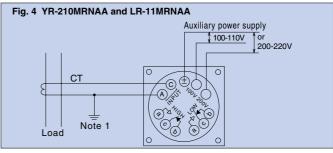

Note 1. In a low voltage circuit, grounding of the secondary side of the current transformer is unnecessary.



AC voltmeters





YR-210MRNAV

LR-11MRNAV

■Specifications

| | _ | | | | Rectangula | r indicators | | Wide-angle indicators | | | | | | |
|---|------------------|---------------|-----------------|--------------------------|--------------------------------|----------------|--------------------------------|-----------------------|--------------------------------|----------------|--------------------------------|--|--|--|
| | | | | Upper/Lowe | r-limit setting | | nit setting | Upper/Lowe | r-limit setting | | nit setting | | | |
| Size | e (wid | dth × height) | mm | | 100 | ×83 | <u> </u> | | 110> | K110 | <u> </u> | | | |
| Mod | del n | ame | | YR-210MRNAV YR-210MRHNAV | | | | LR-11N | MRNAV | LR-11M | IRHNAV | | | |
| Оре | eratio | on principle | | | Rec | tifier | | | Rec | tifier | | | | |
| Acc | urac | y (grade) | | | 2. | 5 | | | 1. | 5 | | | | |
| Free | quen | су | | | | | 50 and | l 60Hz | | | | | | |
| Sca | le le | ngth | (mm) | | 7 | 2 | | | 17 | 75 | | | | |
| Wei | ight | | (kg) | 0.7 1.8 | | | | | | | | | | |
| tion | | Maximum sca | ala valua | | | Consump | tion VA and deli | very period cla | ssification | | | | | |
| sifica | | Maximum Sca | ale value | Consumption VA | Delivery period classification | Consumption VA | Delivery period classification | Consumption VA | Delivery period classification | Consumption VA | Delivery period classification | | | |
| class | | 10, 30 |), 50V | 0.3VA | 0 | 0.3VA | | 0.1VA | | 0.1VA | 0 | | | |
| riod | Direct | 75, 1 | 100V | 0.5VA | 0 | 0.5VA | 0 | 0.1VA | | 0.1VA | | | | |
| ry pe | Ē | 15 | 0V | 0.6VA | 0 | 0.6VA | 0 | 0.15VA | 0 | 0.15VA | | | | |
| elive | 300V | | 0V | 1.7VA | | 1.7VA | 0 | 0.3VA | | 0.3VA | | | | |
| p D | B > VT ratio Sca | | Scale | | | | | | | | | | | |
| ng a | with | 440/110V | 0~600V | | | | | | | | | | | |
| r rati | ped | 3300/110V | 0~4500V | 0.6VA | 0 | 0.6VA | 0 | 0.15VA | 0 | 0.15VA | 0 | | | |
| Indicator rating and delivery period classification | Combined with VT | 6600/110V | 0~9000V | | | | | | | | | | | |
| Ind | ပိ | Other □/110V | VT ratio × 150V | | | | | | | | | | | |


Remarks (1) Error may occur due to waveform distortion.


(2) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Gyrribor | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

■Connection diagram

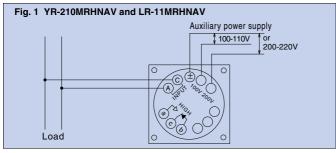


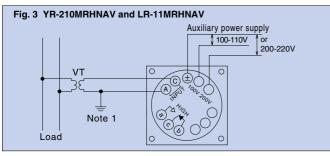

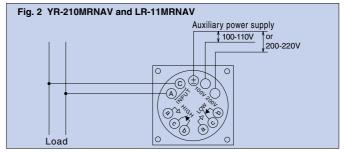

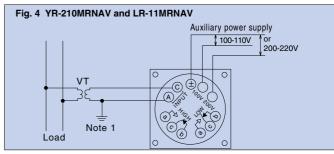

Note 1. In a low voltage circuit, grounding of the secondary side of the instrument voltage transformer is unnecessary.



Meter Relays

Wattmeters

Varmeters





YM-210MRNW

LM-11MRNW

■Specifications


| | _ | | | | | | | Wattn | neters | | | | | | | | | Varm | eters | | | | |
|---|-------------------|---------------------------------|--------------------------------|--------------------|-----------------|------------|------------------|--------------------|--------------------|--------------|-----------|-----------|--------------------|--------------------|--------------|------------------------------------|-----------|--------------------|-------------------------------|---------|-----------|-----------|--------------------|
| | | | | R | Rectang | jular in | dicator | s | ١ ١ | Vide-a | ngle in | dicator | S | P | Rectanç | gular in | dicator | s | ١ | Vide-ar | ngle in | dicator | S |
| | | | | Upper/Lov | ver-limit se | tting Up | per-limit | setting | Upper/Lov | ver-limit se | etting Up | per-limit | setting | Upper/Lov | ver-limit se | -limit setting Upper-limit setting | | setting | Upper/Lower-limit setting Upp | | per-limit | setting | |
| Size | e (wi | dth × height) | mm | | 1 | 00×8 | 3 | 110×110 | | | 100×83 | | | | 110×110 | | | | | | | | |
| Mar | del n | ama | | Y۱ | Л-210 | | YM-210 | | LM-11 | | LM-1 | 1 | Y۱ | YM-210 | | YM-2 | 10 | LI | M-11 | | LM-11 | | |
| IVIOC | JEI III | anie | | M | RNW | | MRHNW MRNW MRHNW | | | MR | NVAR | | MRHN | /AR | MF | NVAR | | MRHN | VAR | | | | |
| Оре | eratio | n principle | | | | • | | Trans | ducer | | | | | Transducer | | | | | | | | | |
| Acc | urac | y (grade) | | | 2.5 1.5 2.5 1.5 | | | | | | | | | | | | | | | | | | |
| Frequency | | | | | | | | | | | | | 50 and | d 60Hz | | | | | | | | | |
| Scale length (mm) | | | | | | 72 | | | 175 | | | | | | 72 | | | | 175 | | | | |
| Wei | ght | | (kg) | | | 0.7 | | | | | 1.8 | | | | | 0.7 | | | | | 1.8 | | |
| tion | | Ratir | ng | Cons | umptic | n VA | | , | Consumption | | n VA | _< | , | Cons | umptic | n VA | ~ | , | Cons | umptio | n VA | 7 | |
| ifica | Circuit | | Indicator | <u>e</u> + | Voltage | circuit | SSOI | ver) iod | <u>e</u> += | Voltage | e circuit | SSOI | ver) iod | ge It | Voltage | circuit | SSOI | ver) iod | et = | Voltage | circuit | SSOI | iod |
| Indicator rating and delivery period classification | Cir | Secondary rating | rating (Po) (kW or kvar) | Voltage circuit | l1 | l 2 | Accessory | Delivery period | Voltage circuit | lı | l2 | Accessory | Delivery period | Voltage circuit | 11 . | l2 | Accessory | Delivery period | Voltage circuit | lı | l2 | Accessory | Delivery period |
| erio | m | | , | | l3 | | <u> </u> | | | l3 | | | | | lз | | , | | | lз | | | |
| ery p | 1-phase 2-wire | 110V 5A | 0.4~0.6 | 3 | 3. | | T-150 | Δ | 3 | 3 | | T-150 | Δ | _ | _ | _ | _ | _ | _ | _ | _ | _ | |
| deli∨ | | 220V 5A | 0.8~1.2 | 6 | 3. | | | Δ | 6 | | .2 | | Δ | | | | | _ | | | | | |
| and | -phase 3-wire | 110V 5A | 0.8~1.2 | 1.5 | 1. | | T-150 | 0 | 1.5 | | .6 | T-150 | 0 | 1.5 | 1.2 | 2.4 | T-150 | 0 | 1.5 | 1.2 | 2.4 | T-150 | 0 |
| ting 8 | 3-E | 220V 5A | 1.6~2.4 | 3 | 1. | - | | 0 | 3 | | .6 | | 0 | 3 | 1.2 | 2.4 | | 0 | 3 | 1.2 | 2.4 | | 0 |
| or rat | Se | $\frac{110}{\sqrt{3}}$ /110V 5A | 0.8~1.2 | 1 | 1.2 | 2.4 | T-150 | Δ | 1 | 1.2 | 2.4 | T-150 | Δ | 1.5 | 1.2 | 2.4 | T-150 | Δ | 1.5 | 1.2 | 2.4 | T-150 | Δ |
| licat | 3-phase 4-wire | 110/190V 5A | 1.4~2.0 | 1 | 1.2 | 2.4 | T-150 | Δ | 1 | 1.2 | 2.4 | T-150 | Δ | 1.5 | 1.2 | 2.4 | T-150 | Δ | 1.5 | 1.2 | 2.4 | T-150 | Δ |
| n n | 3 | 220/380V 5A | 2.8~4.0 | 1 | 1.2 | 2.4 | T-150 | Δ | 1 | 1.2 | 2.4 | T-150 | Δ | — | - | _ | _ | _ | _ | _ | _ | _ | |


- Remarks (1) Refer to the "Wattmeter Scale Selection Reference Table" (p.54) concerning the manufacturable maximum scale value of a wattmeter relay.
 - (2) The varmeter relays are bidirectional deflection indicators with "Zero" as the central division and with LEAD at the left side and LAG at the right side. Refer to the "Varmeter Scale Selection Reference Table" (p.60) concerning the manufacturable maximum scale value of a varmeter relay.
 - (3) Unidirectional deflection indicators can also be manufactured for varmeter relays. Please specify LEAD or LAG (standard is LAG).
 - (4) 1A current rating models are also manufactured (the consumption VA is similar to that of a 5A model).
 - (5) The T-150 rectifier is a dedicated accessory (non-compatible accessory) and thus cannot be used in combinations besides those specified for the indicators. The distance between the indicator and the T-150 rectifier must be 5m or less or the round trip lead wire resistance must be 0.5Ω or less.
 - (6) The weight of the T-150 rectifier is approximately 1kg.
 - (7) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Delivery period classification

| Symbol | _ | OQuasi-standard | • |
|---------------------------|--------------------|-----------------|---------------|
| | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

The items in must be specified.






0-LAG1200kvar

(Unidirectional deflection indicator)

■Outer dimensions of accessory

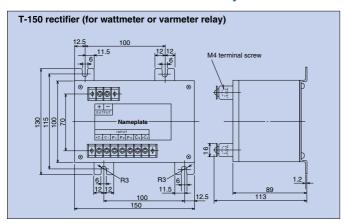

●Terminal layouts




Fig. 1 For 1-phase, 2-wire system wattmeter




Fig. 3 For 3-phase, 4-wire system wattmeter




Fig. 2 For 3-phase, 3-wire system wattmeter








Fig. 4 For 3-phase, 3-wire system varmeter For 3-phase, 4-wire system varmeter


■Connection diagrams

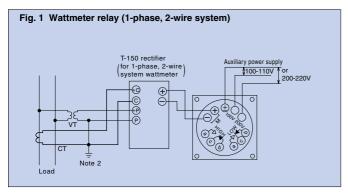

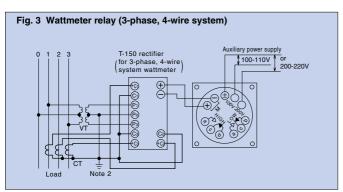

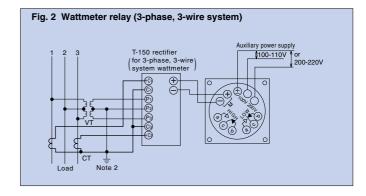

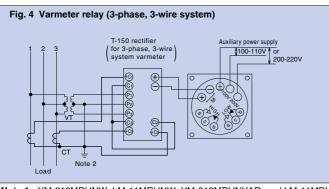

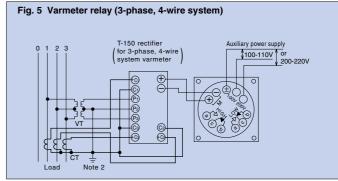

Note 1. YM-210MRHNW, LM-11MRHNW, YM-210MRHNVAR, and LM-11MRHNVAR do not have LOW terminals.

Note 2. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

Meter Relays

Power factor meters

Specifications





YM-210MRNPF

LM-11MRNPF

T-150

T-150

2

| | | | | | Rect | angula | ır indica | ators | | Rectangular indicators | | | | Wide-angle indicators | | | | | |
|-----------------------------|----------------------|---------|------------|---------------------------|---------------------|----------------------------|--------------------|------------------------|-------------|------------------------|--------------------|--------------------|------------------|-----------------------|--------------------|--------------------|-----------------|------------------------------|--------------------|
| | | | Upper/Lowe | er-limit setting Up | pper-limit | setting | Upper/Lo | wer-limit settir | g Upp | oer-limit | setting | Upper/Low | er-limit setting | Upper-limit | setting | Upper/Low | er-limit settin | g Upper-lir | nit setting |
| Siz | e (width × heigh | nt) mm | | | | 100 | ×83 | | | | | | | | 110> | <110 | | | |
| Model name YM-210MRNPF YM-2 | | | | 'M-210MF | RHNPF | YM-210MRNPFU YM-210MRHNPFU | | | LM-1 | IMRNPF | LM-11MR | HNPF | LM-11 | MRNPFU | LM-11M | RHNPFU | | | |
| Operation principle | | | | | Trans | ducer | | | | | Transducer | | | | | | | | |
| Accuracy (grade) | | | | | | | 5 | | | | | | | | 5 | 5 | | | |
| Sca | ale | | | | LEA | AD0.5~ | 1~0.5L | _AG | | | | | | LEA | AD0.5~ | 1~0.5L | AG | | |
| Fre | quency | | | 50 and 6 | and 60Hz 50 or 60Hz | | | 50 and 60Hz 50 or 60Hz | | | | | | | | | | | |
| Sca | ale length | (mm) | | | | 7 | 2 | | | | | | | | 17 | 75 | | | |
| We | ight | (kg) | | 0.7 | | | | | | | 1. | .8 | | | | | | | |
| tion | | | Consu | Consumption VA > | | | Consumption VA > | | | Cons | umption V | Α > | | Cons | umption ' | VA > | T | | |
| period classification | Circuit | Rating | Voltage | Voltage circuit I1 I3 I2 | Accessory | Delivery period | Voltage circuit | Voltage ci | rcuit I2 | Accessory | Delivery period | Voltage circuit | Voltage circ | - Se | Delivery period | Voltage circuit | Voltage cir | Accessory | Delivery period |
| 3-phase 3-wire (balanced) | | 110V 5A | 1 | 1 | T-100 | Δ | | | | | | 1 | 1 | T-100 | Δ | | | | |
| dei | (balanced) | 220V 5A | 2 | 1 | 1-100 | Δ | | | | | | 2 | 1 | 71-100 | | | _ | | |
| ating and | 3-phase 3-wire | | | ٨ | | _ | | | 1 | 2 | T-15 | | | | | | | | |
| aţi | (unbalanced) 220V 5A | | _ | | | 2 | 2 | | 1-150 | Δ | | _ | | | 2 | 2 | 1-10 | ' ^{\(\triangle\)} | |

2

2

T-150

T-150

- **Remarks** (1) Use an input current of 1/5 or more than the rated current. The smaller the input current, the larger the error.
 - (2) 1A current rating models can also be manufactured (the consumption VA is similar to that of a 5A model).
 - (3) The T-100 and T-150 rectifiers are dedicated accessories (non-compatible accessories) and thus cannot be used in combinations besides those designated for the indicators.
 - The distance between the indicator and the T-100 or T-150 rectifier must be 5m or less or the round trip lead wire resistance must be 0.5Ω or less.
 - (4) Weight of accessory T-100 rectifier: approx. 1.4kg T-150 rectifier: approx. 1.7kg
 - (5) Please specify the frequency for YM-210MRNPFU and LM-11MRNPFU.
 - (6) Models for balanced circuits cannot be used with unbalanced loads. Models for unbalanced loads can be used with balanced circuits.
 - (7) The mounting order for the VT and CT does not have to be considered.
 - (8) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection

Precautions"(p.9) to assist in selecting the model and use specifications suited to the application.

 $\frac{110}{\sqrt{3}}$ /110V 5A


110V/190V 5A

3-phase 4-wire


(balanced)

| Delivery per | iou ciassilio | alion | |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | ⊚Standard | OQuasi-standard | △Special |
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

Outer dimensions of accessory

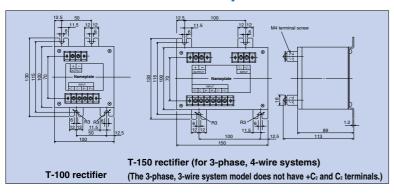


■Connection diagram




2

Fig. 2 Power factor meter relay (3-phase, 3-wire unbalanced loads)



YM-210MRHNPFU and LM-11MRHNPFU do not have LOW terminals



Note 1. In a low voltage circuit, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary

| 9 - 1 - 1 | | | | | |
|---|------------------|------------|-----------|------------------------------------|-----------|
| The items in must be specified. | | | | | Number of |
| Model name Phase-wire system Indicator rating | Scale | Cover type | Frequency | Special specifications | units |
| YM-210MRNPFU 3P3W 110V 5A | LEAD0.5-1-0.5LAG | В | 50Hz | Colored lines, colored bands, etc. | 3 |

Frequency meters





YM-210MRNF

LM-11MRNF

■Specifications

| | | | l | Rectangular | indicators | | | Wide-angle inc | dicators | | | |
|---------|--|---------|-------------------|---------------------------------|------------|-----------------|-------------------|----------------------|--------------------|--|--|--|
| | | | Upper/Lower-limit | nit setting Upper-limit setting | | | Upper/Lower-limit | Upper-limit setting | | | | |
| Siz | e (width × heigl | nt) mm | | 100× | <83 | | | 110×110 | | | | |
| Мо | del name | | YM-210MRN | F | YN | M-210MRHNF | LM-11MRNF | LM-11MRNF LM-11MRHNF | | | | |
| Op | eration principle | • | | Transd | lucer | | | Transduc | er | | | |
| Acc | curacy (grade) | | | 1 | | | | 1 | | | | |
| Sca | ale length | (mm) | | 72 | 2 | | 175 | | | | | |
| We | ight | (kg) | | 0.7 | 7 | | 1.8 | | | | | |
| tion | Circuit voltage | Scale | Consumption VA | Acces | sory | Delivery period | Consumption VA | Accessor | ry Delivery period | | | |
| ssifica | | 45~55Hz | 1 | | | Δ | 1 | | Δ | | | |
| od cla | 110V | 55~65Hz | 1 | | | Δ | 1 | | Δ | | | |
| / peri | | 45~65Hz | 1 | T-10 | 00 | Δ | 1 | T-100 | Δ | | | |
| eliver | | 45~55Hz | 1.5 | | | Δ | 1.5 | | Δ | | | |
| and d | 220V | 55~65Hz | 1.5 | | | Δ | 1.5 | | Δ | | | |
| ating | ating a | 45~65Hz | 1.5 | | | Δ | 1.5 | | Δ | | | |
| ator | Circuit voltage Scale 45~55Hz 55~65Hz 45~65Hz 45~65Hz 45~65Hz 45~65Hz 45~65Hz 220V 55~65Hz 45~65Hz 4 | | | | | 45~75Hz, | 170~190Hz | | | | | |
| Indic | | | | 85~110Hz, 360~440Hz | | | | | | | | |


Remarks (1) Allowable operating voltage range - for 110V: 90~130V; for 220V: 180~260V

- (2) The T-100 rectifier is a dedicated accessory (non-compatible accessory) and thus cannot be used in combinations besides those specified for the indicators.
 - The distance between the indicator and the T-100 rectifier must be 5m or less or the round trip lead wire resistance must be 0.5Ω or less.
- (3) Weight of accessory T-100 rectifier: approx. 0.9kg
- (4) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|--|-----------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period Immediate delivery | | Within 20 days | 21 to 60 days | |

■Outer dimensional drawings of accessory

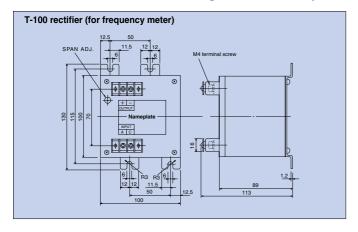

■Connection diagram

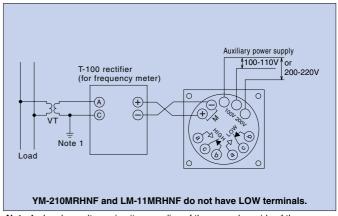

Note 1. In a low voltage circuit, grounding of the secondary side of the instrument voltage transformer is unnecessary.



Meter Relays

Receiving indicators





YM-210MRNRI

LM-11MRNRI

■Specifications


| | | Rectangular | indicators | Wide-angle indicators | | | |
|---|----------------------------------|--------------------------|--------------------|---------------------------|----------------------------|---------------------------|---------------------|
| | | | | Upper/Lower-limit setting | Upper-limit setting | Upper/Lower-limit setting | Upper-limit setting |
| Size | e (width × hei | ght) | mm | 100× | :83 | 110× | 110 |
| Мо | del name | | | YM-210MRNRI | YM-210MRHNRI | LM-11MRNRI | LM-11MRHNRI |
| Оре | eration princip | le | | Movable coil | | Movable coil | |
| Acc | uracy (grade) | | | 2.5 | | 5 | |
| Scale length (mm) | | (mm) | 72 | | 175 | | |
| We | ight | | (kg) | 0.7 | | 1.8 | |
| /ery | Indicator rating Delivery period | | Delivery period | | Internal resistance (Ω) or | consumption current (mA) | |
| deli | | ±0.5mA | Δ | 700 | Σ | 650 | Ω |
| gand | Current input | 1mA | 0 | 700 | Ω | 650 | Ω |
| d cla | Current input | 10mA | Δ | 3Ω | | 7Ω | |
| Indicator rating and delivery period classification | | 4-20mA (zero-suppressed) | 0 | 2.59 | Ω | 10 | Ω |
| Indi | Voltage input | 1, 5, 10V | 0 | 1m/ | A | 1m | A |


- Remarks (1) Refer to p.105 onward of this catalog in regard to transducers to be combined with a receiving indicator.
 - (2) In the case of an electrical quantity scale (A, V, W, var, $\cos\phi$, Hz), the AC/DC symbol and 3-phase circuit symbol are not indicated on the scale. The symbol of the input quantity of the receiving indicator is indicated.
 - (3) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product product | | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

■Connection diagram examples

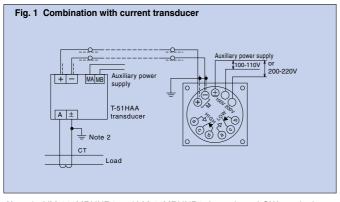

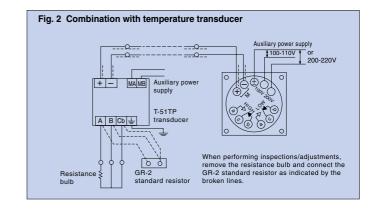


Note 1. YM-210MRHNR1 and LM-11MRHNR1 do not have LOW terminals.

Note 2. In a low voltage circuit, grounding of the secondary side of the current transformer is unnecessary.



■Precautions When Handling Meter Relays

•For meter relays, always keep the auxiliary power supply on. The consequences of turning the auxiliary power supply on/off are described below.

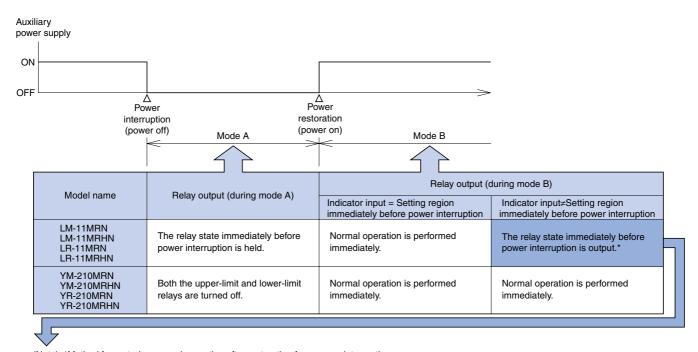


(Note) *Method for restoring normal operation after restoration from power interruption.

Turn the setting knob to move the needle setting in the order of ①, ② as shown below. After this, reset the needle setting.

| Relay output | Lowe | r limit | Upper limit | | |
|---------------------|--|--|--|--|--|
| Malfunction details | Relay output is ON (when it should be OFF) | Relay output is OFF (when it should be ON) | Relay output is ON (when it should be OFF) | Relay output is OFF (when it should be ON) | |
| Action | Lower limit Needle | Lower limit Upper limit Needle | Lower limit Vpper limit Needle | Lower Upper Ilimit Needle | |

•If an inrush current that is generated when a motor is started exceeds the setting value even instantaneously, the relay operates during that state.

To prevent unnecessary influence of the relay during such a transition state of the input signal, use a timer to release the output relay terminals for a fixed time during starting to prevent unnecessary operation of a control device.

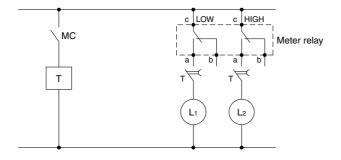

MC: auxiliary contact of electromagnetic switch for starting motor

T : timer

L1, L2 : control device



Indicators with Maximum and Minimum Needles

These indicators have marker needles indicating the maximum and minimum values. The response time of these indicators is extremely fast.

- ●The needle response time is 0.1s (0.3s for DC input).
- •The maximum value marker needle, minimum value marker needle and driving needle are red, green and black, respectively.
- Using the indicators in combination allows the marker needles to be reset to the driving needle both manually and electromagnetically.





LM-11ZNAA

Delivery period classification

product

Immediate delivery

Symbol

Standard Ouasi-standard

product

Within 20 days

△Special

product

21 to 60 days

LM-11YNAV

■Specifications

| | | DC | ammeter | | AC ammeter | DC voltmeter | Receiving indicator |
|------------|----------------------------------|--|-------------|------------|-----------------------|--------------------|---------------------------------|
| | Size (width × height) mm | 110×110 | | | 110×110 | 110×110 | 110×110 |
| Model name | With maximum needle | LN | 1-11ZNDA | | LM-11ZNAA | LM-11ZNAV | LM-11ZNRI |
| Model | With maximum and minimum needles | LM | 1-11YNDA | | LM-11YNAA | LM-11YNAV | LM-11YNRI |
| | Operation principle | Mo | ovable coil | | Rec | tifier | Movable coil |
| | Accuracy (grade) | 1.5 (ma | rker need | le: 2) | 1.5 (marker | r needle: 2) | 1.5 (marker needle: 2) |
| | Scale length (mm) | 175 175 | | 175 | | | |
| | Marker needle reset | Manual and electromagnetic marker needle reset (electromagnetic marker needle reset voltage: 100-110VAC/DC ± | | | | | C/DC ±10%); consumption VA: 6VA |
| | Frequency | _ | | | 50 or 60Hz | 50 or 60Hz | _ |
| | Weight (kg) | 3.2 | | | 3.2 | 3.2 | 3.2 |
| rating | Rated voltage or | 5, 10, 15 | 1, 3, 5 | 15A Note 1 | 1, 5, 10, 15, 20, 30A | 100, 110, 150, 190 | DC 5mA |
| or ra | rated current | 20mA | 10, 15A | or more | 1, 3, 10, 13, 20, 30A | 259, 300V | DC4-20mA |
| Indicator | Consumption VA 40Ω (20mA) 300 | | 300mV | 300mV | 1VA | 5VA | 650Ω (DC5mA), 100Ω (DC4-20mA) |
| hul | Response time | | 0.3s | | 0.1s | 0.1s | 0.3s |
| | Accessory | | _ | | T-150 | T-150 | _ |
| D | elivery period classification | | Δ | | 0 | 0 | Δ |


Note 1. Models with a rating exceeding 15ADC are provided with an externally mounted 300mV shunt.

Additionally, in ordering, please specify the resistance value so that the lead wire round trip resistance value is 0.8Ω or less


Remarks (1) Refer to p.90 and p.92 if an AC voltmeter is to be used as a ground voltmeter.

- (2) The T-150 rectifier is a dedicated accessory (non-compatible accessory) and thus cannot be used in combinations besides those specified for the indicators. The distance between the indicator and the T-150 rectifier must be 5m or less or the round trip lead wire resistance must be 0.5Ω or less.
- (3) Set the duration of supplying electricity to the electromagnetic marker needle resetting terminal to within 5s. Additionally, use a switch that "opens" when released.
- (4) The overload capacity is 2 times the rated current for 2s.
- (5) For an AC ammeter or AC voltmeter, please specify the frequency.
- (6) An expanded scale cannot be manufactured for an AC ammeter.
- (7) Do not use with a circuit through which an inrush current or other current that exceeds the rating flows.
- (8) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Outer dimensions

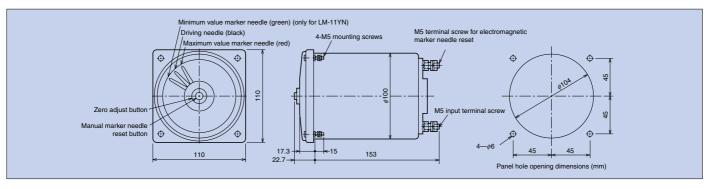







Outer dimensions of accessory

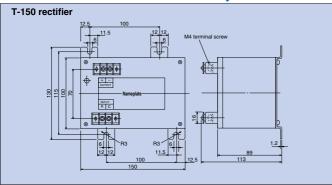



■Connection diagrams

The items in must be specified.

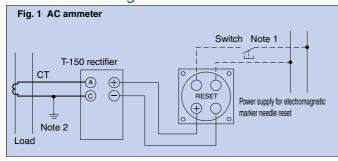

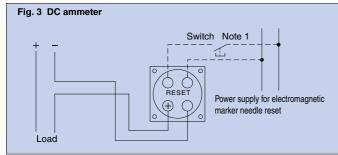

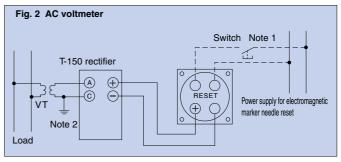


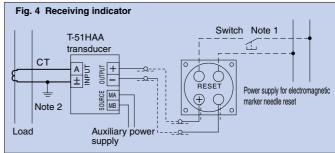

Note 1. Connect if an electromagnetic marker needle resetting circuit is to be provided. Additionally, use a switch that "opens" when released. **Note 2.** In a low voltage circuit, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

•Using LM-11ZNAV or LM-11YNAV AC voltmeter as a ground voltmeter

Shown below are connection examples of the LM-11ZNAV AC voltmeter with the maximum needle (or LM-11YNAV AC voltmeter with maximum/minimum needles) as a ground voltmeter.

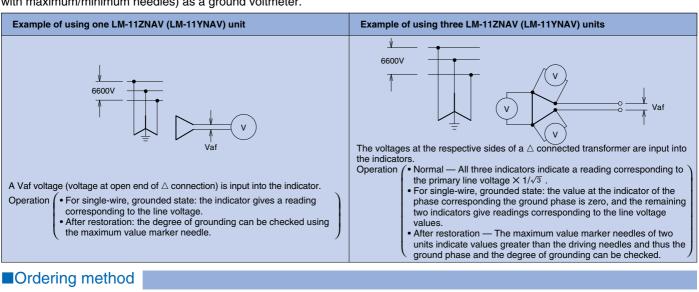



Earth-leakage Detectors

- ●An earth-leakage detector detects an earth fault of an ungrounded 3-phase 3-wire circuit and enables the degree of the earth fault and the ground phase to be judged by deflection of a needle.
- •With the instrument voltage transformer, a Y connection is formed at the primary side to directly ground the neutral point and a △ connection with one corner open is formed at the secondary side (or tertiary side).



LM-11NGD


■Specifications

| | | Wide-angl | e indicator | |
|--------------------------------|-----------------|-----------|----------------|------|
| Size (width × height) mm | | 110> | <110 | |
| Model name | | LM-1 | 1NGD | |
| Operation principle | | Rec | tifier | |
| Zero-phase voltage | Vaf= | 110V | Vaf= | 190V |
| Indicator rated voltage | 63.5V | 86.6V | 110V | 150V |
| Frequency | | 50 or | 60Hz | |
| Consumption VA | 1\ | /A | 2\ | /A |
| Weight (kg) | 0.6 | | | |
| Accessory | T-150 rectifier | | | |
| Delivery period classification | | | Δ | |

Delivery period classification

| Symbol | Standard product | Quasi-standard | △Special product | |
|---------------------------|--------------------|----------------|------------------|--|
| Reference delivery period | 1 | F | 21 to 60 days | |
| Reference delivery period | immediate delivery | within 20 days | 21 10 60 days | |


Remarks (1) Please specify the VT ratio of the EVT used in accordance with the following examples. $\frac{6600}{\sqrt{3}} \ / \frac{110}{\sqrt{3}} \ / \frac{110}{3} \ V \ (\text{specification example in the case where Vaf=110V})$ $\frac{6600}{\sqrt{3}} \ / \frac{110}{\sqrt{3}} \ / \frac{190}{3} \ V \ (\text{specification example in the case where Vaf=190V})$

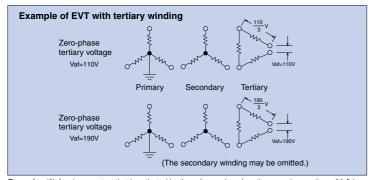


Remarks (2) An alarm contact that is activated by the voltage relay when the zero-phase voltage (Vaf) is 50 to 75V (Vaf=190V) is standard equipment. Contact capacity: 100VAC, 1A (resistive load).

- (3) In the case of using a VT that is not specially designed as a zero-phase transformer, a harmonics suppressing resistor (dummy load) is connected between open and delta. The resistor is selected according to the load of the voltage transformer and should comply with the following:
 - $\begin{cases} 200W\ 200\Omega\ (200\Omega\pm10\%)\ \text{when Vaf=190V} \\ 150W\ 120\Omega\ (120\Omega\pm10\%)\ \text{when Vaf=110V} \end{cases}$
- (4) Be careful of the following matters in using this indicator for telemetry.
 - Please specify the resistance value if the lead wire resistance between the rectifier and the meter exceeds 15Ω (one-way).
 - @ There are three communicating lines between the rectifier and the meter (not including the alarm circuit), and the differences among the resistance values of these lines must be 15Ω or less.
- (5) Please specify the frequency.
- (6) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


■Outer dimensions

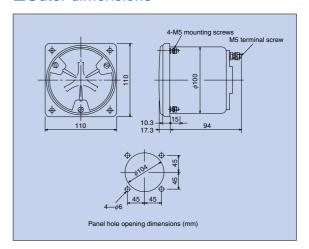

Outer dimensions of accessories

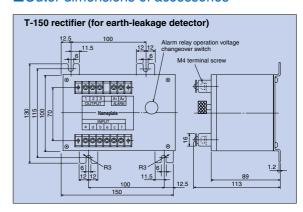

■Connection diagrams

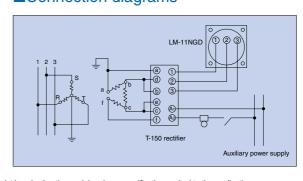

■Ordering method

Connection and VT ratio of EVT to be combined with a ground voltmeter (LM-11ZNAV or 11-YNAV) and an earth-leakage detector (LM-11NGD)

Generally, an EVT with which the zero-phase tertiary voltage in the 1-wire ground state is 110V (or 190V) is used in a YY \triangle (star-star-delta) connection. Although VAf is the input voltage of the ground voltmeter, the respective line voltages of the \triangle connection are input in addition to Vaf into an earth-leakage detector.

| | VT ratio | indication examples (in the case | of a 6600V circuit) | |
|---|----------------------------|--|--|--|
| Connection of VT | Type of EVT | When the zero-phase tertiary voltage | When the zero-phase tertiary voltage | |
| | Type of EVT | in the 1-wire ground state is 110V | in the 1-wire ground state is 190V | |
| ●Without tertiary winding ●With tertiary winding | 1-phase EVT | $\frac{6600}{\sqrt{3}} / \frac{110}{3} V$ | $\frac{6600}{\sqrt{3}} / \frac{190}{3} V$ | |
| <u> </u> | (without tertiary winding) | √3′3 * | √3′3 * | |
| 6600V - 6600V | 1-phase EVT | $\frac{6600}{\sqrt{3}} / \frac{110}{\sqrt{3}} / \frac{110}{3} V$ | $\frac{6600}{\sqrt{3}} / \frac{110}{\sqrt{3}} / \frac{190}{3} V$ | |
| | (with tertiary winding) | $\sqrt{3}$ $\sqrt{3}$ $\sqrt{3}$ $\sqrt{3}$ | $\sqrt{3}$ $\sqrt{3}$ $\sqrt{3}$ $\sqrt{3}$ | |
| Vaf Vaf | 3-phase EVT | 6600 / 110 / 110 / 110 V | 6600 / 110 / 190 V | |
| | (with tertiary winding) | 3 | 3 4 | |
| When the EVT is connected between the transformer neutral point and the earth | | | | |
| | | | | |
| 6600V | 1-phase EVT | 6600 / 110 / | 6600 / 190V | |
| | (without tertiary winding) | $\frac{6600}{\sqrt{3}}$ / 110V | $\frac{6600}{\sqrt{3}}$ / 190V | |
| Vaf | | | | |
| <u> </u> | | | | |

Note. With an arrangement without the tertiary winding in the above diagram, the voltage at the open end resulting from a secondary winding is considered as the zero-phase tertiary voltage.

•Scales of a ground voltmeter (LM-11ZNAV or 11-YNAV) and an earth-leakage detector (LM-11NGD) and the VT ratio

The earth-leakage detector is used in combination with an $YY\triangle$ -connected EVT, and this table shows the relationship between the line voltage V_{L-L} and the scale and the VT ratio.

| Circuit voltage | Indicator maximum | | VT ratio (examples |) | Zero-phase voltage | LM-11ZNAV | LM-11YNAV | LM-1 | 1NGD |
|-----------------|-------------------|---|--|---------------------------------|--------------------|---------------------------|-----------------------|------------------|-----------------------|
| V | scale value | When three 1- | phase EVTs are used | When one 3-phase EVT is used | (Vaf) | Indicator rating (V) | | Indicator rating | Alarm relay operating |
| VL—L | (V) | Without tertiary winding | With tertiary winding | With tertiary winding | (vai) | When 3 units are combined | In the case of 1 unit | (V) | voltage (V) |
| | 600 | $\frac{440}{\sqrt{3}}$ / $\frac{110}{3}$ | $\frac{440}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{110}{3}$ | 440 / 110 / 110 3 | 110 | 86.6 | 150 | 86.6 | 30~50 |
| 440 | 600 | $\frac{440}{\sqrt{3}}$ / $\frac{190}{3}$ | $\frac{440}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{190}{3}$ | 440 / 110 / 190 3 | 190 | 150 | 259 | 150 | 55~75 |
| 440 | 440 | $\frac{440}{\sqrt{3}}$ / $\frac{110}{3}$ | $\frac{440}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{110}{3}$ | 440 / 110 / 110/3 | 110 | 63.5 | 110 | 63.5 | 30~50 |
| | 440 | $\frac{440}{\sqrt{3}}$ / $\frac{190}{3}$ | $\frac{440}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{190}{3}$ | 440 / 110 / 190 3 | 190 | 110 | 190 | 110 | 55~75 |
| | 4500 | $\frac{3300}{\sqrt{3}}$ / $\frac{110}{3}$ | $\frac{3300}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{110}{3}$ | 3300 / 110 / 110/3 | 110 | 86.6 | 150 | 86.6 | 30~50 |
| 3300 | | $\frac{3300}{\sqrt{3}}$ / $\frac{190}{3}$ | $\frac{3300}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{190}{3}$ | 3300 / 110 / 190 3 | 190 | 150 | 259 | 150 | 55~75 |
| 3300 | 3300 | $\frac{3300}{\sqrt{3}}$ / $\frac{110}{3}$ | $\frac{3300}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{110}{3}$ | 3300 / 110 / 110 3 | 110 | 63.5 | 110 | 63.5 | 30~50 |
| | | $\frac{3300}{\sqrt{3}}$ / $\frac{190}{3}$ | $\frac{3300}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{190}{3}$ | 3300 / 110 / 190 3 | 190 | 110 | 190 | 110 | 55~75 |
| | 9000 | $\frac{6600}{\sqrt{3}}$ / $\frac{110}{3}$ | $\frac{6600}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{110}{3}$ | 6600 / 110 / 110 3 | 110 | 86.6 | 150 | 86.6 | 30~50 |
| 6600 | 9000 | $\frac{6600}{\sqrt{3}}$ / $\frac{190}{3}$ | $\frac{6600}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{190}{3}$ | 6600 / 110 / 190 | 190 | 150 | 259 | 150 | 55~75 |
| 0000 | 6600 | $\frac{6600}{\sqrt{3}}$ / $\frac{110}{3}$ | $\frac{6600}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{110}{3}$ | 6600 / 110 / 110 / 3 | 110 | 63.5 | 110 | 63.5 | 30~50 |
| | 0000 | $\frac{6600}{\sqrt{3}}$ / $\frac{190}{3}$ | $\frac{6600}{\sqrt{3}}$ / $\frac{110}{\sqrt{3}}$ / $\frac{190}{3}$ | 6600 / 110 / 190 3 | 190 | 110 | 190 | 110 | 55~75 |

- ●There are two types of indicator maximum scale values, the nominal line voltage V_L-L and 1.36×V_L-L. (1.36 is the value in the case of 150V/110V.)
- ullet The zero-phase voltage Vaf is the voltage at the open end of the open \triangle connection when the primary side is in the 1-wire ground state.
- ●The alarm relay operation voltage is related only to the zero-phase voltage (that is, the VT ratio) and has no relationship with the indicator scale.

Regarding the indicator rating

- OIn the case of combining three LM-11ZNAV (LM-11YNAV) units or in the case of LM-11NGD The indicator rating is the line voltage at the △ connection side when the primary side is in the 1-wire ground state (however, the fault phase is excluded).
- OIn the case of using one LM-11ZNAV (LM-11YNAV) unit The indicator rating is the voltage corresponding to the zero-phase voltage Vaf.

Synchroscopes

- •A synchroscope indicates the synchronization point (scale center) when the frequencies and the phases at a generator side and a bus line side are matched.
- •If the frequencies of both sides are equal, the position at which the needle is stationary indicates the phase difference between the two.
- ●When the generator side (starting side) frequency is fg and the bus line side (operating side) frequency is fg, the direction of rotation of the needle is as follows:

When fg=fB The needle is stopped.

When fg>fB The needle rotates in the FAST direction.

When fg<fB The needle rotates in the SLOW direction.



L1-11NSY

Specifications

| | | | Wide-angle indicators | | | | |
|--------------------------------|----------------|-------------|-----------------------|------------------------|-----|--|--|
| Size (width > | × height) mm | | 110× | (110 | | | |
| Model | I name | | LI-11 | NSY | | | |
| Operation | n principle | | Movable iron co | ore (induction) | | | |
| Accurac | y (grade) | | 5 | | | | |
| Frequ | uency | | 50Hz o | r 60Hz | | | |
| Weigl | ht (kg) | 2.0 | | | | | |
| Indicat | tor type | 1-pl | nase | 3-phase | | | |
| Rated v | oltage V | 110 | 220 | 110 | 220 | | |
| Consumption VA | Generator side | 4 | 8 | 4 | 8 | | |
| Consumption va | Bus line side | 4 | 8 | 4 | 8 | | |
| Accessory | | T-150 shunt | | T-150 resistor | | | |
| Delivery period classification | | Δ | Δ | Δ | Δ | | |
| Special sp | ecification | | With phase angle scal | e (delivery period: △) | | | |

Remarks (1) The pull-in and dropout frequencies are 2 to 3Hz. That is, although the needle rotates up to a frequency difference of 2 to 3Hz according to the difference and indicates whether the generator (or starting side) is slow or fast, when the difference becomes large, the needle moves slightly without rotating.

- (2) The needle does not rotate when the frequency difference is large. In this case, judgments should be made using the light shown in the connection diagram. Please note that the light is not supplied; it is to be prepared by the customer if required.
- (3) The specifications are continuous rating specifications.
- (4) In a state where electricity is not supplied, the needle indicates an arbitrary position exceeding ±30° from the synchronization point.
- (5) The lead wire length from the main synchroscope unit to an accessory device must be set to 5m or less.
- (6) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.
- (7) The scale must be specified. The standard specification is: SLOW-FAST.

Phase angle scale

- •An indicator with phase angle scale, in which an angle scale centered at the synchronization point (scale center) is drawn, can also be manufactured.
- ●The needle indicates the phase difference between the generator side and bus line side. The indicator can thus be used for measuring the phase difference when the needle is stationary or for timing of startup.
- ullet The standard phase angle scale is a 30° forward/backward scale.



Delivery period classification

Immediate delivery


Symbol

Within 20 days


21 to 60 days


L1-11NSY with phase angle scale

Outer dimensions

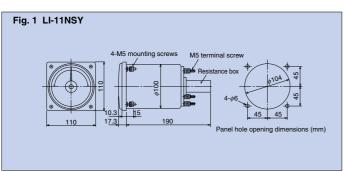

■Outer dimensions of accessories

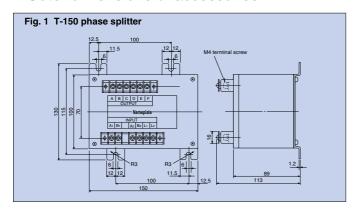

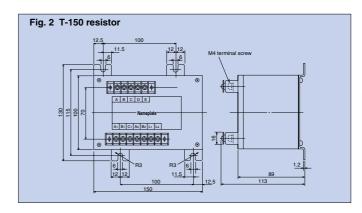

■Connection diagrams




Fig. 1 3-phase system; combined with VT




Fig. 2 1-phase system; combined with VT




Fig. 3 3-phase system; 220V





Fig. 4 1-phase system; 220V


- **Remarks** (1) The synchroscope operates normally even if the light shown in the diagrams is not used.
 - (2) Regarding light connection
 - When combined with a VT, the same phase at the secondary side of the VT must be grounded.
 - If a VT is not used (direct case), connect the same phases shown in the connection diagrams.

The light will not flash if not connected.

- (3) Regarding light rating
 - A value twice the circuit voltage is generated between the light connection terminals (between L₁ and L₂). If a light of the same rating as the circuit voltage is to be used, connect two lights in series.

■Example synchroscope light connection (for reference)

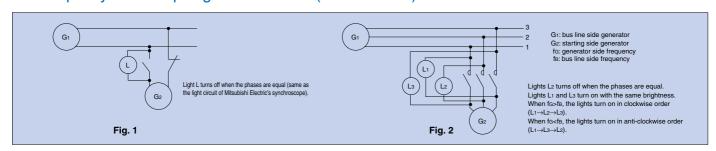

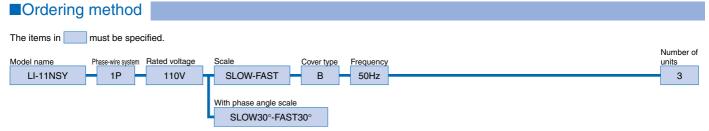



Dual-element Indicators

Two measured quantities are indicated by the same indicator.

- •Two independent movable coil indicators are incorporated, and by combination with a detector and a transmitter, two measured quantities, such as voltage and current, water level and water quantity, power and reactive power can be indicated by the same indicator to enable reduction in panel space. The indicator can be combined with power transducers to enable measurement of various electrical quantities.
- •The needle colors are black and red (the front side needle as viewed from the front face of the indicator is black and the rear side needle is red).



LM-11NE

Specifications

| Size (width > | < height) mm | 110×110 wide-angle indicator | | |
|------------------------|--------------|---|---|--|
| Model | name | LM-11NE | | |
| Operation | n principle | Movable coil | | |
| Accurac | y (grade) | 1.5 | | |
| Scale ler | gth (mm) | 175 | | |
| Weigl | nt (kg) | 1.0 | | |
| Indicator r | ating (DC) | Approximate internal resistance value (Ω) Delivery | | |
| | 1mA | 1200 | | |
| Both elements have | 5mA | 50 | | |
| same ratings | 10mA | 25 | | |
| | 4 - 20mA | 15 | | |
| Respective elements | 1/5mA | 1mA side: 1200, 5mA side: 50 | | |
| have different ratings | 5/10mA | 5mA side: 50, 10mA side: 25 | 0 | |
| nave uniorent ratings | 10/1mA | 10mA side: 25, 1mA side: 1200 | | |

Delivery period classification

| Symbol | Standard | | △Special |
|---------------------------|--------------------|----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |


Remarks (1) Indication accuracy: 15% of full scale

- (2) Relative deviation between the two needles: 2.0% of full scale $\,$
- (3) Withstand voltage


Between electrical circuit as a whole and outer casing: 2210VAC, 5s Mutually between input circuits (indicator alone): 50V AC, 1min

- (4) In the case of a double scale, each scale is drawn in the same color as the corresponding needle.
- (5) In the case of an electrical quantity scale (A, V, W, var, cosφ, Hz), the AC/DC symbol and 3-phase circuit symbol of the scale (primary side) are not indicated. The symbol of the receiving indicator is indicated.
- (6) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.


Outer dimensions

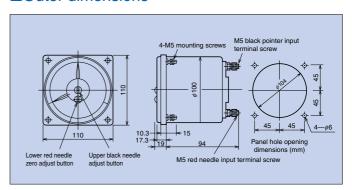

■Connection diagram

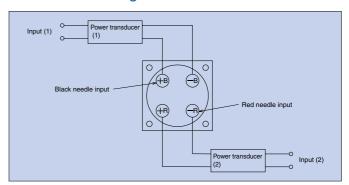

Usage example

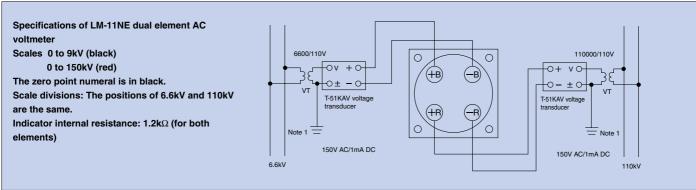

Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

■Ordering method The items in must be specified. Number of Special specifications Colored lines, colored Model name Indicator rating Cover type LM-11NE 0-100A 5 В FS1mA hands etc (In the case of separate scales) (Different rating) 0-9000V/0-150kV FS10/1mA



Bar-shaped Indicators

■Applications

- Optimal as indicators for various process controls in power generating/transforming systems, steel plants and chemical plants, as well as general panel indicators.
- •Useful for changing the panel appearance and significantly reducing panel size.
- •Level differences of measured values can be compared easily by coupled mounting of indicators.

■Products list

- ●There are four types of outer size (length) 100mm, 130mm, 150mm and 170mm.
- •All models are available in vertical and horizontal mount specifications.
- ●For the FM model, both 1- and 2-needle meters can be manufactured.

| Indicator type | C | uter dimensions | 100×30mm | 130×36mm | 150×40mm | 170×42mm |
|--------------------------|------------------|-----------------|----------|----------|----------|----------|
| | Vertical mount | 1 needle | FM-210SN | FM-213SN | FM-215SN | FM-217SN |
| DC indicator FM model | | 2 needles | FM-210DN | FM-213DN | FM-215DN | FM-217DN |
| DC indicator i wi moder | Horizontal mount | 1 needle | FM-210SN | FM-213SN | FM-215SN | FM-217SN |
| | HOHZOHIAI HIOUHI | 2 needles | FM-210DN | FM-213DN | FM-215DN | FM-217DN |
| AC indicator FR model | Vertical mount | 1 needle | FR-210SN | FR-213SN | FR-215SN | FR-217SN |
| AC Illulcator En Illouer | Horizontal mount | 1 needle | FR-210SN | FR-213SN | FR-215SN | FR-217SN |

■Standard specifications in common

| Item | Specification |
|---------------------------------------|---|
| Standards | Direct-acting electrical indicators JIS C 1102-2 |
| Accuracy (grade) | 1, 1.5 or 2.5 |
| Operating temperature range | -5°C~50°C (reference temperature: 23°C) |
| Operating humidity range | At a relative humidity of 30~70%, there are no adverse effects on indications. |
| Mounting attitude | Vertical (the scale plate is vertical with respect to a horizontal surface) |
| Insulation test | $10M\Omega$ or more at a test voltage of 500VDC (between electrical circuit and outer casing) |
| Voltage test | 2210VAC for 5s (between electrical circuit and outer casing), 500VAC for 1min (between elements in a 2-needle model) |
| Crest factor of input signal | Sine wave $(\sqrt{2})$ |
| Measurement category | CAT Ⅲ (category of measurement performed inside a building facility) |
| Pollution degree of usage environment | 2 (of a level where only a non-conducting pollution occurs) |
| Installation altitude | 2,000m or less |
| Usage location | Indoors |
| Mounting panel | Metal panel |
| Storage temperature | -20°C~60°C |
| Scale plate | Background color: white |
| Needle | Large triangular needle (red) |
| Cover | Acrylic resin (with antistatic treatment applied) |
| Case | Heat-resistant ABS resin |
| Accessory | Protective plates (Refer to p.105 for handling method.) |

■Panel mounting examples

●Horizontal mount

●Vertical mount

●Vertical coupled mount









Bar-shaped Indicators

DC indicators

(DC voltage/DC current input)







FM-213SN vertical mount



FM-215DN vertical mount



FM-217DN vertical coupled mount

■Specifications

| | | | | | 1-point | er type | | | 2-point | er type | | | | | | | |
|--|---------------|--------------------------|--------------------------------|------------|----------|----------|------------------|--------------------------------|----------|----------|----------|--|--|--|--|--|--|
| | Si | ze | mm | 100×30 | 130×36 | 150×40 | 170×42 | 100×30 | 130×36 | 150×40 | 170×42 | | | | | | |
| | M | odel name | | FM-210SN | FM-213SN | FM-215SN | FM-217SN | FM-210DN | FM-213DN | FM-215DN | FM-217DN | | | | | | |
| | O | peration principle | | | Moval | ole coil | | | Moval | ole coil | | | | | | | |
| | Ad | ccuracy (grade) | | 1.5 or 2.5 | | 1 or 1.5 | | 1.5 or 2.5 | | 1 or 1.5 | | | | | | | |
| | Sc | cale length | (mm) | 66 | 88 | 100 | 100 | 66 | 88 | 100 | 100 | | | | | | |
| | 0 | uter dimensions | | Fig. 1 | Fig. 2 | Fig. 3 | Fig. 4 | Fig. 1 | Fig. 2 | Fig. 3 | Fig. 4 | | | | | | |
| | W | eight | (kg) | 0.4 | 0.5 | 0.6 | 0.7 | 0.5 | 0.6 | 0.7 | 0.7 | | | | | | |
| delivery period classification | | Indicator rating | Delivery period classification | | | Inte | ernal resistance | (Ω) or voltage Ω | | | | | | | | | |
| ssiffi | μ | 100 <i>μ</i> A | Δ | 4000 | _ | _ | _ | 4000 | _ | | | | | | | | |
| clas | current input | 500μA | Δ | 300 | 300 | 30 | 00 | 300 | 300 | 300 | | | | | | | |
| jod | rren | 1mA | Δ | 100 | 100 | 10 | 00 | 100 | 100 | 10 | 00 | | | | | | |
| per | | 5mA | Δ | 20 | 20 | 2 | :0 | 20 | 20 | 2 | 0 | | | | | | |
| ery | 8 | 10mA | Δ | 10 | 10 | 1 | 0 | 10 | 10 | 1 | 0 | | | | | | |
| Jelj- | | 4~20mA (zero-suppressed) | Δ | 10 | 10 | 1 | 0 | 10 | 10 | 1 | 0 | | | | | | |
| and c | | 50mA~10A | Δ | 60mV | 60mV | 60 | mV | | _ | _ | | | | | | | |
| Delivery period Consumption current (approx.) mA | | | | | | | | | | | | | | | | | |
| tor | voltage | 1, 5, 10V | Δ | | 1n | nA | | 1mA | | | | | | | | | |
| dica | 0 | 1~5V (zero-suppressed) | Δ | | 1.25 | 5mA | | 1.25mA | | | | | | | | | |
| <u>=</u> | Ö | 20~300\/ | ٨ | | 1n | nΔ | | | _ | _ | | | | | | | |


Remarks. (1) Models that can be mounted vertically and horizontally can be manufactured; please specify if required. Delivery period classification

(2) Use the following table to select the application (instrumentation or panel) and accuracy grade.

| Application | FM-210N | FM-213N | FM-215N | FM-217N |
|-----------------|---------|---------|---------|---------|
| Instrumentation | 1.5 | 1.0 | 1.0 | 1.0 |
| Panel | 2.5 | 1.5 | 1.5 | 1.5 |

| Symbol | Standard | OQuasi-standard | △Special | | | | | |
|---------------------------|--------------------|-----------------|---------------|--|--|--|--|--|
| Gyrribor | product | product | product | | | | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | | | | |

- (3) The withstand voltage between the input terminals of the L element and the R element of a 2-needle model (D) is 500VAC for 1min. In the case of a DC circuit or other circuit requiring a higher withstand voltage, use an isolator (T-101IS type) at the input.
- (4) Provided with span adjuster (adjustment range: approx. ±5%).
- (5) In the case of an electrical quantity scale (A, V, W, var, cos ∅, Hz), the AC/DC symbol and 3-phase circuit symbol are not indicated on the scale. The symbol of the input quantity of the receiving indicator is indicated.
- (6) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.



AC indicators

(AC voltage/AC current input)





■Specifications

| Size | | mm | 100×30 | 130×36 | 150×40 | 170×42 | | | | | |
|---|------------------|--------------------------------|----------|----------------|------------------------|----------|--|--|--|--|--|
| Model | name | | FR-210SN | FR-213SN | FR-215SN | FR-217SN | | | | | |
| Operat | ion principle | | | Rectifier | | | | | | | |
| Accura | cy (grade) | | 2.5 | 1.5 | | | | | | | |
| Scale I | ength | (mm) | 66 | 88 | 100 | 100 | | | | | |
| Outer | dimensions | | Fig. 1 | Fig. 2 | Fig. 3 | Fig. 4 | | | | | |
| Weight | | (kg) | 0.5 | 0.6 | 0.7 | 0.7 | | | | | |
| AC . | Indicator rating | Delivery period classification | | Consumption VA | A or voltage drop | | | | | | |
| हिं झिं current हिं झें input | 500μA~100mA | Δ | 1.4V | 1.4V | 1.4V | 1.4V | | | | | |
| lassi | 100mA~5A | Δ | 0.2VA | 0.2VA | 0.2VA | 0.2VA | | | | | |
| AC current input input AC voltage input | Indicator rating | Delivery period classification | | Consumption | Consumption current mA | | | | | | |
| ≦ input | 5~300V | Δ | 4mA | 4mA | 4mA | 4mA | | | | | |

Remarks. (1) Models that can be mounted vertically and horizontally can be manufactured; please specify if required.

- required.
 (2) Error may occur when the input waveform is distorted.
- (3) Please specify the frequency.
- (4) 2x, 3x, and 5x expanded scales can also be manufactured.
- (5) In the case of an electrical quantity scale (A, V, W, var, cosφ, Hz), the AC/DC symbol and 3-phase circuit symbol are not indicated on the scale. The symbol of the input quantity of the receiving indicator is indicated.
- (6) Please make sure to read the "Safety Precautions" (pp.5-8) and the "Selection Precautions" (p.9) to assist in selecting the model and use specifications suited to the application.

Delivery period classification

| Delivery period classification | | | | | | | | | | | |
|--------------------------------|--------------------|-----------------|---------------|--|--|--|--|--|--|--|--|
| Symbol | ⊚Standard | OQuasi-standard | △Special | | | | | | | | |
| Symbol | product | product | product | | | | | | | | |
| Deference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | | | | | | | |





Bar-shaped Indicators

■Outer dimensions

Fig. 1 FM-210N/FR-210N


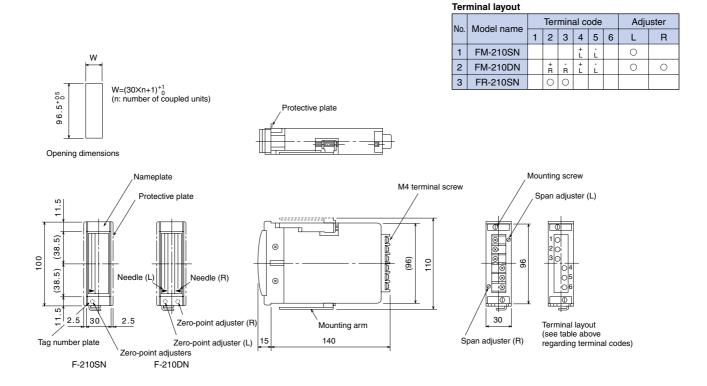


Fig. 2 FM-213N/FR-213N (protective plate unnecessary)

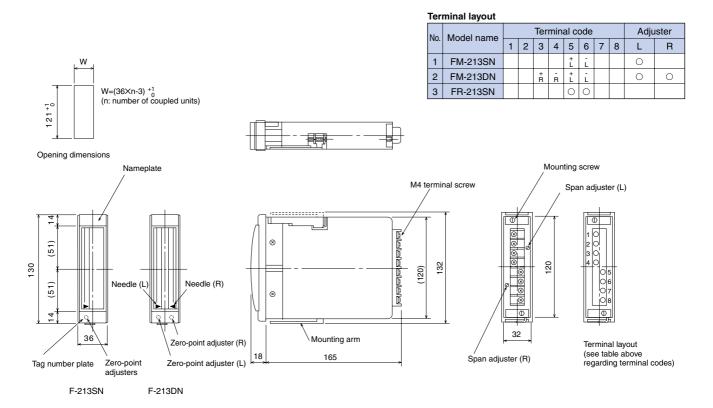

■Outer dimensions

Fig. 3 FM-215N/FR-215N


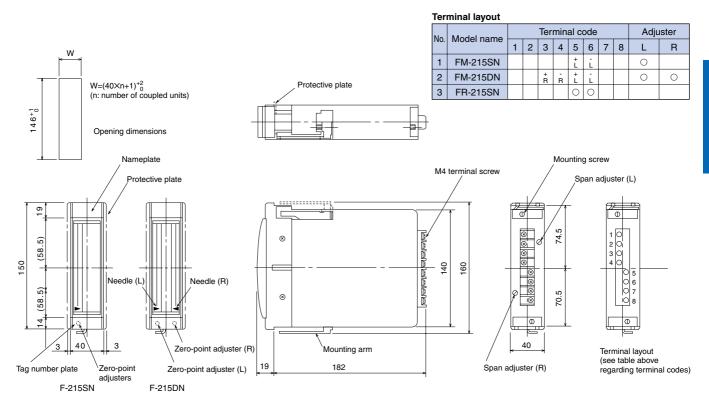


Fig. 4 FM-217N/FR-217N



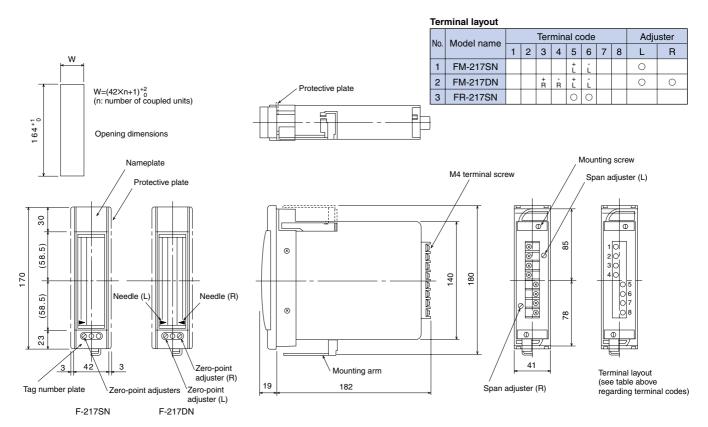

■Nameplate and tag number plate indication standards

Indications on nameplates and tag number plates shall be engraved according to the following standards.

Orders with no specified nameplates or tag number plates will be delivered without nameplates or tag number plates.

1. Indication method

Method Engraved/Ink Font Round Gothic Material ABS resin

2. Dimensions/Number of characters/Number of steps (vertical mount)

| | Plate | F-210N | F-213N | F-215N | F-217N |
|------------|---------------------------------|--------|--------|--------|--------|
| | Effective area | 9×28 | 11×32 | 15×38 | 25×38 |
| Nameplate | Number of characters per column | 9 | 9 | 9 | 9 |
| | Number of rows | 2 | 2 | 3 | 3 |
| Togramma | Effective area | 9×28 | 11×32 | 10×38 | 8×38 |
| Tag number | Number of characters per column | 10 | 10 | 10 | 10 |
| plate | Number of rows | 1 | 1 | 1 | 1 |

- ◆Effective area ······ Dimensions enabling effective indication of characters (height × width)
- ●Number of characters ······· Maximum number of characters that can be entered in a single column
- ●Number of steps Number of character strings
- •May differ from the standard size/position depending on the combination of the character string.
- Please inquire regarding horizontal mounting.


3. Style/Print color

| Background color of nameplate • tag number plate | Print color | Outer frame color | | | | |
|--|-------------|---------------------------------|--|--|--|--|
| (B) Black Munsell N1.5 | White | Outer frame: N1.5 | | | | |
| (F) Dark blue Munsell 7.5BG4/1.5 | White | Outer frame: 7.5BG4/1.5 | | | | |
| (W) White Munsell N9/0 | Black | Outer frame: N1.5 or 7.5BG4/1.5 | | | | |


●If the background color is not specified, it will be the same color as the outer frame.

4. Model-wise indication standards


Nameplates

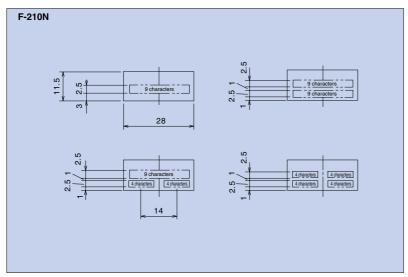


Tag number plates





Nameplates

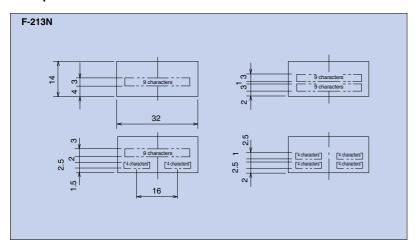



Tag number plates



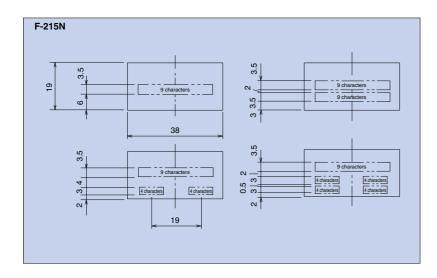



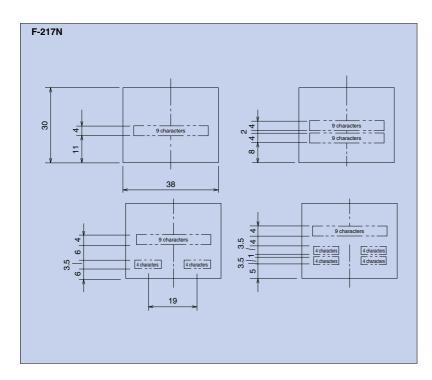

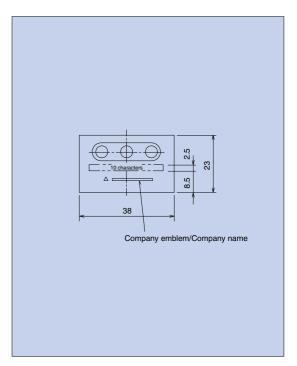




Bar-shaped Indicators

Handling precautions


1. Using protective plates

- Protective plates are mounted to indicators so that the gaps between the indicator and panel cannot be seen. They are mounted to both sides of an indicator when a single unit is mounted, and mounted at both ends of the indicator when coupled mounting is used.
- Plate attachment
 Match and insert the upper and lower inner protrusions of each plate in the grooves of the outer frame at the rear of the indicator.
- The plates are coated the same color as the outer frame.
- The plates are packaged together with the indicator.
 F-213N does not have protective plates.

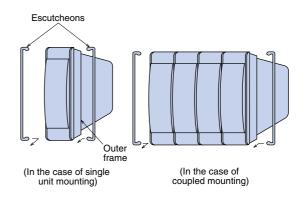


2. Mounting the indicator

• Push on the front face of the panel to insert the unit. Next, turn the fastening screws in the rear face of the main unit clockwise using a standard screwdriver or box-end screwdriver with 5.5mm opposing sides. In doing so, the mounting arms will be set automatically and fixed to the panel (thickness of corresponding panel: 1 to 6mm).

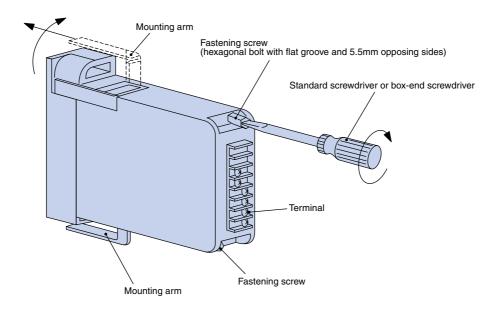

3. Zero-point adjustment

- For indicators other than F-217N, open the tag number plate using a standard screwdriver and use the zero-point adjusters inside to adjust the zero point.
 - Be careful not to apply excessive force to the adjusters.
- For zero-point adjustment of the F-217N, use a standard screwdriver to adjust the zero point by turning the zero-point adjusters on the front face.
- If the unit is equipped with a zero-suppressed indicator, perform adjustment while applying electricity equivalent to the minimum scale value; for example, 4mA in the case of 4 to 20mA.

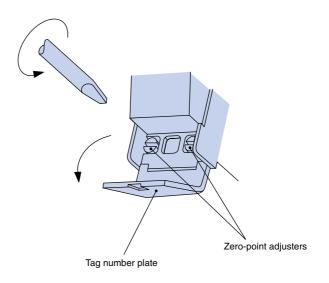


4. Disassembling of nameplates, tag number plates, covers and scale plates


Procedure 1. Remove the nameplate and tag number plate.

For pivoting tag number plates, remove the extraction pins at the rear. Remove while lifting the indicator approximately 5mm from the panel surface.

(The pivoting tag number plate does not need to be removed to remove the scale plate.)

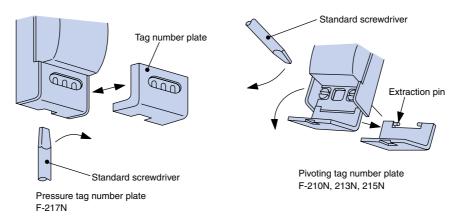


- 2. Remove the cover fastening screws.
- 3. To remove the cover, pull the upper side of the cover forward slowly and then lift slightly.

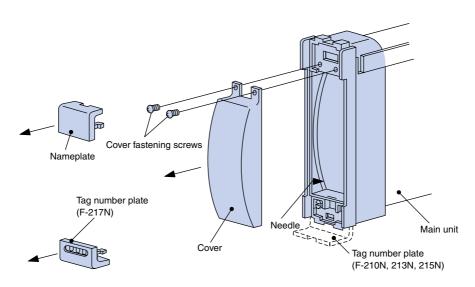

- 4. To prevent deformation of the needle, turn the zero-point adjuster and move the needle to the lower side.
- 5. Draw out the scale plate wedge toward the front.
- 6. The scale plate can be removed when the upper side (nameplate side) of the scale plate is slowly drawn outward and lifted slightly.

Note: Be careful not to deform the needle when removing the scale plate.

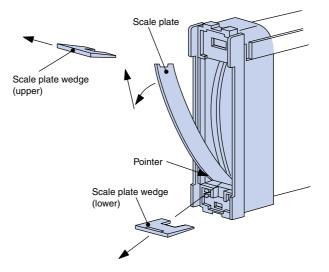

Transducers

Overview and Features


High performance realized in a compact module.

Single function models T-51/T-101 Series

Power K Series(ordinary class, fixed-load output)
H Series(ordinary class, constant-voltage/constant-current output)
S Series(precision class, constant-voltage/constant-current output)

and Peripheral

Instrumentation An assortment of box models with power, instrumentation and peripheral elements

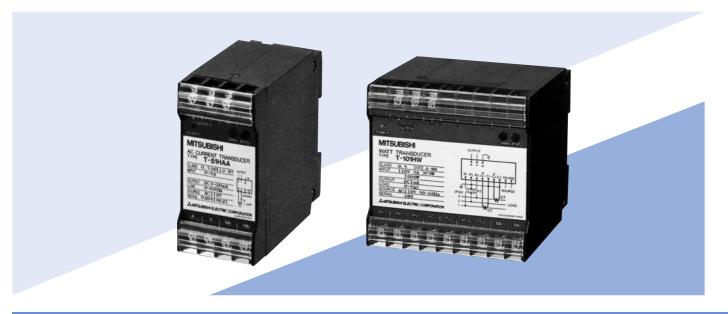

Mitsubishi Electric transducers

| | | | Power transducers Instru | | | | | | | | trum | enta | ition | trans | sduc | ers | | | Pe | riphe | eral t | rans | duce | ers | | Spe | cial | | | | | | | | |
|-----------------|-----------------|-------------------------------|--------------------------|---------------------------|---------|--------------|----------------|--|--|--------------|-----------|---------------------|------------------|------------------|-----------------|--------------------------|----------|------------|----------|---------------------|---------|-------|-------------------------------|----------------------------|-----------------|--|--|-----------------------------------|-----------------|---|-----------------------|-----------------------|--------|-----------|-------------------------------------|
| Shap | | uct name | Current | Current (saturated power) | Voltage | Active power | Reactive power | Phase angle (3-phase balanced circuit) | Phase angle (3-phase unbalanced loads) | Power factor | Frequency | Voltage phase angle | Harmonic current | Harmonic voltage | Electric energy | Reactive electric energy | DC level | DC reverse | Isolator | High-speed isolator | Limiter | Adder | Temperature (resistance bulb) | Temperature (thermocouple) | First-order lag | AC current demand (moderate time interval) | AC voltage demand (moderate time interval) | Current with power flow detection | Leakage current | Leakage current (with built-in low-pass filter) | Voltage drop detector | Voltage rise detector | Filter | Harmonics | Active power/Active electric energy |
| E | | K Series (ordinary class) | 0 | 0 | 0 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| unctic | T-51 Series | H Series (ordinary class) | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | | | | | | | | | | | | | | | | | | | | | | |
| Single function | T-101 Series | S Series (precision class) | 0 | | 0 | 0 | 0 | | 0 | 0 | 0 | 0 | | | | | | | | | | | | | | | | | | | | | | | |
| iž | | | | | | | | | | | | | | | | | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | 0 |
| Collective | T-120 \$ | Series | 0 | | 0 | 0 | 0 | | | 0 | 0 | | 0 | 0 | 0 | 0 | | | | | | | | | | | | | | | | | | 0 | |

Now even easier to use.

Collective transducers T-120 Series

Multi-use transducers that allow the input of various electric quantities from instrument transformers (VT, CT), and output DC signals and pulses.



4 modes of mounting

As standard specifications, the T-51, T-101 and T-120 Series can be mounted four ways: mounting legs, IEC rail (35mm), distribution panel breaker mounting plate, and mounting tabs.



IEC rail (35mm)



Distribution panel breaker mounting plate



Distribution panel breaker mounting tab



Compact modules that facilitate panel designing

The realization of compact modules was pursued. There are 2 types of outer dimensions.

(T-51/T-101 Series)

Self-lifting screws utilized for input and output terminals

Wiring work is easier if self-lifting screws are used.

(T-51/T-101/T-120 Series)

Equipped with power supply indicator

An auxiliary power supply indicator (red LED) that indicates operating state is provided.

(excluding the T-51K and T-120 Series)

Mitsubishi Electric electronic technologies fully integrated

In addition to carefully selected electronic parts, the design considers lighting/switching surges and noise.

Select the optimal model according to the application

Single function models Power, instrumentation and peripheral transducers

K Series Ordinary class, fixed-load output

H Series----- Ordinary class, constant-voltage/constant-current output

S Series..... Precision class, constant-voltage/constant-current output

Collective Multi-use for power applications

Safety Precautions

Safety Precautions

Please pay attention to the following items when using transducers.

Read the instruction manual attached to the product before performing settings or using the device.

For safety reasons, mounting and connection work should only be performed by a professional electrical wiring technician.

1 Precautions concerning usage environment and usage conditions

Do not use in the following locations. Use in such locations may lead to malfunction, significant error or reduced service life.

- ●Locations where the ambient temperature is outside the range of -10°C~50°C.
- Locations where the average daily temperature exceeds 35°C.
- Locations where the humidity is outside the range of 30%RH~85% RH (no condensation).
- Locations with excessive dust, corrosive gases, salinity or oil fumes.
- Locations with excessive vibration or impact.
- Locations directly exposed to rain, water drops or sunlight.
- Locations with excessive external noise.
- Locations at an altitude of 1000m or more.
- Locations where a strong electric field or magnetic field is generated.
- Locations where there are metal pieces or inductive substances present.

2 Mounting precautions

Please pay attention to the following items regarding mounting.

- The transducers must be mounted inside a panel.
- Tighten the mounting screws using the following torques:

M4 iron screws 1.47~1.86N•m M4 brass screws 0.88~1.08N•m M5 iron screws 2.94~3.43N•m M5 brass screws 1.67~2.06N•m

3 Connection precautions

Please pay attention to the following items regarding connection.

- Use the specified materials and diameters for the electrical wires that connect the output and load of transducers in order to prevent failure due to external noise or surges.
- •Use the following crimp terminals.

| Series | Applicable crimp terminals | Tightening torque | | |
|-------------|--|-------------------|--|--|
| T-51, T-101 | Round crimp terminals (outer diameter: ϕ 8.5 or less) for M4 screws | 0.98~1.47N•m | | |
| T-120 | Round crimp terminals (outer diameter: ϕ 8.3 or less) for M4 screws | | | |
| 1-120 | Round crimp terminals (outer diameter: ϕ 7.1 or less) for M3.5 screws | 0.61~0.82N•m | | |

•Although transmission distances for standard combinations are indicated in this catalog, the values are to be used when there is no interference (e.g., induction voltage, surge) in the transmission line. If installation of the transmission line parallel to power cables is unavoidable and there is a possibility of inductive interference, use a shielded transmission line to avoid interference during use.

- Power factor and reactive power transducers will not operate correctly when connected as a reverse phase sequence. Use with the correct phase sequence.
- •When a device, such as a harmonics transducer for measuring harmonic voltage is connected to a VT, do not remove the auxiliary power supply of multi-use or harmonics transducers from the VT. The harmonic voltage may not be measured correctly.
- •In regard to grounding in the connection diagrams, grounding of the secondary sides of the VT and CT is unnecessary for low-voltage circuits.

A CAUTION

Connect correctly

Check the connection diagrams carefully before making connections. Erroneous connections may cause equipment to scorch or catch fire.

Fasten terminal connections securely

Fasten electrical wires securely to the terminals. Otherwise, overheating, equipment burnout or fire may occur.

Do not perform work with live wires

Do not perform connection work with live wires. Electrical shock, electrical burns, equipment burnout or fire may occur.

Do not open the secondary side of a CT circuit

Ensure that the signal on the secondary side of the CT is connected correctly to the CT connection terminals. Incorrect connection of the CT or opening the secondary side of the CT will cause high voltage on the secondary side of the CT, and may lead to equipment failure, electrical shock or a fire.

Do not short-circuit the secondary side of a VT circuit

Ensure that the secondary side of the VT is correctly connected to the VT connection terminals. Incorrect connection of the VT or short-circuiting the secondary side of the VT will cause a large overcurrent to flow through the VT secondary winding, which will lead to equipment failure, electrical shock or fire.

4 Precautions concerning preparation before use

Please read the following items before use.

(1) Transport

Avoid application of vibration and impact as much as possible during transport.

In situations where it is possible that transducers will be subject to excessive vibration or shock, remove the transducer from the panel before transportation.

(2) Check the model name and rating As a precautionary measure, check the model name and specifications such as input, output and auxiliary power supply before use.

(3) Adjustment

Generally, transducers are adjusted before shipment from the factory and do not require adjustment. To perform adjustment for matching with receiving-side equipment, perform adjustment while avoiding the application of excessive force to the adjusters. Not doing so may cause failure of the adjusters.

Avoid touching the adjusters in ordinary circumstances.

(4) Insulation resistance test and withstand voltage test Please read the following carefully before performing an insulation resistance test or voltage test. Not doing so may cause failure.

A CAUTION

Do not perform a withstand voltage test between input and output for non-isolated models

For instrumentation transducers where the input and output circuits are not insulated, do not perform withstand voltage testing between the input and output. Breakage will occur.

The withstand voltage test will cause the dielectric breakdown of internal elements, and may cause equipment failure or fire.

5 Usage precautions

Please pay attention to the following items during use.

A CAUTION

Use transducers according to their ratings

Use transducers according to their ratings. Not doing so may cause significant error, failure or fire due to overheating.

For input values outside the rating range, the output value will be outside the rating range.

Ensure the settings are correct

For models requiring settings, read the relevant instruction manual carefully before performing settings. Setting errors or unset items may cause abnormal operation and alarms may not function properly for receiving-side equipment; for example, if no value is set, no alarm will be activated for the output signal.

Do not lower the input voltage

With the active power, reactive power, power factor, phase angle and frequency transducers, an error may occur if the input voltage is outside the specified operating range (guaranteed value: 90~110% of the rated voltage).

Additionally, malfunction may occur if the input voltage drop is significant (less than 60% of the rated voltage).

6 Precautions concerning repair upon failure and treatment of abnormality

If an instrument malfunctions contact the nearest branch of Mitsubishi Electric System Service Co., Ltd. or Mitsubishi Electric.

Safety Precautions

7 Maintenance and inspection

Please pay attention to the following items regarding maintenance and inspection.

Refer to p.174 for details.

A CAUTION

Make sure to turn off the power for maintenance and inspections

When performing maintenance and inspections of transducers, be sure to turn off the power supply to the circuit connected to the transducer.

Electrical shock, electrical burns, equipment burnout or fire may occur if removal is attempted in the live-wire state.

8 Storage precautions

Do not store transducers for long periods in the following locations.

- ●Locations where the ambient temperature is outside the range of -20~60°C.
- ●Locations where the average daily temperature exceeds 35°C.
- ●Locations where the humidity is outside the range of 30%RH~85%RH (no condensation).
- Locations with excessive dust, corrosive gases, salinity or oil fumes.
- •Locations with excessive vibration or impact.
- •Locations directly exposed to rain and/or water drops.
- Locations where there are metal pieces or inductive substances present.

When storing transducers, turn off the power, remove the wiring such as those for input/output/auxiliary power supply and place in a plastic bag.

A CAUTION

Make sure to turn off the power before removal

In removing a transducer for storage, make sure to turn off the power supply of the circuit connected to the transducer.

Electrical shock, electrical burns, equipment burnout or fire may occur if removal is attempted in the live-wire state.

9 Disposal precautions

Dispose of the product appropriately according to the "Waste Management and Public Cleansing Law."

This product does not use batteries.

•WARRANTY

- •The warranty period is 1 year from the date of purchase or 18 months after manufacture, whichever is earlier. Even during the warranty period, repairs for failure due to an intentional or negligent act by the customer shall be charged.
- •Mitsubishi Electric shall not be liable for warranty against damages resulting from reasons not attributable to the company, opportunity loss and/or lost earnings on the customer's part due to malfunction of a Mitsubishi product, damages resulting from special circumstances whether foreseeable or unforeseeable by Mitsubishi, secondary damages, accident compensation, and damages and other services besides those of a Mitsubishi product.

Product service life

- The expected life of a transducer is 10 years.
 - * The expected service life is the period or number of operations for which the transducer can be used without functions deteriorating to a level that impairs practical use, on the condition that the equipment or materials are used in accordance with standard specification conditions. Please note that the expected service life is only a guide and performance is not guaranteed for this period. (Excerpt/Summary of "Expected Service Life of Electrical Equipment," in the September, 1998 issue of the Journal of the Institute of Electrical Installation Engineers of Japan.)

Recommended exchange period

•The recommended exchange period for transducers is seven years.

Requests Regarding Selection

1 For remote measurement, select a large output value.

When performing remote measurements, as a general rule, use a local transducer and ensure that transmissions are made according to the output side of the transducer; that is, ensure that the output side is not pulled over a long distance. Additionally, select a large output value; for example, 4~20mA.

2 Select an H or S Series model if the load resistance varies.

When the load resistance to be connected to the output terminals of a transducer is unknown, or where there is a possibility for future increases in load, select a constant-voltage, constant-current output transducer such as a model from the H or S series.

3 Select a model with an effective value if the input waveform becomes distorted.

AC-input transducers are calibrated based on sinusoidal input. In addition, depending on the model, error may occur when the input waveform is distorted due to the operating principle. Therefore, if there is waveform distortion, select an effective-value model with comparatively low error such as T-101SAA or T-101SAV.

4 Select a phase-angle transducer for unbalanced loads if the three-phase loads are unbalanced.

Phase-angle transducer errors may occur if the three-phase loads of balanced circuits become unbalanced. Select a phase-angle transducer for unbalanced loads such as T-101HPA(U) or T-101SPA(U) if it is possible that the three-phase load will be unbalanced.

5 Error may occur when the input current is extremely low (phase angle, power factor).

When using a phase angle or power factor transducer, error or malfunction may occur when the input current drops significantly lower than the rated current. Therefore, when selecting the rated primary current of a CT, ensure that the secondary current during actual use is 1/3 or more of the rated secondary current of the CT.

6 Check the electricity pulse unit (active and reactive).

Be certain to first check the restrictions applying to the value to be set for the electricity pulse unit (active and reactive) for multi-use transducers.

7 The standard bias/span ratio of the rated values of a transducer is 1/4 or less.

Cases where the bias/span ratio is larger than 1/4 can be supported by increasing the class index by multiples of 1/4 only.

- (Example 1) In the case where the output value is 4~20mA, the bias is 4mA, the span is 16 (=20-4)mA, and the bias/span ratio is thus 4/16=1/4.
- (Example 2) In the case where the output value is 12~20mA, the bias is 12mA, the span is 8 (=20-12)mA, and the bias/span ratio is thus 12/8=3/2. This is six times the abovementioned ratio of 1/4 and is accommodated by selecting a model with which the class index is multiplied by six; for example, if the class index is 0.25, 0.25×6 = class 1.5.




Power, Instrumentation and Peripheral

Products list

Power transducers

| Series | | K Series | | H Se | H Series | | S Series | | |
|-----------------------------|---------------------------------------|------------|---|---------------------------------------|--|---------------------------------------|--|--|--|
| Product name | Output form | Fixed load | Operation method | Constant voltage/ constant current | Operation method | Constant voltage/ constant current | Operation method | | |
| Current | (p.112) | T-51KAA | Average value rectification | T-51HAA | Approximate effective value rectification | T-101SAA | Effective value computation | | |
| | Saturated power (p.113) | T-51KSS | Average value rectification | T-51HSS | Approximate effective value rectification | _ | _ | | |
| Voltage | (p.114) T-51KAV T-51HAV T-51HAV | | Approximate effective value rectification | T-101SAV | Effective value computation | | | | |
| Active pow | ver (p.116) | _ | _ | T-101HW | Time division multiplication | T-101SW | Time division multiplication | | |
| Reactive po | wer (p.118) | _ | _ | T-101HVAR | Time division multiplication | T-101SVAR | Time division multiplication | | |
| Phase angle | 3-phase balanced circuit | _ | _ | T-101HPA | Phase discrimination | _ | _ | | |
| (p.120) | 3-phase unbalanced loads | _ | _ | T-101HPA (U) | Positive phase detection phase discrimination | T-101SPA (U) | Positive phase detection phase discrimination (integration type) | | |
| Power factor (p.122) | 3-phase unbalanced loads | _ | _ | T-101HPF (U) | Positive phase detection power factor correction | T-101SPF (U) | Positive phase detection power factor computation | | |
| Frequenc | y (p.124) | _ | _ | T-51HF | One-shot | T-101SF | Quartz oscillation frequency division | | |
| Voltage phase angle (p.125) | | _ | _ | _ | _ | T-101SY | Voltage phase discrimination | | |

Model Name Configuration

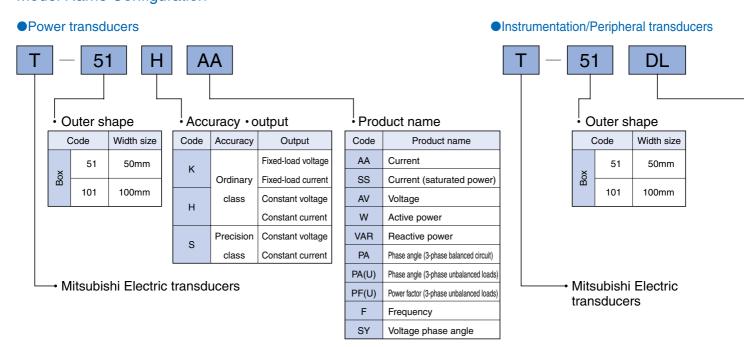

Transducers (Single Function)

Instrumentation transducers

| Pro | Model name | | | | | | |
|-------------|--------------------------------|----------|--|--|--|--|--|
| DC level (| p.126) | T-51DL | | | | | |
| DC revers | e (p.127) | T-51DR | | | | | |
| Isolator (p | .128) | T-101IS | | | | | |
| High-spee | T-101ISQ | | | | | | |
| Limiter (p. | Limiter (p.130) | | | | | | |
| Adder (p. | 131) | T-101AD | | | | | |
| | Resistance bulb (non-isolated) | T-51TP | | | | | |
| Temperature | Resistance bulb (isolated) | T-101TPZ | | | | | |
| (p.132) | Thermocouple (non-isolated) | T-101TC | | | | | |
| | Thermocouple (isolated) | | | | | | |
| First-orde | First-order lag (p.136) | | | | | | |

Peripheral transducers

| Pro | Model name | | | |
|------------------------|---------------------------------|---------------|--|--|
| AC current (moderate t | demand ime interval) (p.138) | T-101HAA (DS) | | |
| AC voltage (moderate t | demand ime interval) (p.139) | T-101HAV (DS) | | |
| Current tran | T-101HAA (D) | | | |
| Leakage (| Leakage current (p.142) | | | |
| | with built-in low-pass filter | T-51LGF | | |
| Voltage dro | op detector (p.146) | T-101VDL | | |
| Voltage rise | T-101VDH | | | |
| Filter (p.1 | 47) | T-51FA | | |

Product name (instrumentation)

| Code | Product name | | | |
|------|--|--|--|--|
| DL | DC level | | | |
| DR | DC reverse | | | |
| IS | Isolator | | | |
| ISQ | High-speed isolator | | | |
| LM | Limiter | | | |
| AD | Adder | | | |
| TP | Temperature (resistance bulb) [non-isolated] | | | |
| TPZ | Temperature (resistance bulb) [isolated] | | | |
| TC | Temperature (thermocouple) [non-isolated] | | | |
| TCZ | Temperature (thermocouple) [isolated] | | | |
| DS | First-order lag | | | |

Product name (peripheral)

| Code | Product name |
|----------|---|
| HAA (DS) | AC current demand (moderate time interval) |
| HAV (DS) | AC voltage demand (moderate time interval) |
| HAA (D) | Current transducer with power flow detection |
| LG | Leakage current |
| LGF | Leakage current (with built-in low-pass filter) |
| VDL | Voltage drop detector |
| VDH | Voltage rise detector |
| FA | Filter |



Current Transducers [Insulated]

T-51/T-101 Series





T-51HAA

T-101SAA

| Outer chane | Model | Accuracy | In | put (AC) | Output (DC) | Ripple/ Response | Consumption | Auxiliary power | Weight | Delivery period |
|-------------|----------|----------|----------|--------------|--|--------------------------------------|-------------|---|--------|--------------------|
| Oliter | name | (grade) | Current | Frequency | Voltage or current and load | speed | VA | supply | Wolgin | classification |
| | T-51KAA | 0.5 | 5A 1A | 50 and 60Hz | T-51KAA (*1) 1mA: specify 5kΩ or less 5mA: specify 1kΩ or less 100mV: specify 50kΩ or more 1V: specify 50kΩ or more 5V: specify 50kΩ or more | 5% P-P or less 1s or less | 0.4 | _ | 0.4kg | 0 |
| Box | T-51HAA | 0.5 | 5A 1A | 50 and 60Hz | •T-51HAA, T-101SAA 1mA: $0 \sim 5k\Omega$ 5mA: $0 \sim 1k\Omega$ 4~20mA: $0 \sim 600\Omega$ 100mV: $5k\Omega \sim \infty$ 1V: $5k\Omega \sim \infty$ 5V: $5k\Omega \sim \infty$ 10V: $10k\Omega \sim \infty$ 1~5V: $5k\Omega \sim \infty$ | 1% P-P or less 1s or less | 0.1 | 110VAC ⁻¹⁰ % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |
| | T-101SAA | 0.25 | 5A 1A | 50Hz or 60Hz | | 1% P-P or less 0.5s or less | 0.1 | 110VAC ⁻¹⁰ % 50 and 60Hz Consumption VA: 3 | 0.6kg | Δ |

The load resistance connected to T-51KAA is fixed. In the case of current output, please specify a resistance value no more than that shown in the table above; specify a resistance value no less than that shown in the table above in the case of voltage output.

*2 Error may occur when the input waveform is distorted. For example, when the third harmonic content is 15%, the error is approx. ±5% for T-51KAA, ±2% for T-51HAA and $\pm 0.2\%$ for T-101SAA.

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | ∆Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Syllibol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |


Number of units

■Manufacturable range


| | | T-51KAA | T-51HAA | T-101SAA | |
|-----------|----|----------|--------------------------------|----------|--|
| Inpu | t | 0.1~7.5A | 0.1~5A | | |
| 0 | | 0.1~5mA | 0.1~20mA | | |
| Outp | ut | 50mV~5V | / 50mV~10V | | |
| Auxiliary | ^ | _ | 100, 105, 110, 115, 120V +10 % | | |
| power | | | 200, 210, 220, 230, 240V 15 % | | |
| supply | DC | | 24V, 100~120V | 24V±10% | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$. The voltage tolerance of a 100~120VDC auxiliary power supply is ¹⁵/₂₅ %.

■Input/Output relationships

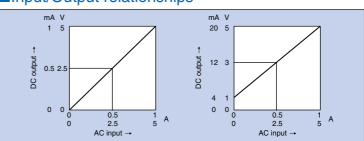

Connection diagrams (Refer to p.156 for outer dimensions.)

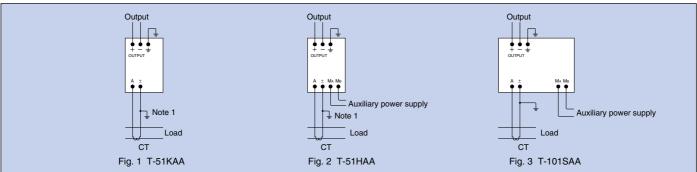

Note 1. For low-voltage circuits, grounding of the secondary side of the current transformer is unnecessary.

Ordering method

| K Series | Model name | Input Current | Output Voltage or current | Load resistance | Number of units |
|----------------------------|------------|------------------|------------------------------|------------------------------|------------------------|
| | T-51KAA | 5A | 0-1mA | 5kΩ | 15 |
| H Series | Model name | Input Current | Frequency | Output Voltage or current | Auxiliary power supply |
| S Series | T-51HAA | 5A | | 4-20mA | 110VAC |

Specify in the case of S Series.



Current Transducers (Saturated Power) [Insulated]

T-51/T-101 Series

Suited for motor circuits, heater circuits and other circuits in which an overcurrent flows during startup.





T-51HS

| Outer shape | Model | Accuracy | Inpu | t (AC) | Output (DC) | Ripple/ Response | Consumption | Auxiliary power | Weight | Delivery period |
|-------------|---------|----------|-------------------|-------------|---|------------------------------------|-------------|---|----------|--------------------|
| Outer | name | (grade) | Current | Frequency | Voltage or current and load | speed | VA | supply | VVCigiti | classification |
| Box | T-51KSS | 0.5 | 0~5~15A 0~1~3A | 50 and 60Hz | ●T-51KSS (*1) 0~0.8~(1)mA : specify 5kΩ or less 0~4~(5)V : specify 50kΩ or less | 5% P-P or less 1s or less | 0.4 | П | 0.4kg | 0 |
| ā | T-51HSS | 0.5 | 0~5~15A 0~1~3A | 50 and 60Hz | ●T-51HSS 0~0.8~(1)mA : 0~5kΩ 4~16~(20)mA : 0~600Ω 0~4~(5)V : 5kΩ~∞ 0~8~(10)V : 10kΩ~∞ | 1% P-P or less 1s or less | 0.1 | 110VAC ⁺¹⁰ % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |

^{*1} The load resistance connected to T-51KSS is fixed. In the case of current output, please specify a resistance value no more than that shown in the table above; specify a resistance value no less than that shown in the table above in the case of voltage output.

- ² Models with 2- to 5-times expanded saturated power can also be manufactured.
- *3 Error may occur when the input waveform is distorted.

 For example, when the third harmonic content is 15%, the error is approx. ±5% for T-51KSS and ±2% for T-51HSS
- *4 The tolerance of the maximum saturated power is within ±10% (% in respect to saturated power value).

Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

Manufacturable range


| | | T-51KSS | T-51HSS | | |
|-----------|----|--|--|--|--|
| Input | | 0.1~7.5A | 0.1~5A | | |
| Outpu | ut | Only specifications in the table above | 0.1~20mA 50mV~10V | | |
| Auxiliary | AC | _ | 100, 105, 110, 115, 120V _{*10} % 200, 210, 220, 230, 240V | | |
| power | | | 200, 210, 220, 230, 240V -15 /0 | | |
| | DC | _ | 24V, 100~120V | | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$. The voltage tolerance of a 100~120VDC auxiliary power supply is $^{15}_{-2}\%$.

■Input/Output relationships

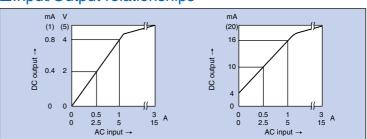

Connection diagrams (Refer to p.156 for outer dimensions.)

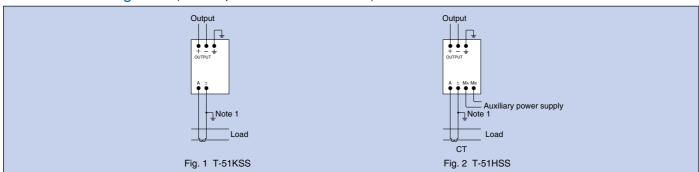

Note 1. For low-voltage circuits, grounding of the secondary side of the current transformer is unnecessary.

■Ordering method

H Series

| Model name | | Input Current | | Output Voltage or current | | Load resistance | | Number of units |
|------------|--|------------------|--|------------------------------|--|------------------------|--|-----------------|
| T-51KSS | | 0-5-15A | | 0-0.8-1mA | | 3kΩ | | 10 |
| Model name | | Input Current | | Output Voltage or current | | Auxiliary power supply | | Number of units |
| T-51HSS | | 0-5-15A | | 4-16-20mA | | 110VAC | | 20 |
| | | | | | | | | |



Voltage Transducers [Insulated]

T-51/T-101 Series





| Outer shape | Model | Accuracy | Inj | put (AC) | Output (DC) | Ripple/ Response | Consumption | Auxiliary power | Weight | Delivery period |
|-------------|----------|----------|--------------|--------------|--|--------------------------------------|------------------------|---|---------|--------------------|
| Outer | name | (grade) | Voltage | Frequency | Voltage or current and load | speed | VA | supply | vvoigni | classification |
| | T-51KAV | 0.5 | 150V 300V | 50 and 60Hz | T-51KAV (*1) 1mA: specify 5kΩ or less 5mA: specify 1kΩ or less 100mV: specify 50kΩ or more 1V: specify 50kΩ or more 5V: specify 50kΩ or more | 5% P-P or less 1s or less | 1.4 | _ | 0.4kg | 0 |
| Вох | T-51HAV | 0.5 | 150V 300V | 50 and 60Hz | ●T-51HAV, T-101SAV $1mA: 0 \sim 5k\Omega$ $5mA: 0 \sim 1k\Omega$ $4 \sim 20mA: 0 \sim 600\Omega$ $100mV: 5kΩ \sim \infty$ $1V: 5kΩ \sim \infty$ $5V: 5kΩ \sim \infty$ $10V: 10kΩ \sim \infty$ $1 \sim 5V: 5kΩ \sim \infty$ | 1% P-P or less 1s or less | 150V: 0.4 300V: 0.8 | 110VAC **10 % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |
| | T-101SAV | 0.25 | 150V 300V | 50Hz or 60Hz | | 1% P-P or less 0.5s or less | 150V: 0.4 300V: 0.8 | 110VAC ^{:10} % 50 and 60Hz Consumption VA: 3 | 0.6kg | Δ |

^{*1} The load resistance connected to T-51KAV is fixed. In the case of current output, please specify a resistance value no more than that shown in the table above; specify a resistance value no less than that shown in the table above in the case of voltage output.

| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Gymbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

^{*2} Error may occur when the input waveform is distorted. For example, when the third harmonic content is 15%, the error is approx. $\pm 5\%$ for T-51KAV, $\pm 2\%$ for T-51HAV and $\pm 0.2\%$ for T-101SAV.


■Manufacturable range

| | | T-51KAV | T-51HAV | T-101SAV | | |
|-----------|----|---------|---|-----------------------------|--|--|
| Input | | 50~300V | | | | |
| 0 | | 0.1~5mA | 0.1~20mA | | | |
| Outp | Jι | 50mV~5V | 50mV~5V 50mV~10V | | | |
| Auxiliary | ۸۵ | | 100, 105, 110, | 115, 120V _{+10,07} | | |
| power | AC | | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | | | |
| supply | DC | _ | 24V, 100~120V | 24V±10% | | |


The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$.

The voltage tolerance of a 100~120VDC auxiliary power supply is *15 %.

■Input/Output relationships

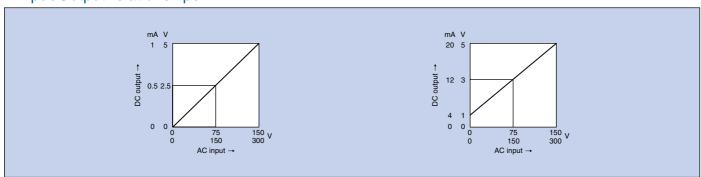

■Connection diagrams (Refer to p.156 for outer dimensions.)

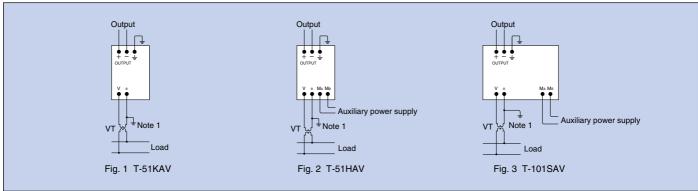

Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

■Ordering method K Series Model name Load resistance Number of units T-51KAV 0-5V 10 150V $50 \text{k}\Omega$ H Series Number of units Model name Frequency Auxiliary power supply S Series T-101SAV 110VAC 150V 60Hz 4-20mA

Specify in the case of S Series.



Active Power Transducers [Insulated]

T-51/T-101 Series



T-101HW

| shape | Model | racy de) | | | Inp | ut (AC) | | Output (DC) | Ripple/ | Consum | ption VA | Auxiliary | Moight | Delivery |
|-------------|---------|---------------------|--------------------|---|-----------|----------------------------|---------------|-----------------------------|-----------------|--------------------|------------------------------------|-------------------------------|--------|-----------------------|
| Outer shape | name | Accuracy (grade) | Phase- wire | Voltage | Current | Inherent active power (P0) | Frequency | Voltage or current and load | Response speed | Current circuit | Voltage circuit | power supply | Weight | period classification |
| | | | ē | 110V | 5A | 0.25~0.6kW | | | | | 0.6 | | | |
| | | | 2-wire | 1100 | 1A | 0.05~0.12kW | | | | 0.2 | 0.6 | | | |
| | | | 1-phase | 0001 | 5A | 0.5~1.2kW | | 1mA : 0~5kΩ | | 0.2 | 1.0 | | | |
| | | | ÷ | 220V | 1A | 0.1~0.24kW | | 5mA : 0~1kΩ | | | 1.2 | | | |
| | | | 1-phase 3-wire | 100/000/ | 5A | 0.5~1.2kW | | 4 004 0 0000 | | I1 0.1 | Po-P10.3 | | | |
| | | | 1-phase | 100/200V | 1A | 0.1~0.24kW | | 4~20mA : 0~600Ω | 10/ D.D. | I2 0.1 | Po-P20.3 | 110VAC | | |
| | | ē | 44614 | 5A | 0.5~1.2kW | 50 and | 100mV : 5kΩ~∞ | 1% P-P or less | P1-P20.3 | +10 % -15 % | 0.6kg | | | |
| | T-101HW | 0.5 | 3-wi | 110V | 1A | 0.1~0.24kW | 60Hz | 1V : 5kΩ~∞ | 0.5s | I ₁ 0.1 | P2-P30.3 | 50 and 60Hz Consumption | | 0 |
| | | | 3-phase 3-wire | 0001 | 5A | 1.0~2.4kW | | 5V - 5I-O | or less | Is 0.1 | P1-P20.6 | VA: 3 | | |
| | | | ج. ا | 220V | 1A | 0.2~0.48kW | | 5V : 5kΩ~∞ | | | P2-P30.6 | | | |
| | | | ē | 110 /110// | 5A | 0.5~1.2kW | | 10V : 10kΩ~∞ | | I ₁ 0.1 | P ₀ -P ₁ 0.2 | | | |
| | | | 4-wi | $\frac{110}{\sqrt{3}}$ /110V | 1A | 0.1~0.24kW | | 1~5V : 5kΩ~∞ | | | Po-P30.2 | 2 | | |
| | | | 3-phase 4-wire | 110/190V | 5A | 0.86~2.07kW | | | | I2 0.2 | P ₀ -P ₁ 0.3 | | | |
| Box | | | ج- ا | 110/1900 | 1A | 0.17~0.40kW | | | | I3 0.1 | Po-P30.3 | | | |
| ă | | | ē | 110V | 5A | 0.25~0.6kW | | | | | 0.6 | | | |
| | | | 2-wire | 1100 | 1A | 0.05~0.12kW | | | | 0.2 | 0.6 | | | |
| | | | -phase 220V | 5A | 0.5~1.2kW | | 1mA : 0~5kΩ | 0.2 | 0.2 | 1.0 | | | | |
| | | | - | 220V | 1A | 0.1~0.24kW | | 5mA : 0~1kΩ | | | 1.2 | | | |
| | | | 1-phase 3-wire | 100/200V | 5A | 0.5~1.2kW | | 4~20mA : 0~600Ω | | I1 0.1 | Po-P10.3 | | | |
| | | | 1-phas | 100/2000 | 1A | 0.1~0.24kW | | 4~20IIIA : 0~00032 | 1% P-P | I2 0.1 | Po-P20.3 | 110VAC | | |
| | T-101SW | 0.25 | <u>e</u> | 110V | 5A | 0.5~1.2kW | 50Hz or | 100mV : 5kΩ~∞ | or less | I ₁ 0.1 | P1-P20.3 | +10 % -15 % 50 and 60Hz | 0.6kg | Δ |
| | 1-1010 | 0.23 | e 3-wire | 1100 | 1A | 0.1~0.24kW | 60Hz | 1V : 5kΩ~∞ | 0.5s or less | 110.1 | P2-P30.3 | Consumption | 0.0kg | |
| | | | 3-phase | 220V | 5A | 1.0~2.4kW | | 5V : 5kΩ~∞ | 01 1000 | I3 0.1 | P1-P20.6 | VA: 3 | | |
| | | | မ | 2200 | 1A | 0.2~0.48kW | | 3V . 3K22~60 | | 13 0.1 | P2-P30.6 | 5 | | |
| | | | <u>e</u> | $\frac{110}{\sqrt{3}}$ /110V | 5A | 0.5~1.2kW | | 10V : 10kΩ~∞ | | I ₁ 0.1 | Po-P10.2 | | | |
| | | | e 4-w | √3 /1100 | 1A | 0.1~0.24kW | | 1~5V : 5kΩ~∞ | | I ₂ 0.2 | Po-P30.2 | | | |
| | | | 3-phase 4-wire | 988 97 98 98 98 98 98 98 98 98 98 98 98 98 98 | 5A | 0.86~2.07kW | | | | I3 0.1 | Po-P10.3 | | | |
| | | | က် | 110/1900 | 1A | 0.17~0.40kW | | | | 13 0.1 | Po-P30.3 | | | |

■Manufacturable range

| | | T-101HW T-101SW | | | | |
|-----------------|----|--|---------|--|--|--|
| Inpu | t | Within the range of the inherent active power (Po) in the table above *1 | | | | |
| Outpu | ut | 0.1~20mA 50mV~10V *2 | | | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V -15 % | | | | |
| supply | DC | 24V, 100~120V | 24V±10% | | | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%.$

The voltage tolerance of a 100~120VDC auxiliary power supply is $^{+15}_{-25}$ %.

Delivery period classification

| Symbol | | Quasi-standard product | △Special product |
|---------------------------|--------------------|------------------------|------------------|
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

- *1 Please specify an inherent active power value for the transducer (i.e., input rating of the active power transducer) within the range in the table above.
- *2 The manufacturable range for bidirectional current output is ±0.1~±5mA. Positive/negative bidirectional output models for positive/negative bidirectional inputs accompanying power flow and positive direction output-only models can also be manufactured.

| xample) | Input | Out | tput | | | |
|---------|------------|----------|------------|--|--|--|
| | -1kW~0~1kW | -1~0~1mA | 0~0.5~1mA | | | |
| | | -5~0~5V | 4~12~20mA | | | |
| | | | 0~50~100mV | | | |
| | | | 0~2.5~5V | | | |

■"Inherent active power" of active power transducers

An active power transducer can be manufactured if the transducer's inherent active power $\left(P_{_{0}} = \frac{\text{primary-side active power (kW)}}{\text{VT ratio} \times \text{CT ratio}}\right)$

is within the range of the table on the left.


In the case of positive/negative bidirectional input, calculate using the larger of the positive or negative active powers.

■Inherent active power value calculation example


In the case of a 3-phase, 3-wire, VT 6600/110V, CT 200/5A arrangement with the primary side power being 2000kW:

Transducer inherent active power
$$P_0 = \frac{\text{primary-side active power (kW)}}{\text{VT ratio} \times \text{CT ratio}} = \frac{2000 \text{kW}}{6600/110 \times 200/5} = 0.833 \text{ (kW)}$$


■Input/Output relationships

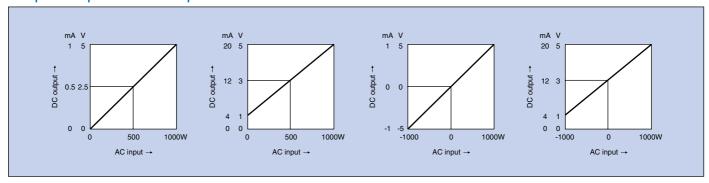

Connection diagrams (Refer to p.156 for outer dimensions.)

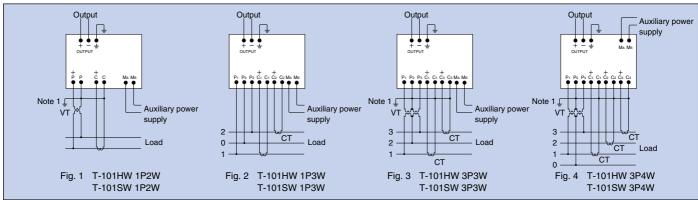

Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transfomer and current transformer is unnecessary.



^{*} The primary-side active power (kW) mentioned here is not the full-load active power based on the VT-CT rating. It refers to the active power value kW (i.e., primary-side active power value corresponding to the rated output value) to be controlled according to the load state (e.g., light load). (equivalent to the scale of the indicator)



Reactive Power Transducers

T-51/T-101 Series



T-101HVAR

| hape | Model | acy de) | | | In | put (AC) | | Output (DC) | Ripple/ | Consum | ption VA | Auxiliary | VA / - 1 - 1 - 1 | Delivery | | | |
|-------------|-------------|---------------------|----------------|------------------------------|---------|----------------------------|--------------|--|-------------------|--------------------|-------------------------------------|-----------------|------------------|--------------------------|--|--|--|
| Outer shape | name | Accuracy (grade) | Phase- wire | Voltage | Current | Inherent active power (Qo) | Frequency | Voltage or current and load | Response speed | Current circuit | Voltage circuit | power supply | Weight | period classification | | | |
| | | | | 110V | 5A | 0.5 ~1.2kvar | | | | | P1-P20.3 | | | | | | |
| | | | 3-phase 3-wire | | 1A | 0.1 ~0.24kvar | | | | I ₁ 0.1 | P2-P30.3 | | | | | | |
| | | | 3-phas | 0001/ | 5A | 1.0 ~2.4kvar | | –1~0~1mA : 0~5kΩ | | I3 0.1 | P1-P20.6 | | | | | | |
| | T 404111415 | | | 220V | 1A | 0.2 ~0.48kvar | 50 and | –5~0~5mA : 0~1kΩ | 1% P-P or less | | P2-P30.6 | 110VAC +10 % | | | | | |
| | T-101HVAR | 0.5 | | 110 | 5A | 0.5 ~1.2kvar | 60Hz | –100~0~100mV : 5kΩ~∞ | 0.5s or less | P1-P20.3 | 50 and 60Hz Consumption VA: 3 | 0.6kg | 0 | | | | |
| | | | 4-wire | $\frac{110}{\sqrt{3}}$ /110V | 1A | 0.1 ~0.24kvar | | –1~0~1V : 5kΩ~∞ | | I ₁ 0.1 | P2-P30.3 | | | | | | |
| | | | 3-phase 4-wire | 110/190V | 5A | 0.86~2.07kvar | | -5~0~5V : 5kΩ~∞ -10~0~10V : 10kΩ~∞ | | I ₂ 0.2 | P1-P20.5 | | | | | | |
| × | | | | | 1A | 0.17~0.40kvar | | 0~0.5~1mA : 0~5kΩ | | | P2-P30.5 | | | | | | |
| Box | | | 3-phase 3-wire | | 1101/ | 5A | 0.5 ~1.2kvar | | 0~2.5~5mA : 0~1kΩ | | | P1-P20.3 | | | | | |
| | | | | 110V | 1A | 0.1 ~0.24kvar | | 4~12~20mA : 0~600Ω | | I ₁ 0.1 | P2-P30.3 | | | | | | |
| | | | | 2221 | 5A | 1.0 ~2.4kvar | | 0~50~100mV : 5kΩ~∞ 0~0.5~1V : 5kΩ~∞ | | I2 0.2 I3 0.1 | P1-P20.6 | | | | | | |
| | T 4040VAD | 0.05 | | 220V | 1A | 0.2 ~0.48kvar | 50Hz | 0~2.5~5V : 5kΩ~∞ | 1% P-P or less | | P2-P30.6 | 110VAC +10 % | 0.01 | | | | |
| | T-101SVAR | 0.25 | | 110 (440) | 5A | 0.5 ~1.2kvar | or 60Hz | 0~5~10V : 10kΩ~∞ | 0.5s or less | | P1-P20.3 | VA: 3 | 0.6kg | Δ | | | |
| | | | 3 4-wire | $\frac{110}{\sqrt{3}}$ /110V | 1A | 0.1 ~0.24kvar | | 1~3~5V : 5kΩ~∞ | | I ₁ 0.1 | P2-P30.3 | | | | | | |
| | | | 3-phase 4-wire | | | 3-phase 4 | | 5A | 0.86~2.07kvar | | | | I2 0.2 I3 0.1 | P1-P20.5 | | | |
| | | | | 110/190V | 1A | 0.17~0.40kvar | | | | | P2-P30.5 | | | | | | |

■Manufacturable range

| | <u> </u> | | | | | | | | |
|-----------------|----------|---|-----------|--|--|--|--|--|--|
| | | T-101HVAR | T-101SVAR | | | | | | |
| Input | | Within the range of the inherent reactive power (Qo) in the table above. *1 | | | | | | | |
| Outp | ut | 0.1~20mA, 50mV~10V *2 | | | | | | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | | | | | | | |
| supply | DC | 24V, 100~120V | 24V±10% | | | | | | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$. The voltage tolerance of a 100~120VDC auxiliary power supply is $^{15}_{28}\%$.

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | ∆Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Syllibol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

- *1 Please specify the inherent reactive power value of the transducer within the range in the table above.

 The reactive power transducer has bidirectional inputs for lead (LEAD) and lag (LAG) of the phase.
- *2 The manufacturable range for a bidirectional current output is ±0.1~±5mA.

 Unidirectional input and unidirectional output for the lag side (LAG) or the lead side (LEAD) can also be manufactured.

 Please specify LAG or LEAD.

| (Example) | Input | Output | | |
|-----------|--------------|---------|--|--|
| | LAG 0~1kvar | 0~1mA | | |
| | | 4~20mA | | |
| | LEAD 0~1kvar | 0~100mV | | |
| | | 0~5V | | |

[Insulated]

■"Inherent reactive power" of reactive power transducers

A reactive power transducer can be manufactured if the transducer inherent reactive power $\left(\mathbf{Q}_{_{0}} = \frac{\text{primary-side reactive power (kvar)}}{\text{VT ratio} \times \text{CT ratio}}\right)$

is within the range of the table on the left.


In the case of bidirectional input, calculate using the larger of the lag or lead reactive powers.

■Inherent reactive power value calculation example


In the case of a 3-phase, 3-wire, VT 6600/110V, CT 200/5A arrangement with the primary-side reactive power being 1200kvar:

Transducer inherent reactive power
$$Q_0 = \frac{\text{primary-side reactive power (kvar)}}{\text{VT ratio} \times \text{CT ratio}} = \frac{1200 \text{kvar}}{6600/110 \times 200/5} = 0.500 \text{ (kvar)}$$

■Input/Output relationships

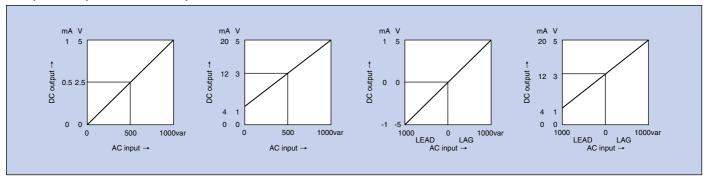


Connection diagrams (Refer to p.156 for outer dimensions.)

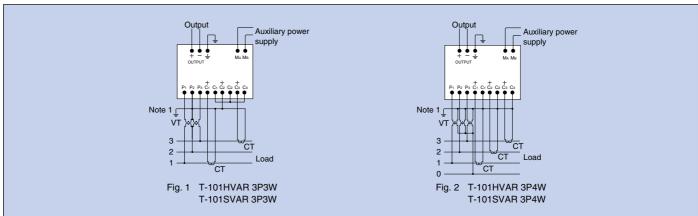

- *3 In the case of unidirectional input, the lag side (LAG) is the reactive power unless particularly specified.
- *4 A CT must be inserted and used in the current circuit because reactive power transducers are three-current systems.
- *5 Operation will be abnormal when the input of the three-phase circuit is a negative-phase sequence.

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

Ordering method



In the case of 3-phase, 4-wire,
 please specify the phase
 voltage and line voltage.

- Please specify in the case of S Series.

- Although manufacturing will be performed even when specified in kvar units, the specifications will be converted to var units on the rating nameplate.

^{*} The primary-side reactive power (kvar) mentioned here is not the full-load reactive power based on the VT-CT rating. It refers to the reactive power value kvar (primary-side reactive power value equivalent to the rated output value) to be controlled according to the power factor.



Phase Angle Transducers [Insulated]

T-51/T-101 Series



T-101HPA (U)

| 9 | | >- | | | | . (4.0) | | 2 (2.2) | Pinnlo/ | | | Auxiliary | (-) | Delivery |
|-------------|---------------|---------------------|-----------------------------------|------------|----------|--------------------|-----------------|--|---------------------|---------------------------|----------------------|---|--------|----------------|
| Outer shape | Model name | Accuracy (grade) | Phase- | | 1 | t (AC) | _ | Output (DC) | Ripple/ Response | | ption VA | power | Weight | period |
| <u>S</u> | Tiarrie | Q Q | wire | Voltage | Current | Phase angle | Frequency | Voltage or current and load | speed | Current circuit | Voltage circuit | supply | | classification |
| | TAGALIDA | 2.0 | balanced circuit) | 110V | 5A 1A | LEAD 60° | 50 and | | 1% P-P | | 0.3 | | 0.6kg | |
| | T-101HPA | 2.0 | 3-phase 3-wire (balanced circuit) | 220V | 5A 1A | LAG 60° | 60Hz | –1~0~1mA : 0~5kΩ | 1s or less | 0.1 | 0.6 | | 0.6kg | 0 |
| | | | | 110V | 5A 1A | _ | | –5~0~5mA : 0~1kΩ –100~0~100mV : 5kΩ~∞ | | I1 0.1 | 0.3 | 110VAC | | |
| | T4041DA ((1)) | 0.0 | 3-phase 3-wire (unbalanced loads) | 220V | 5A 1A | LEAD 60° | 50Hz or 60Hz | -1~0~1V : 5kΩ~∞ -5~0~5V : 5kΩ~∞ | 1% P-P or less | I3 0.1 | 0.6 | 50 and 60Hz Consumption VA: 3 | 0.6kg | |
| × | T-101HPA (U) | 2.0 | 3-phase 4-wire | 110 /1101/ | 5A 1A | 0° ≀ LAG 60° | | -10~0~10V : 10kΩ~∞ 0~0.5~1mA : 0~5kΩ | 1s or less | I ₁ 0.1 | 0.3 | | | 0 |
| Box | | | 3-phase | 110/190V | 5A 1A | | | 0~2.5~5mA : 0~1kΩ 4~12~20mA : 0~600Ω | | I3 0.1 | 0.5 | | | |
| | | | 3-phase 3-wire (unbalanced loads) | 110V | 5A 1A | | | 0~50~100mV : 5kΩ~∞ 0~0.5~1V : 5kΩ~∞ | | 0.3 I ₁ 0.1 | 0.3 | | | |
| | T-101SPA (U) | 1.0 | 3-phase 3-wire (| 220V | 5A 1A | - LEAD 60° | 50Hz or | 0~2.5~5V : 5kΩ~∞ 0~5~10V : 10kΩ~∞ | 1% P-P or less | I3 0.1 | 0.6 | 110VAC +10 % -15 % 50 and 60Hz | 0.6kg | Δ |
| | (0) | | 5A ? | | | 60Hz | 1~3~5V∶5kΩ~∞ | 1s or less | I ₁ 0.1 | 0.3 | Consumption VA: 3 | | | |
| | | 98 pd c | | | | I3 0.1 | 0.5 | | | | | | | |

■Manufacturable range

| | | lactarable range | | | | | |
|-----------------|----|-------------------------------------|---|--|--|--|--|
| | | T-101HPA, T-101HPA (U) | T-101SPA (U) | | | | |
| Inpu | t | As indicated in the table above. *1 | | | | | |
| Outpo | ut | 0.1~20mA, 5 | 0mV~10V *2 | | | | |
| Auxiliary power | AC | 100, 105, 110, 200, 210, 220, | 115, 120V ₁₁₀ % 230, 240V -15 % | | | | |
| supply | DC | 24V, 100~120V | 24V±10% | | | | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$. The voltage tolerance of a 100~120VDC auxiliary power supply is $^{15}_{28}\%$.

| *1 | The error | increases | when | the input | current | decreaes |
|----|-----------|-----------|------|-----------|---------|----------|

- ●T-101HPA ...1/5 of the rated current or less
- ●T-101HPA(U) ... 1/5 of the rated current or less
- ●T-101SPA(U) ...1/10 of the rated current or less
- $^{\star}2$ The manufacturable range for a bidirectional current output is $\pm 0.1 \sim \pm 5$ mA.

Delivery period classification


Reference delivery period Immediate delivery Within 20 days

Symbol


product

21 to 60 days

■Input/Output relationships

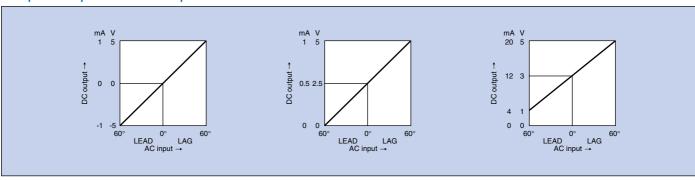

■Connection diagrams (Refer to p.156 for outer dimensions.)

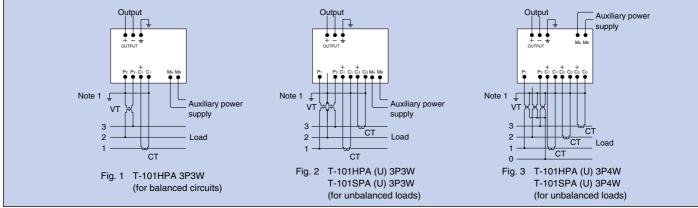

- *3 When only the auxiliary power supply is applied, a value close to a phase angle of 0° (power factor of 1) is output.
- *4 Use a transducer "for unbalanced loads" if there is a possibility for the 3-phase load to become unbalanced.
- *5 With transducers for both balanced circuits and unbalanced loads, an error may occur when the 3-phase voltage becomes unbalanced.
- *6 Operation will be abnormal when the input is a negative-phase sequence.

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

| Model name | | | Input | | Fraguena. | Output | Audion nower aunalu | Number of units |
|--------------|------------|---------|---------|------------------|-----------|--------------------|------------------------|-----------------|
| woder name | Phase-wire | Voltage | Current | Phase angle | Frequency | Voltage or current | Auxiliary power supply | Number of units |
| T-101HPA (U) | 3P3W | 110V | 5A | LEAD60°-0-LAG60° | 60Hz | 4–12–20mA | 110VAC | 5 |



Power Factor Transducers

T-51/T-101 Series



T-101HPF (U)

| e. | | 50 | | | Inpu | t (AC) | | | Output (DC) | | » T | Consumpt | | | Ħ | eriod tion | | |
|-------------|---------------|---------------------|----------------|------------------------------|---------|----------------|------------|--|--|---|------------------------------|--|-----------------|----------------------------|------------------|--------------------------------|--|--|
| Outer shape | Model name | Accuracy (grade) | Phase- wire | Voltage | Current | Power factor | Frequency | Characteristics | Voltage or current and load | d | Ripple/ Response speed | Current | Voltage circuit | Auxiliary powersupply | Weight | Delivery period classification | | |
| 3 | | P AC | Pha | vollage | Cur | 1 ower lactor | rrequeries | Charac | Output | SGN | . В В » | Our | Voltage | р | > | Deliv | | |
| | | | Φ | 110V | 5A | | | | –1~0~1mA : 0~5kΩ | | | | 0.3 | | | | | |
| | | | 3-wire | | 1A | | | -5 ~0~5mA : 0~1kΩ -100 ~0~100mV : 5kΩ~ ∞ -1 ~0~1V : 5kΩ~ ∞ | | | I ₁ 0.1 | | | | | | | |
| | | | 3-phase | | 5A | | | | -1~0~1V : 5kΩ~∞ -5~0~5V : 5kΩ~∞ | | I3 0.1 | | | | | | | |
| | | | 3-p | 220V | 5A | LEAD LAG | 50Hz | | | | | | 0.6 | 110VAC | | | | |
| | | | | | 1A | 0.5~1~0.5 | | 50Hz | -10~0~10V : 10kΩ~∞ 0~0.5~1mA : 0~5kΩ | | 1% P-P or less | | | +10 % -15 % | 0.6 | | | |
| | T-101HPF (U) | 3.0 | | | 5A | or LEAD LAG | or | 3 | 0~2.5~5mA : 0~1kΩ | _ | 1s | | | 50 and 60Hz Consumption | kg | 0 | | |
| | | | ē | $\frac{110}{\sqrt{3}}$ /110V | - O, t | 0~1~0 | 60Hz | | 4~12~20mA : 0~600Ω 0~50~100mV : 5kΩ~∞ | | or less | | 0.3 | VA: 3 | | | | |
| | | | 4-wi | | 1A | | | | 0~50~10011V : 5kΩ~∞ 0~0.5~1V : 5kΩ~∞ | | | I1 0.1 | | | | | | |
| | | | 3-phase 4-wire | | 5A | | | | | | | 0~2.5~5V : 5kΩ~∞ | | | I2 0.1 I3 0.1 | | | |
| | | | <u>е</u> | 110/190V | | | | | 0~5~10V : 10kΩ~∞ 1~3~5V : 5kΩ~∞ | | | | 0.5 | | | | | |
| Box | | | | | 1A | | | | | | | | | | | | | |
| ă | | | | 44014 | 5A | | | 1 | 1 | 0~-1/1~0V : 5kΩ~∞ 0~-5/5~0V : 5kΩ~∞ (input LEAD 0~1~0 LAG only) | - | | | | | | | |
| | | | 3-phase 3-wire | 110V | 1A | | | | 0 1 0mA : 0 5k0 | LEAD 1Vmax LAG | | I3 0.1 | 0.3 | | | | | |
| | | | лаѕе | | 5A | - | | | (input LEAD 0~1~0 LAG only) | 5V ±0.5V | | | | | | | | |
| | | | 3-p | 220V | - JA | LEAD LAG | | | –1~0~1mA : 0~5kΩ –5~0~5mA : 0~1kΩ | | 1% P-P | | 0.6 | 110VAC | | | | |
| | T 4040DE (11) | | | | 1A | 0.5~1~0.5 | | | -5~0~5πA : 0~ πs2 -100~0~100mV : 5kΩ~∞ -1~0~1V : 5kΩ~∞ | | or less | | | +10 % | 0.6 | | | |
| | T-101SPF (U) | 2.0 | | | 5A | or LEAD LAG | or 60Hz | | -1~0~1V : 5κΩ~∞ -5~0~5V : 5kΩ~∞ -10~0~10V : 10kΩ~∞ | | 1s or less | | | 50 and 60Hz Consumption | kg | Δ | | |
| | | | vire | $\frac{110}{\sqrt{3}}$ /110V | | 0~1~0 | 00112 | 3 | 0~0.5~1mA : 0~5kΩ | _ | oriess | | 0.3 | VA: 3 | | | | |
| | | | 3e 4-v | | 1A | | | | 0~2.5~5mA : 0~1kΩ 4~12~20mA : 0~600Ω | | | I ₁ 0.1 I ₂ 0.2 | | | | | | |
| | | | 3-phase 4-wire | | 5A | | | | 0~50~100mV : 5kΩ~∞ 0~0.5~1V : 5kΩ~∞ | | | Is 0.1 | | | | | | |
| | | | 8 | 110/190V | 1A | | | | 0~2.5~5V : 5kΩ~∞ 0~5~10V : 10kΩ~∞ 1~3~5V : 5kΩ~∞ | | | | 0.5 | | | | | |

■Manufacturable range

| | | T-101HPF (U) | T-101SPF (U) | | | | |
|-----------------|----|------------------------------------|------------------------------------|--|--|--|--|
| Inpu | t | As indicated in the table above *1 | | | | | |
| Outpo | ut | 0.1~20mA, 50mV~10V *2 | | | | | |
| Auxiliary power | AC | 100, 105, 110, 200, 210, 220, | 115, 120V +10 % 230, 240V -15 % | | | | |
| supply | DC | 24V, 100~120V | 24V±10% | | | | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$. The voltage tolerance of a 100~120VDC auxiliary power supply is $^{15}_{-25}\%$.

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Symbol | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |


- The error increases when the input current decreases.
 - ●T-101HPF(U) ...1/5 of the rated current or less
 - $\bullet \text{T-}101\text{SPF}(\text{U})$... 1/10 of the rated current or less
- *2 The manufacturable range for a bidirectional current output is $\pm 0.1 \sim \pm 5 mA$. Output specifications
 - •As indicated in the "Input/Output relationships," the outputs of a power factor transducer include an output (Output) proportional to the power factor and a lead/lag distinguishing output (SGN). The output characteristics are classified according to characteristics 1 to 3 (only the model with the characteristic of 3 is manufactured as the T-101HPF(U)).
 - ●SGN output

In the case of phase lag ... $5V\pm0.5V$, 2mA (Source: output current) In the case of phase lead ... 1V max, 5mA (Sink: input current)


- *3 When only auxiliary power supply is applied, a power factor close to 1 is output.
- *4 An error may occur when the 3-phase voltage becomes unbalanced.
- 5 Operation will be abnormal when the input is a negative-phase sequence.

(for Unbalanced Loads) [Insulated]

■Input/Output relationships

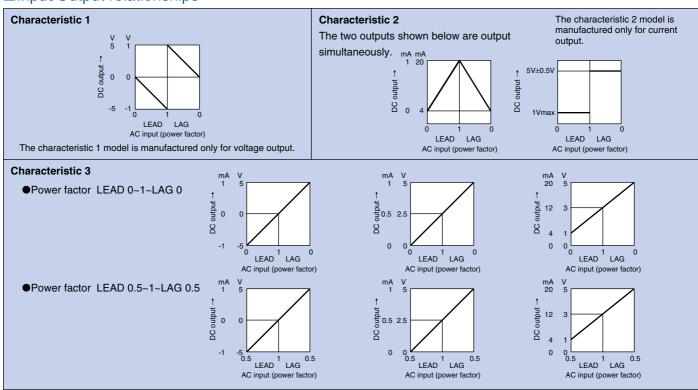

Connection diagrams (Refer to p.156 for outer dimensions.)

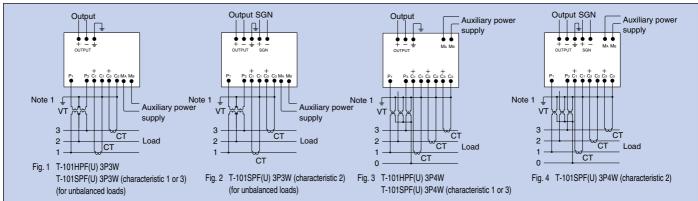

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

Model name | This case of 3-phase, 4-wire models, | This

 In the case of 3-phase, 4-wire models, please specify the phase voltage and line voltage.



Frequency Transducers [Insulated]

T-51/T-101 Series





T-51HF

HF T-101SF

| Outer shape | Model name | Accuracy | Inpu | it (AC) | Output (DC) | Ripple/ | Consumption VA | Auxiliary power supply | Weight | Delivery period |
|-------------|------------|------------------|----------|--------------------|---|----------------|----------------------|---|--------|--------------------|
| Outer | Woder Hame | (grade) | Voltage | Frequency | Voltage or current and load | Response speed | o o no a mpa o m m m | галана у роног сарргу | | classification |
| | T-51HF | 1.0 | 110V | | 0~1mA : 0~5kΩ 0~5mA : 0~1kΩ | 1% P-P or less | 0.3 | 110VAC +10 % -15 % 50 and 60Hz | 0.4kg | 0 |
| Box | | 1.0 | 220V | 45~55Hz 55~65Hz | $4\sim20\text{mA}:0\sim600\Omega$ $0\sim100\text{mV}:5\text{k}\Omega\sim\infty$ $0\sim1V:5\text{k}\Omega\sim\infty$ $0\sim5V:5\text{k}\Omega\sim\infty$ $0\sim10V:10\text{k}\Omega\sim\infty$ $1\sim5V:5\text{k}\Omega\sim\infty$ | 1s or less | 0.6 | Consumption VA: 3 | 0.4kg | |
| Ğ | | | 110V | | | | 0.3 | 110VAC +10 % | 0.01 | |
| | T-101SF | 0.5 | 45~55112 | | 0.45~0.55V : 5kΩ~∞ | 1% P-P or less | | 50 and 60Hz Consumption | 0.6kg | |
| | | 220V 55~65Hz 0.8 | | 0.55~0.65V : 5kΩ~∞ | 10 07 1000 | 0.6 VA: 3 | | | | |

Manufacturable range

| IVIC | Hu | iacturable i | arige | | | | |
|-----------------|----|--------------------------------|--|--|--|--|--|
| | | T-51HF | T-101SF | | | | |
| Inpu | t | 50~400Hz *1 | | | | | |
| Outpo | ut | 0.1~20mA, 50mV~10V *2 | | | | | |
| Auxiliary power | AC | 100, 105, 110 200, 210, 220 | , 115, 120V ₊₁₀ % , 230, 240V ⁻¹⁵ % | | | | |
| supply | DC | 24V, 100~120V | 24V±10% | | | | |

Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

- *1 The input range is approximately ±10% of the central frequency. Example: In the case of 400Hz, input 360~440Hz.
- *2 Transducers with positive/negative bidirectional output based on the central frequency can also be manufactured. However, the manufacturable ranges in regard to output are ±0.1~±5mA and ±50mV~±10V. Example: Input 45~50~55Hz; Output -1~0~1mA, -5~0~5V.
- *3 When only auxiliary power supply is applied, positive-side burnout output occurs.

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$.

The voltage tolerance of a 100~120VDC auxiliary power supply is 15 %.

■Input/Output relationships

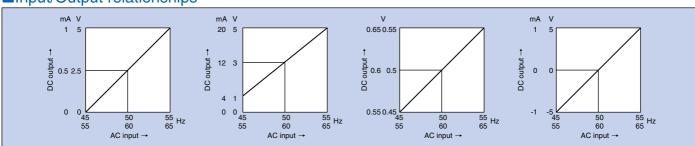

Connection diagrams (Refer to p.156 for outer dimensions.)



Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

| Model name | Inp | out | Output | | Auxilianu pawar aupplu | Number of units |
|--------------|---------|-----------|--------------------|--|------------------------|-----------------|
| Woder Harrie | Voltage | Frequency | Voltage or current | | Auxiliary power supply | Number of units |
| T-51HF | 110V | 45~55Hz | 0~5V | | 110VAC | 2 |



Voltage Phase Angle Transducers [Insulated]

T-51/T-101 Series



T-101SY

| Outer shape | Model name | Accuracy | | Inpu | ıt (AC) | | Output (DC) | Ripple/ | Consum | ption VA | Auxiliary power | Weight | Delivery | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------------|----------|-------------|------------------------------|---|----------------|-----------------------------|----------------|----------------|---------------|----------------------|--------|-----------------------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|-------------------|------------|-----|-----|-------------|-------|
| Outer | Model name | (grade) | Phase angle | Reference voltage | Compared voltage | Frequency | Voltage or current and load | Response speed | Reference side | Compared side | | Weight | period classification | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | —1~0~1mA : 0~5kΩ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | —5~0~5mA : 0~1kΩ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | LEAD60° | | | | —100~0~100mV : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | T-101SY | 1.0 | ~0°~ | | | | —1~0~1V : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | LAG60° | | | | —5~0~5V : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | 110 | 110 | 50Hz or 60Hz | —10~0~10V : 10kΩ~∞ | | | | 110VAC | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Box | | Υ | | $\frac{110}{\sqrt{3}}$ /110V | $\frac{0}{3}$ /110V $\left \frac{110}{\sqrt{3}}$ /110V $\right $ | 30112 01 00112 | 0~0.5~1mA : 0~5kΩ 19 | 1% P-P or less | 0.3 | 0.3 | -15 % 50 and 60Hz | 0.6kg | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| ă | 1-10131 | | | switching | switching | | | | | | | | | | | | | | | | | | | | | | | | | | | | | 0~2.5~5mA : 0~1kΩ | 1s or less | 0.5 | 0.3 | Consumption | 0.0kg |
| | | | | _ | | | 4~12~20mA : 0~600Ω | | | | VA: 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | LEAD30° | | | | 0~50~100mV : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 2.0 | ~0°~ | | | | 0~0.5~1V : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | LAG30° | | | | 0~2.5~5V : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | 0~5~10V : 10kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | 1~3~5V : 5kΩ~∞ | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

■Manufacturable range

| | | T-101SY | | |
|-----------------|----|---|--|--|
| Input | | As indicated in the table above. *1 | | |
| Output | | 0.1~20mA, 50mV~10V *1 | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | | |
| supply | DC | 24V±10% | | |


^{*1} The manufacturable ranges for bidirectional output are $\pm 0.1 \sim \pm 5$ mA and ± 50 mV $\sim \pm 10$ V.

Delivery period classification


| | Symbol | Standard | | |
|--|---------------------------|--------------------|----------------|---------------|
| | | product | product | product |
| | Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

- *2 With a voltage phase angle transducer, when the frequencies of the standard voltage and comparative voltage are the same, a DC output proportional to the phase difference between the two is obtained. When the voltages differ in frequency, the output fluctuates continously.
- *3 The input terminals can be used for both $\frac{110}{\sqrt{3}}$ and 110V, and either voltage can be input by changing the connection. (Po $= P_1 \dots \frac{110}{\sqrt{20}}$, Po $= P_2 \dots 110V$)
- *4 If the reference and/or compared voltages fall to a value 1/3 or less than that of the rated voltage while the auxiliary power supply is applied, failure may occur.

■Input/Output relationships

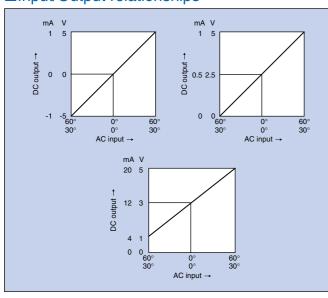

Connection diagrams (Refer to p.156 for outer dimensions.)

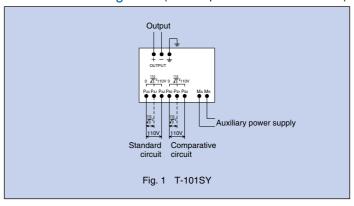

| Model name | | Input | 1 | Fraguenov | Output |] | Auxiliary nawar aupply | Number of units |
|--------------|--------------|------------------|---|-----------|--------------------|---|------------------------|-----------------|
| Model Harrie | Voltage | Phase angle | | Frequency | Voltage or current | | Auxiliary power supply | Number of units |
| T-101SY | 110/√3 /110V | LEAD60°~0~LAG60° | | 60Hz | -100-0-100mV | | 110VAC | 3 |
| | | | | | | | | |



DC Level Transducers [Non-insulated]

T-51/T-101 Series

DC level transducers input DC voltage (or current) and output DC voltage or a DC current proportional to the input, and can be used for level conversion or as a buffer for power transducer output.

Use an isolator when insulation is required between the input and output.

MTMARDA MTMARDA U. Fryson MARD SI STATE OF THE
T-51DL

Applications

- •Level conversion or buffer between various equipment
- •Level conversion or buffer for power transducer output

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| shape | Model | Accuracy | Innut (DC) on | nd input resistance Output (DC) Auxiliary power | | Weight | Delivery period | | |
|-------|--------|----------|---|--|--|--------------------------------|---|---------|----------------|
| Outer | name | (grade) | input (DC) an | d input resistance | ut resistance Voltage or current and load Ripple/Response speed | | supply | vveigni | classification |
| Вох | T-51DL | 0.25 | 100mV 1V 5V 10V 1~5V 1mA 5mA 4~20mA | 100kΩ or more Input voltage drop: 200mV or less | $\begin{array}{c} 1 mA: 0{\sim}10 k\Omega \\ 5 mA: 0{\sim}2 k\Omega \\ 4{\sim}20 mA: 0{\sim}600 \Omega \\ 100 mV: 500 \Omega{\sim} \\ 1V: 500 \Omega{\sim} \\ 5V: 500 \Omega{\sim} \\ 10V: 1 k\Omega{\sim} \\ 1{\sim}5V: 500 \Omega{\sim} \end{array}$ | 1% P-P or less 0.2s or less | 110VAC **10 % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |

■Manufacturable range


| / | T-51DL | | |
|----|--|---|--|
| i | 60mV~300V, 0.5mA~0.1A | | |
| ıt | 0.1~20mA, 50mV~10V | | |
| ۸۲ | 100, 105, 110, 115, 120V _{+10 o/} | | |
| AC | 200, 210, 220, 230, 240V ⁻¹⁵ | | |
| DC | 24V±10% | | |
| | ıt | 60mV~300V, 0.5mA~0.1A tt 0.1~20mA, 50mV~10V AC 100, 105, 110, 115, 120V ₋₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | |

*1 Resistance between input terminals.


| Input | 60mV~50V | over 50V~300V | 0.5mA~0.1A |
|------------------|----------|---------------|-----------------------------------|
| Input resistance | 100kΩ | 2kΩ/V | Input voltage drop: 200mV or less |

- *2 Transducers with positive/negative bidirectional input and positive/negative bidirectional output can also be manufactured. The manufacturable ranges for bidirectional output are ±50mV~±10V and ±0.1~±20mA.
- *3 The input and output are not insulated.
- ⁷⁴ Please inquire separately regarding input specifications exceeding 300V.


■Usage examples

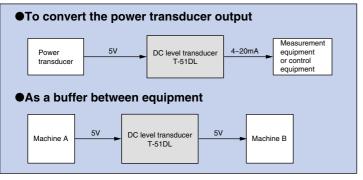


Connection diagrams (Refer to p.156 for outer dimensional drawings)

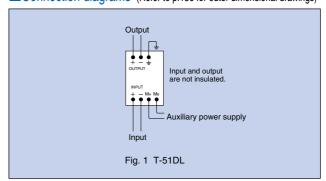

■Input/Output relationships

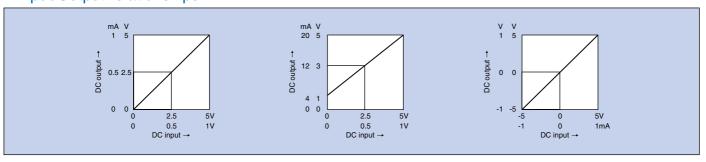

Ordering method



— Specify three values for bidirectional output.



DC Reverse Transducers [Non-insulated]

T-51/T-101 Series

DC reverse transducers input DC voltage (or current) and output DC voltage or DC current inversely proportional to the input; for example, as the input signal increases from 0% to 100%, the output signal decreases from 100% to 0%.

Minable Minabl

T-51DF

Applications

- Monitoring of deviation amount in combination with devices such as a position detection sensor or temperature transducer
- ●To create a fail-safe arrangement in the event of losing control power supply

Delivery period classification

| Cumbal | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| shape | Model | Accuracy | Innut (DC) o | nd input resistance | Output (DC) | | Auxiliary power | Weight | Delivery period |
|-------|--------|----------|--|---|--|--------------------------------|---|---------|-----------------|
| Outer | name | (grade) | Input (DC) a | nd input resistance | Voltage or current and load | Ripple/Response speed | supply | vveigni | classification |
| Вох | T-51DR | 0.25 | 0~100mV 0~1V 0~5V 0~10V 1~5V 0~1mA 0~5mA 4~20mA | 100kΩ or more Input voltage drop: 200mV or less | $\begin{array}{c} 10\text{mA}:010\text{k}\Omega\\ 50\text{mA}:02\text{k}\Omega\\ 204\text{mA}:0600\Omega\\ 1000\text{mV}:500\Omega\infty\\ 10\text{V}:500\Omega\infty\\ 50\text{V}:500\Omega\infty\\ 100\text{V}:1\text{k}\Omega\infty\\ 51\text{V}:500\Omega\infty \end{array}$ | 1% P-P or less 0.2s or less | 110VAC **10 % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |

■Manufacturable range


| | | T-51DR | |
|-----------|----|--|----|
| Input | | 60mV~300V, 0.5mA~0.1A | *3 |
| Output | | 0.1~20mA, 50mV~10V | |
| Auxiliary | ۸۵ | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | |
| power | AC | 200, 210, 220, 230, 240V -15 76 | |
| supply | DC | 24V±10% | |

*1 Resistance between input terminals


| Input | 60mV~50V | over 50V~300V | 0.5mA~0.1A |
|------------------|----------|---------------|-----------------------------------|
| Input resistance | 100kΩ | 2kΩ/V | Input voltage drop: 200mV or less |

- *2 The input and output are not isolated.
- *3 Please inquire separately regarding input specifications exceeding 300V.


■Usage examples

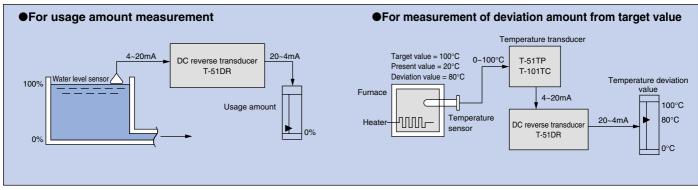

■Input/Output relationships

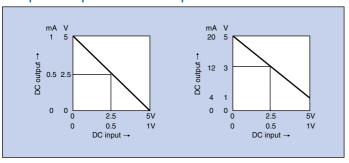

Connection diagrams (Refer to p.156 for outer dimensions.)

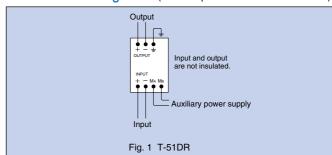

| Model name | Input | Output | Auxiliary power supply | Number of units |
|--------------|--------------------|--------------------|--------------------------|-----------------|
| Wodor Harrio | Voltage or current | Voltage or current | rtaxillary porrol oupply | realine of armo |
| T-51DR | 0-5V | 20-4mA | 110VAC | 3 |

Isolators [Insulated]

T-51/T-101 Series

Isolators provide insulation between DC circuits and measurement equipment, and between various sensors and control equipment.

Isolators can be used as a buffer or level exchange between input/output.

Applications

- Insulation between DC circuits and measurement equipment
- •Insulation interface between each sensor and other equipment such as computers or data loggers
- •Insulation between separate circuits



T-101IS

Delivery period classification

| Symbol Standard Quasi-standard product product Reference delivery period Immediate delivery Within 20 days | ∆Special | | |
|---|--------------------|----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| shape | Model | Accuracy | Input (DC) and input resistance | Output (DC) | Dielectric strenath between | Auxiliary | Weight | Delivery period | |
|-------|---------|----------|--|---|--------------------------------|--------------------------------|--|-----------------|----------------|
| Outer | name | (grade) | input (DC) and input resistance | Voltage or current and load | Ripple/Response speed | | power supply | vveigni | classification |
| Box | T-101IS | 0.25 | 60mV 1V 5V 10V 1~5V 150V : 300kΩ or more 300V : 600kΩ or more 1mA 5mA 4~20mA 100kΩ or more 100kΩ or more 100kΩ or more 200kΩ or more 200kΩ or more 200kΩ or more 200kΩ or more | $\begin{array}{l} 1 mA: 0{\sim}5k\Omega \\ 5 mA: 0{\sim}1k\Omega \\ 4{\sim}20 mA: 0{\sim}600\Omega \\ 100 mV: 5k\Omega{\sim}{\circ} \\ 1V: 5k\Omega{\sim}{\circ} \\ 5V: 5k\Omega{\sim}{\circ} \\ 10V: 10k\Omega{\sim}{\circ} \\ 1{\sim}5V: 5k\Omega{\sim}{\circ} \end{array}$ | 1% P-P or less 0.5s or less | 2000VAC 2000VDC for 1min | 110VAC 10 % 50 and 60Hz Consumption VA: 3 | 0.6kg | 0 |

■Manufacturable range

| | _ | T-101IS | |
|-----------|----|--|----|
| Input | | 60mV~300V, 0.5mA~0.1A | *4 |
| Outpo | ut | 0.1~20mA, 50mV~10V | |
| Auxiliary | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | |
| supply | DC | 24V±10% | |


*1 Resistance between input terminals

| Input | 60mV~50V | over 50V~300V | 0.5mA~0.1A |
|------------------|----------|---------------|-----------------------------------|
| Input resistance | 100kΩ | 2kΩ/V | Input voltage drop: 200mV or less |

- *2 Combine with a shunt if the current input exceeds 0.1A.
- *3 Isolators that provide positive/negative bidirectional output or positive direction-only output for positive/negative bidirectional input can also be manufactured.
- The manufacturable ranges for a bidirectional output are ±50mV~±10V and ±0.1~±5mA.

 4 Please inquire separately regarding input specifications exceeding 300V.

■Usage examples

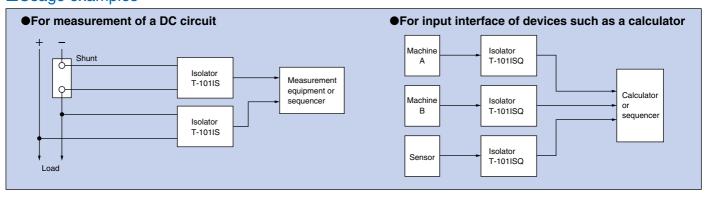

Model name T-101IS | Number of units | Cutput
Specify three values for bidirectional output.



High-speed Isolators [Insulated]

T-51/T-101 Series

(Response speed: 1ms)

High-speed isolators provide insulation between DC circuits and measurement devices, and between various sensors and control equipment. They operate at high response speeds, enabling use in high-speed control circuits and high-speed measurement applications.



T-101ISQ

Applications

- •Insulation of real-time measurement signals
- Insulation of high-speed control systems

Delivery period classification

| Symbol Standard Quasi-standard ASperproduct product product product product 21 to 0 to 10 | | △Special | |
|---|--------------------|----------------|---------------|
| Syllibol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| shape | Model Accuracy | | Innut (DC) and innut resistance | Output (DC) | Dielectric strenath between | Auxiliary | Weight | Delivery period | |
|-------|----------------|---------|---|---|--------------------------------|--------------------------------|--|-----------------|----------------|
| Oute | name | (grade) | Input (DC) and input resistance | Voltage or current and load | Ripple/Response speed | | power supply | vveigni | classification |
| Box | T-101ISQ | 0.25 | 60mV 1V 5V 10V 1~5V 150V : 300kΩ or more 300V : 600kΩ or more 1mA 5mA 4~20mA 100kΩ or more 100kΩ or | $\begin{array}{l} 1 mA: 0{\sim}5k\Omega \\ 5 mA: 0{\sim}1k\Omega \\ 4{\sim}20 mA: 0{\sim}600\Omega \\ 100 mV: 5k\Omega{\sim}{\circ} \\ 1V: 5k\Omega{\sim}{\circ} \\ 5V: 5k\Omega{\sim}{\circ} \\ 10V: 10k\Omega{\sim}{\circ} \\ 1{\sim}5V: 5k\Omega{\sim}{\circ} \end{array}$ | 1% P-P or less 1ms or less | 2000VAC 2000VDC for 1min | 110VAC 10 % 50 and 60Hz Consumption VA: 3 | 0.6kg | Δ |

■Manufacturable range


| | _ | T-101ISQ | |
|-----------|----|--|----|
| Inpu | t | 60mV~300V, 0.5mA~0.1A | *4 |
| Outpo | ut | 0.1~20mA, 50mV~10V | |
| Auxiliary | ۸. | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | |
| power | AC | 200, 210, 220, 230, 240V -15 70 | |
| supply | DC | 24V±10% | |
| | - | | |

*1 Resistance between input terminals


| Input | 60mV~50V | over 50V~300V | 0.5mA~0.1A |
|------------------|----------|---------------|-----------------------------------|
| Input resistance | 100kΩ | 2kΩ/V | Input voltage drop: 200mV or less |

- *2 Combine with a shunt if the current input exceeds 0.1A.
- *3 Isolators that provide positive/negative bidirectional output or positive direction-only output for positive/negative bidirectional input can also be manufactured.
- *4 The manufacturable ranges for bidirectional output are ±50mV~±10V and ±0.1~±5mA. Please inquire separately regarding input specifications exceeding 300V.

■Input/Output relationships

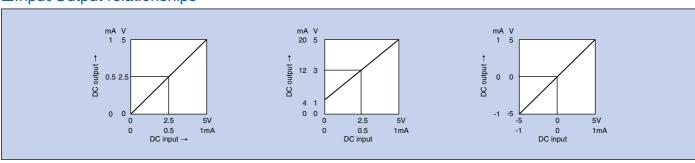

Connection diagrams (Refer to p.156 for outer dimensions.)

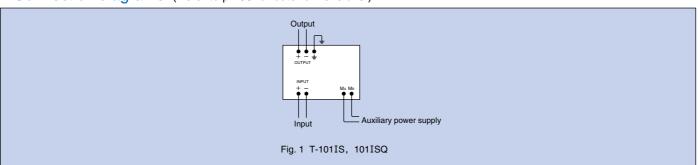

Ordering method

| Model name | Input | Output | Auviliant namer aunah | Number of unite |
|------------|--------------------|--------------------|------------------------|-----------------|
| woder name | Voltage or current | Voltage or current | Auxiliary power supply | Number of units |
| T-101 ISO | 0-5V | 4-20mA | 110VAC | 7 |
| 1-10115Q | 0-51 | 4-2011A | TTOVAC | |
| | | | | |

- Specify three values for bidirectional output.



Limiters [Non-insulated]

T-51/T-101 Series

Limiters restrict the variation range of an output signal and restrict the output to values outside the preset limit range when a signal outside the limit range is input.

CAL signals proportional to setting values are output, allowing accurate settings and set values to be checked.

officially and a second and a s

T-51LM

Applications

- •Maximum and minimum value retention during abnormal operation of a control device
- Prevent full opening/closing of devices such as control valves
- Prevent of off-scale input to computers

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| shape | Model | Model Accuracy Input (DC) and Output (DC) | | DC) | Setting | | Auxiliary | Weight | Delivery period | | |
|-------|--------|---|--|---|--|--------------------------------|-----------|--------------------|---|---------|----------------|
| Outer | name | (grade) | input | t resistance | Voltage or current and load | Ripple/Response speed | Accuracy | Range (CAL output) | power supply | vveigni | classification |
| Вох | T-51LM | 0.25 | 100mV 1V 5V 10V 1~5V 1mA 5mA 0~20mA 4~20mA | 100kΩ or more Input voltage drop: 200mV or less | $\begin{array}{c} 1 mA: 0{\sim}5k\Omega \\ 5 mA: 0{\sim}1k\Omega \\ 0{\sim}20 mA: 0{\sim}600\Omega \\ 4{\sim}20 mA: 0{\sim}600\Omega \\ 100 mV: 5k\Omega{\sim}\infty \\ 1V: 5k\Omega{\sim}\infty \\ 5V: 5k\Omega{\sim}\infty \\ 10V: 10k\Omega{\sim}\infty \\ 1{\sim}5V: 5k\Omega{\sim}\infty \end{array}$ | 1% P-P or less 0.2s or less | ±0.25% | | 110VAC ⁺¹⁰ ₋₁₅ % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |


■Manufacturable range

| | / | T-51LM | |
|-----------|----|--|----|
| Inpu | t | 60mV~10V, 0.5mA~0.1A | |
| Outpu | ut | 0.1~20mA, 50mV~10V | *2 |
| Auxiliary | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | |
| supply | DC | 24V±10% | |

- *1 The input and output are not insulated.
- *2 Limiters with bidirectional input and positive/negative bidirectional output can also be manufactured. The manufacturable ranges for bidirectional output are ±50mV~±10V and ±0.1~±5mA.


Setting procedure (Please carefully read the accompanying instruction manual.)

| Lower limit | While measuring the lower-limit setting output voltage (between the LOW CAL. OUT and COM terminals), vary the lower-limit setter (LO) to set the lower limit value. |
|-------------|--|
| Upper limit | While measuring the upper-limit setting output voltage (between the HIGH CAL. OUT and COM terminals), vary the upper-limit setter (HI) to set the upper limit value. |



(Layout of setters and output terminals)

■Input/Output relationships

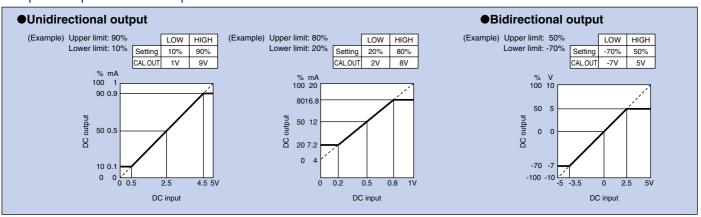

Ordering method

Specify three values for bidirectional output.



Adders [Non-insulated]

T-51/T-101 Series

Adders can be used to input several DC voltages or direct currents, perform addition according to the specified ratio, and output a DC voltage or direct current proportional to the addition result. An adder can also be used to perform actions such as concentrating power when combined with a power transducer.



T-101AD

Applications

•Synthesis of active powers (reactive powers) of multiple circuits

| Delivery per | iod classification |
|--------------|--------------------|
| | |

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| Outer shape | Model Accu- Input (DC) and | | Number | Number Output (DC) | | Auxiliary power | NAZ-1-1-1 | Delivery period | |
|-------------|----------------------------|-----------------|--|--------------------|--|--------------------------------|---|-----------------|----------------|
| Outer | name | racy (grade) | input resistance | of circuits | Voltage or current and load | Ripple/Response speed | supply | Weight | classification |
| Вох | T-101AD | 0.5 | $ \begin{array}{c} 100 \text{mV} \\ 1 \text{V} \\ 5 \text{V} \\ 10 \text{V} \\ 1 \sim 5 \text{V} \\ 1 \text{mA} \\ 5 \text{mA} \\ 4 \sim 20 \text{mA} \end{array} \right\} \begin{array}{c} 100 \text{k}\Omega \text{ or more} \\ 100 \text{k}\Omega \text{ or more} $ | 4 (max.) | $\begin{array}{c} 1 mA: \ 0{\sim}5k\Omega \\ 5 mA: \ 0{\sim}1k\Omega \\ 4{\sim}20 mA: \ 0{\sim}600\Omega \\ 100 mV: \ 5k\Omega{\sim}^{\circ} \\ 1V: \ 5k\Omega{\sim}^{\circ} \\ 5V: \ 5k\Omega{\sim}^{\circ} \\ 10V: \ 10k\Omega{\sim}^{\circ} \\ 1{\sim}5V: \ 5k\Omega{\sim}^{\circ} \end{array}$ | 1% P-P or less 0.2s or less | 110VAC ⁺¹⁰ / ₋₁₅ % 50 and 60Hz Consumption VA: 3 | 0.6kg | 0 |


■Manufacturable range

| | | T-101AD | |
|--------------------|--|--------------------|--|
| Input | | 50mV~10V, 0.5~20mA | |
| Output | | 0.1~20mA, 50mV~10V | |
| Auxiliary power AC | 100, 105, 110, 115, 120V ₊₁₀ , 200, 210, 220, 230, 240V ⁻¹⁵ | | |
| supply | DC | 24V±10% | |


- *1 Method for designating addition proportions

 For example, if the inputs are Pa=5V (1000kW), PB=5V (3000kW) and Pc=5V (5000kW), and the output is 5V (9000kW), the addition proportions= \frac{1}{0}: \frac{3}{0}: \frac{5}{5}: \frac{5}{0}.
- *2 If the number of inputs exceeds four, addition can be performed using 2 or more adders.
- *3 Adders that provide positive/negative bidirectional output or positive direction-only output for positive/negative bidirectional input can also be manufactured.
 The manufacturable ranges for bidirectional output are ±50mV~±10V and ±0.1~±5mA.
- 4 The input and output are not insulated.
- *5 For 4-20mA, an input of 0mA is regarded as -4mA for calculations.
- *6 For 1-5V, an input of 0V is regarded as -1V for calculations.


■Usage examples

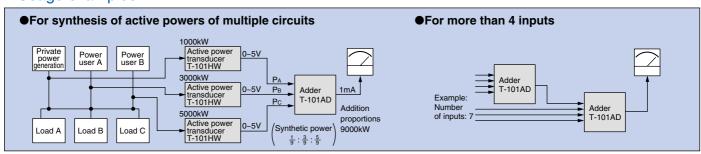


■Input/Output relationships

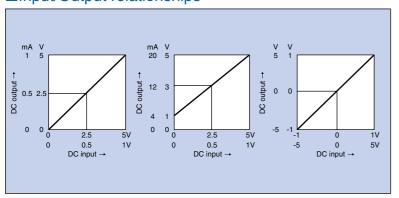

Connection diagrams (Refer to p.156 for outer dimensions.)

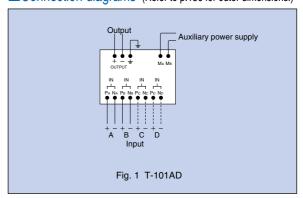





Resistance-bulb Temperature Transducers

T-51/T-101 Series

These temperature transducers measure temperature by the change in resistance value of a resistance bulb and output DC current or DC voltage proportional to the temperature of the part measured.





T-51TP

ITP T-101TP

Applications

 Transmission of temperature signals to temperature monitors or temperature control equipment

●Temperature measurement of things such as voltage transformer oil

| Delivery period classification | | | | | | | | |
|--------------------------------|--------------------|-----------------|---------------|--|--|--|--|--|
| Symbol | ⊚Standard | OQuasi-standard | ∆Special | | | | | |
| Symbol | product | product | product | | | | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | | | | |

| Outer shape | Model Accu- | | Between | Input | Output (DC) | | | | Auxiliary power | Weight | Delivery | | |
|-------------|-------------|-----------------|------------------|--|--|--------------------------------|----------------|-------------|-------------------|----------------|---|-------|---|
| Outer | name | racy (grade) | input and output | Resistance bulb | Voltage or current and load | Ripple | Response speed | Burnout | supply | | period classification | | |
| Вох | T-51TP | 0.5 | Non-insulated | Pt 100Ω (at0°C) Pt 50Ω (at0°C) | 1mA : 0~5kΩ 5mA : 0~1kΩ 4~20mA : 0~600Ω 100mV : 5kΩ~∞ | 5mA : 0~1kΩ 4~20mA : 0~600Ω | 1% P-P | 2s or less | | l langu lissit | 110VAC ⁺¹⁰ / ₋₁₅ % 50 and 60Hz | 0.4kg | 0 |
| Ğ | T-101TPZ | 0.5 | Insulated | Cu 10Ω (at25°C) (besides the above: Ni) | 1V : 5kΩ~∞ 5V : 5kΩ~∞ 10V : 10kΩ~∞ 1~5V : 5kΩ~∞ | or less | 2s or less | Upper limit | Consumption VA: 3 | 0.7kg | 0 | | |

■Manufacturable range

| | | T-51TP, T-101TPZ | | | | | |
|------------------------------|----|--|--|--|--|--|--|
| Input | | Input temperature range: -200~500°C | | | | | |
| Output | | 0.1~20mA, 50mV~10V | | | | | |
| Auxiliary power supply | | 100, 105, 110, 115, 120V _{+10 9/} 200, 210, 220, 230, 240V ⁻¹⁵ | | | | | |
| Supply | DC | 24V, 100~120V | | | | | |

The voltage tolerance of a 24VDC auxiliary power supply is $\pm 10\%$.

The voltage tolerance of a 100~120VDC auxiliary power supply is $^{+15}_{-25}$ %.

- *1 Use these temperature transducers in combination with a 3-wire resistance bulb. If a 2-wire resistance bulb is used, error may occur due to the influence of lead-wire resistance.
- *2 For 3-wire resistance bulbs, set the resistance values of the respective lead wires between the resistance bulb and the transducer to 10Ω or less. Additionally, set the difference among the lead-wire resistance values to within the values in the table below.

| Resistance bulb | Pt100Ω • JPt100Ω | Pt50Ω | Cu10Ω | |
|--|------------------|--------------|----------------------|--|
| Difference among lead-wire resistance values | 0.2Ω or less | 0.1Ω or less | 0.02Ω or less | |

The temperature error due to resistance differences in the table on the left is approximately 0.5K.

- The accuracy (grade) indicates the accuracy of the temperature transducer only and does not include the error of the resistance bulb. Additionally, the customer is requested to provide the resistance bulb.
- *4 When resistance bulb input stops, burnout output is performed on the positive side.

Examples of standard input specifications

| Resistance bulb | Minimum span | Input measurement range (°C) | | | | | | |
|--|-------------------------------------|--|--|--|--|--|--|--|
| Pt100Ω (at0°C) JPt100Ω (at0°C) | 50°C | 0~100 0~250 -20~ 80 - 50~200 0~120 0~300 -40~ 60 -100~200 | | | | | | |
| Pt50Ω (at0°C) | 100°C | 0~150 -50~50 0~200 -50~150 | | | | | | |
| Cu10Ω (at25°C) | 100°C | (Please specify for cases other than listed above.) | | | | | | |
| Ni and resistance bulbs other than the above | Please specify the resistance bulb. | e input temperature range and the temperature/resistance value relationship of the | | | | | | |


■Selection between insulated/non-insulated (between input and output)

Make a selection according to the temperature sensor configuration explained in the following table.

| Temperature sensor | Temperature transducer |
|---|---|
| Insulated with respect to the object measured | Both insulated and non-insulated units can be used. However, if the temperature sensor is located close to a power supply line or control equipment, common mode noise due to electromagnetic induction may occur. Use an insulated unit in this case. |
| Non-insulated with respect to the object measured | Make sure to use insulated units to prevent circuit noise interference due to the common potential generated in temperature sensors and the penetration of external noise. |

(Insulated/Non-insulated)

■Input/Output relationships

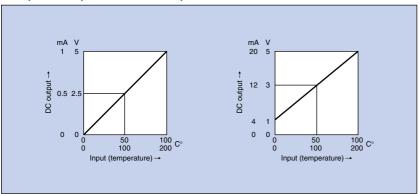


■Inspection and adjustment

Perform the following procedure to check whether or not a transducer is operating normally.

- ① Install an inspection resistor at (near) the installation location of the resistance bulb and connect the inspection resistor.
- ②Check whether or not the transducer outputs a value corresponding to the inspection temperature. If there is an error in output, adjust the transducer using the output adjuster.

A GR-2 standard resistor (sold separately) can be used as an inspection resistor (see p.149).

■Connection diagrams (Refer to p.156 for outer dimensions.)

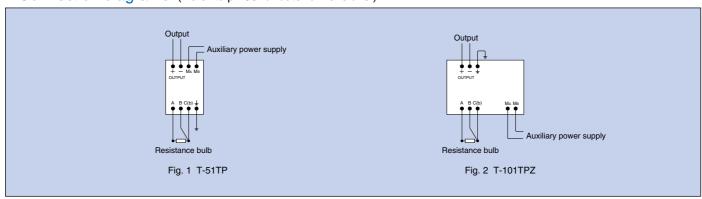

| Madal nama |] | Inp | out | | Output | Auxiliary nawar cupply | Number of unite |
|------------|---|-------------|-----------------|---|--------------------|------------------------|-----------------|
| Model name | | Temperature | resistance bulb | • | Voltage or current | Auxiliary power supply | Number of units |
| T-101TPZ | | 0–200°C | Pt100Ω | | 4–20mA | 110VAC | 10 |



Thermocouple Temperature Transducers

T-51/T-101 Series

Thermocouple temperature transducers use the electromotive force of the thermocouple to measure the temperature and output DC current or DC voltage proportional to the temperature of the part being monitored.

Parameter (Control of the Control of

T-101TC2

Applications

- •Temperature measurement of devices such as high-temperature furnaces
- Transmission of temperature signals to temperature monitors or temperature control equipment

Delivery period classification

| Symbol | | OQuasi-standard | △Special product |
|---------------------------|---|-----------------|------------------|
| Reference delivery period | F | F | |

| Outer shape | Model name | Accuracy (grade) | Between input | lı | nput | | Output (| DC) | | Auxiliary power | Weight | Delivery period |
|-------------|------------|---------------------|------------------------------------|---|--------------|-------------------------------|---|-----------------------------|-----------------------|----------------------|--------|-----------------|
| Outer | woder name | | Acct (gre | and output | Thermocouple | Measurable range | Minimum span | Voltage or current and load | Ripple/Response speed | Burnout | supply | vveigni |
| | T-101TC | | Non-insulated 0.5 | K (Chromel/Alumel) | -200~1200°C | 100°C | 1mA : 0~5kΩ 5mA : 0~1kΩ 4~20mA : 0~600Ω | | | 110VAC | | |
| | | | | T (Copper/Constantan) | -200~ 350°C | 120°C | | | | | 0.6kg | 0 |
| Box | | 0.5 In | | 0.5 ├──────────────────────────────────── | | 0~100mV : 5kΩ~∞ 1V : 5kΩ~∞ | 1% P-P or less 1s or less | Upper limit | 50 and 60Hz | | | |
| | T-101TCZ | | | E (Chromel/Constantan) | -200~ 800°C | 100°C | 5V : 5kΩ~∞ 10V : 10kΩ~∞ | | | Consumption VA: 3 | 0.7kg | 0 |
| | | | R, S (rhodium/platinum) 0~1600°C 5 | | 500°C | 1~5V : 5kΩ~∞ | | | | | | |

■Manufacturable range

| | | T-101TC, T-101TCZ |
|-----------------|----|--|
| Inpu | t | As indicated in the table above. |
| Outpo | ut | 0.1~20mA, 50mV~10V |
| Auxiliary power | AC | 100, 105, 110, 115, 120V 200, 210, 220, 230, 240V |
| supply | DC | 24V±10% |

The voltage tolerance of an AC auxiliary power supply is $^{\scriptscriptstyle +10}_{\scriptscriptstyle -15}$ %.

- Please specify the input temperature range so that it is within the measurable range of the thermocouple and ensure that the span value is at least the minimum span value. Example: In the case of an R thermocouple, 0~500°C or 100~600°C is specified as the input temperature range.
- '2 The input signal source resistance (thermocouple sensor resistance value + compensation wire round trip resistance value) must be 100Ω or less. Influence of the signal source resistance: approx. $0.1\mu\text{V}/\Omega$ or less with respect to the thermal electromotive force.
- *3 The accuracy (grade) indicates the accuracy of the temperature transducer only and does not include the error of the thermocouple sensor. Additionally, the customer is required to provide the thermocouple sensor.
- *4 When thermocouple input stops, burnout output is performed on the positive side.

■Examples of standard input specifications

| Level across of standard input specimentarions | | | | | | | | | | | |
|--|-----------------------|-----------------------|-----------------------|------------------|------------------|----------|--|--|--|--|--|
| Input sensor | | | Measuremen | nt range (°C) | | | | | | | |
| ĸ | 0~ 100 0~ 500 | 0~ 150 0~ 600 | 0~ 200 0~ 800 | 0~ 250 0~1000 | 0~ 300 0~1200 | 0~ 400 | | | | | |
| (CA) | 100~ 200 | 300~ 600 | 400~ 800 | 400~1000 | 600~ 800 | 600~1200 | | | | | |
| | -50~ 150 | -100~ 300 | | | | | | | | | |
| Т | 0~ 120 | 0~ 150 | 0~ 200 | 0~ 300 | 0~ 400 | | | | | | |
| (CC) | -50~ 100 -200~ 200 | -50~ 150 -200~ 400 | -50~ 200 | -100~ 50 | -100~ 100 | | | | | | |
| J (IC) | 0~ 100 0~ 400 | 0~ 150 0~ 500 | 0~ 200 0~ 600 | 0~ 250 0~ 800 | 0~ 300 | | | | | | |
| (10) | -50~ 100 | -50~ 150 | | | | | | | | | |
| | 0~ 100 | 0~ 300 | 0~ 500 | 0~ 600 | | | | | | | |
| E (CRC) | 50~ 150 | 300~ 600 | | | | | | | | | |
| | -10~ 90 | | | | | | | | | | |
| R | 0~1000 0~1600 | 0~1200 | 0~1300 | 0~1400 | 0~1500 | | | | | | |
| S | 300~1300 1000~1400 | 400~1400 1100~1600 | 400~1600 1300~1600 | 800~1300 | 800~1600 | | | | | | |

(Insulated/Non-insulated)

■Selection between insulated/non-insulated (between input and output)

Please make a selection according to the temperature sensor configuration explained in the following table.

| Temperature sensor | Temperature transducer |
|---|--|
| Insulated with respect to the measured object | Both insulated and non-insulated units can be used. However, if the temperature sensor is located close to a power supply line or control equipment, common mode noise due to electromagnetic induction may occur. Use an insulated unit in this case. |
| Non-insulated with respect to the measured object | Make sure to use an insulated unit to prevent circuit noise interference due to the common potential generated in temperature sensors and the penetration of external noise. |


■Inspection and adjustment

Perform the following procedure to check whether or not a transducer is operating normally.


(The inspection temperature is the maximum input temperature.)

- ①Measure the temperature (reference temperature) in the immediate vicinity of the transducer.
- ②Using the thermal electromotive force table in JIS C 1602, please note the thermal electromotive forces corresponding to the transducer maximum input temperature and the reference temperature.
- ③Apply a DC voltage equivalent to (electromotive force of the maximum input temperature electromotive force of the reference temperature) to the input side of the transducer.
- (4) Check whether or not an output equivalent to the maximum input temperature is output. If there is an error in the output, adjust the transducer using the output adjuster.

■Input/Output relationships

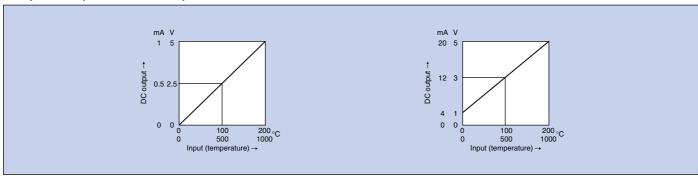

Connection diagrams (Refer to p.156 for outer dimensions.)

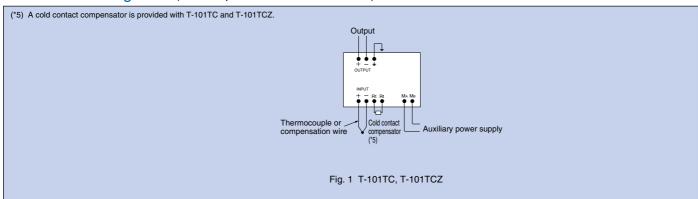

| Model name | Inp | Input | | Output | Auxiliary power cumby | | Number of units |
|--------------|-------------|--------------|--|--------------------|-----------------------|------------------------|-----------------|
| Woder Harrie | Temperature | thermocouple | | Voltage or current | | Auxiliary power supply | Number of units |
| T-101TC | 0-300°C | Т | | 0-5V | | 110VAC | 10 |



First-order Lag Transducers [Non-insulated]

T-51/T-101 Series

These transducers apply a time constant to the DC input signal and delay the response speed.

The time constant can be set to any value between 1 and 60 seconds.

Windows Committee Committe

T-51DS

Applications

- Averaging highly fluctuating signals
- Prevents control system oscillation

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Gyrribor | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |


| Outer shape | Model name | Accuracy | Input (DC) and input vaciations | Out | tput (DC) | | Auxilians names ample | y Weight | Delivery |
|-------------|------------|----------|---|--|--|----------------|--|----------|-----------------------|
| Outer | Model name | class | Input (DC) and input resistance | Voltage or current and load | Time constant | Ripple | Auxiliary power supply | | period classification |
| Box | T-51DS | 0.5 | 100mV 1V 5V 10V 1~5V 1mA 5mA 4~20mA 1 00kΩ or more 100kΩ or more | $\begin{array}{c} \text{1mA}:0{\sim}5k\Omega \\ \text{5mA}:0{\sim}1k\Omega \\ \text{4}{\sim}20\text{mA}:0{\sim}600\Omega \\ \text{100mV}:5k\Omega{\sim}\infty \\ \text{1V}:5k\Omega{\sim}\infty \\ \text{5V}:5k\Omega{\sim}\infty \\ \text{10V}:10k\Omega{\sim}\infty \\ \text{1}{\sim}5\text{V}:5k\Omega{\sim}\infty \end{array}$ | 1 to 60s Accuracy: ±20% [with respect to set value] | 1% P-P or less | 110VAC ⁺¹⁰ ₋₁₅ % 50 and 60Hz Consumption VA: 3 | 0.4kg | 0 |

■Manufacturable range


| | | T-51DS | | | | |
|--------------------|----|--|--|--|--|--|
| Input | | 60mV~10V, 0.5mA~0.1A | | | | |
| Output | ut | 0.1~20mA, 50mV~10V | | | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₋₁₀ % 200, 210, 220, 230, 240V -15 % | | | | |
| supply | DC | 24V±10% | | | | |

- *1 The input and output are not insulated.
- *2 The time constant can be set arbitrarily.


■Time constant, time interval and response speed relationship

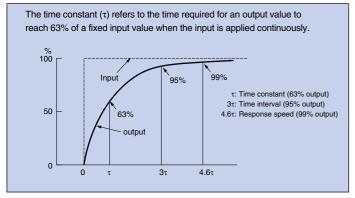


■Usage example

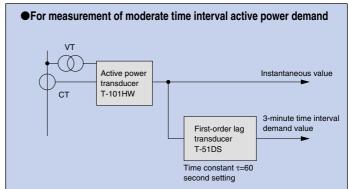

Connection diagrams (Refer to p.156 for outer dimensions.)

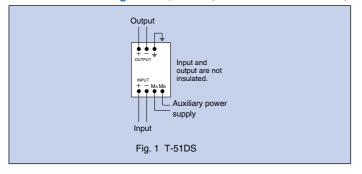

■Front view

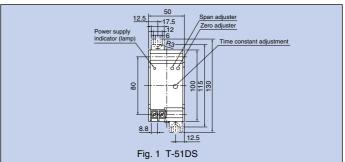

| Model name | Input Voltage or current | Output Voltage or current | Auxiliary power supply | Number of units |
|------------|-----------------------------|------------------------------|------------------------|-----------------|
| T-51DS | 4-20mA | 0-5V | 110VAC | 2 |



AC Current Demand Transducers (Moderate Time Interval) [Insulated]

T-51/T-101 Series

AC current demand transducers output DC current or DC voltage that is proportional to the average value (demand value) of the AC current within a specified time interval.

Applications

- Protection of transmission lines
- Checking transformer load state



T-101HAA (DS

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | | |
|---------------------------|--------------------|-----------------|---------------|--|--|
| Symbol | product | product | product | | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | | |

| Outer shape | Model name | Accuracy | Inpu | ıt (AC) | Outpu | t (DC) | | | Consumption VA | Auxiliary power supply | Weight | Delivery period |
|-------------|--------------|----------|----------|----------------|--|---|-------------|-------------------|----------------|--|---------|-----------------|
| Outer | Model Hame | (grade) | Current | Frequency | Voltage or current and load | Time int | terval (to) | Ripple | Consumption vA | Auxiliary power suppry | vveigni | classification |
| Вох | T-101HAA(DS) | 0.5 | 5A 1A | 50 and 60Hz | $\begin{array}{c} 1 \text{mA} : 0{\sim}5 k\Omega \\ 5 \text{mA} : 0{\sim}1 k\Omega \\ 4{\sim}20 \text{mA} : 0{\sim}600 \Omega \\ 100 \text{mV} : 5 k\Omega{\sim} \\ 1 \text{V} : 5 k\Omega{\sim} \\ 5 \text{V} : 5 k\Omega{\sim} \\ 10 \text{V} : 10 k\Omega{\sim} \\ 1{\sim}5 \text{V} : 5 k\Omega{\sim} \end{array}$ | 15s 30s 60s 120s 150s 180s | · Specify | 1% P-P or less | 0.1 | 110VAC ⁺¹⁰ ₋₁₅ % 50 and 60Hz Consumption VA: 5 | 0.5kg | 0 |

■Manufacturable range


| | | T-101HAA (DS) | | | |
|------------------------------|----|---|--|--|--|
| Input | | 0.1~5A | | | |
| Outpu | ut | 0.1~20mA, 50mV~10V | | | |
| Auxiliary power supply | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | | | |
| supply | DC | 24V±10% | | | |

- *1 Accuracy of time interval (to): ±20%
 - The accuracy of the time interval is the accuracy of the time at which the output reaches a value corresponding to 95% of a fixed value when input.
- *2 Error may occur when the waveform of the input current is distorted.


 For example, when the third harmonic content is 15%, the error is approx. ±2.0%.


The time interval (to) refers to the time required for an output (Io) to reach a value corresponding to 95% of a fixed input value (I) when the input (I) is applied continuously.

The output becomes substantially 100% at 3 times the time interval (3to).




■Input/Output relationships





■ Connection diagrams (Refer to p.156 for outer dimensions.)

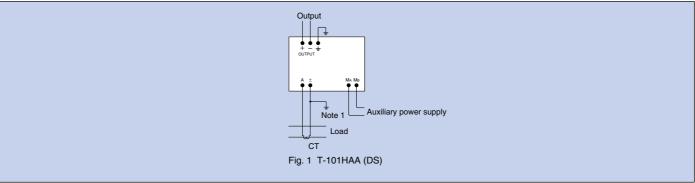

Note 1. For low-voltage circuits, grounding of the secondary side of the current transformer is unnecessary.

| Model name | | Input | Time interval | Output | Austions nower aunals | Number of units |
|-------------|-----|---------|---------------|--------------------|------------------------|-----------------|
| Model nar | ie | Current | Time interval | Voltage or current | Auxiliary power supply | Number of units |
| T-101HAA (I | OS) | 5A | 180 seconds | 4-20mA | 110VAC | 1 |



AC Voltage Demand Transducers (Moderate Time Interval) [Insulated]

T-51/T-101 Series

AC voltage demand transducers output DC current or DC voltage that is proportional to the average value (demand value) of the AC voltage within a specified time interval.

Applications

- Monitoring of voltage due to load fluctuation
- •For detecting abnormal voltages in devices such as small-scale generators
- •For preventing the detection of error due to flicker



T-101HAV (DS

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

| shape | Model name | Accuracy | Input (AC) | | Outpu | Canaumatian \/A | Auviliant pauter aupply | Weight | Delivery | | |
|-------------|---------------|----------|--------------|----------------|--|---|-------------------------|----------------------|---|-------|-----------------------|
| Outer shape | Model name | (grade) | Voltage | Frequency | Voltage or current and load | Time interval (to) | Ripple | Consumption va | Auxiliary power supply | 0 | period classification |
| Вох | T-101HAV (DS) | 0.5 | 150V 300V | 50 and 60Hz | $\begin{array}{c} 1\text{mA}:0{\sim}5\text{k}\Omega\\ 5\text{mA}:0{\sim}1\text{k}\Omega\\ 4{\sim}20\text{mA}:0{\sim}600\Omega\\ 100\text{mV}:5\text{k}\Omega{\sim}\infty\\ 1\text{V}:5\text{k}\Omega{\sim}\infty\\ 5\text{V}:5\text{k}\Omega{\sim}\infty\\ 10\text{V}:10\text{k}\Omega{\sim}\infty\\ 1{\sim}5\text{V}:5\text{k}\Omega{\sim}\infty \end{array}$ | 15s 30s 60s 120s 150s 180s | 1% P-P or less | 150V:0.4 300V:0.8 | 110VAC ⁺¹⁰ % 50 and 60Hz Consumption VA: 5 | 0.5kg | 0 |

■Manufacturable range

| | _ | T-101HAV (DS) | | | |
|-----------------|----|---|--|--|--|
| Input | | 50~300V | | | |
| Outp | ut | 0.1~20mA, 50mV~10V | | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₋₁₀ % 200, 210, 220, 230, 240V ⁻¹⁰ % | | | |
| supply | DC | 24V±10% | | | |

*1 Accuracy of time interval (to): ±20%


The accuracy of the time interval is the accuracy of the time at which the output reaches a value corresponding to 95% of a fixed value when input.

*2 Error may occur when the waveform of the input voltage is distorted.


For example, when the third harmonic voltage is 15%, the error is approx. ±2.0%.


The time interval (to) refers to the time required for an output (Io) to reach a value corresponding to 95% of a fixed input value (I) when the input (I) is applied continuously.

The output becomes substantially 100% at 3 times the time interval (3to).




■Input/Output relationships





Connection diagrams (Refer to p.156 for outer dimensions.)

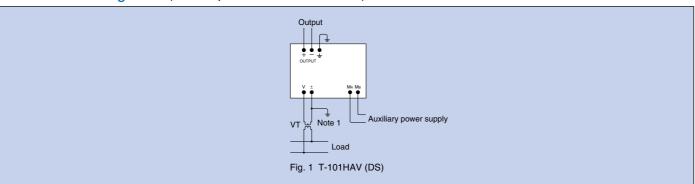

Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.

| Model name | Input Voltage | Time interval | Output Voltage or current | Auxiliary power supply | Number of units |
|---------------|------------------|---------------|------------------------------|------------------------|-----------------|
| T-101HAV (DS) | 150V | 30 seconds | 5V | 110VAC | 2 |



Current Transducers with Power Flow

T-51/T-101 Series

Current transducers receive the current and voltage of 3-phase AC circuits as input, distinguish the power flow direction (receiving or sending), and output DC current or DC voltage proportional to the current value that was input.



T-101HAA (D)

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

| | Outer shape | Model name | Accuracy | Circuit | | Input (AC) Output (DC) | | Output (DC) Ripple/ Consu | | Consum | ption VA | Auxiliary | Weight | Delivery | |
|--|-------------|------------------|-----------------|---------|----------------------|------------------------|-------------------------------|--|--|----------------|-----------------|-----------------|-------------------------------------|----------|-----------------------|
| | Oute | Wiodel Hairie | (grade) | Cilcuit | Voltage | Current | Frequency | Distinguishable phase angle range | Voltage or current and load | Response speed | Current circuit | Voltage circuit | power supply | weignt | period classification |
| | * | | ى AC circuit | 110V | Sending) (Receiving) | | ●Receiving -85°~0°~85° (275°) | (Sending) (Receiving) $ -1 \sim 0 \sim 1 \text{mA} : 0 \sim 5 \text{k} \Omega \\ -5 \sim 0 \sim 5 \text{mA} : 0 \sim 1 \text{k} \Omega \\ -20 \sim 0 \sim 20 \text{mA} : 0 \sim 600 \Omega $ | 1% P-P | | 0.3 | | | | |
| | | ٥.۶ | | 220V | -5A~0~5A | ~0~5A 50 and | | | | 0.1 | 0.6 | 110VAC | 0.01 | | |
| | ğ | T-101HAA (D) 0.5 | 0.5 | 3-phase | 110V | (Sending) (Receiving) | o, (o, | ●Sending 95°~180°~265° | Dending -1~0~1V: 5kΩ~∞ 95°~180°~265° -5~0~5V: 5kΩ~∞ | 1s or less | 0.1 | 0.3 | 50 and 60Hz Consumption VA: 3 | | 0 |
| | | | | | 220V | -1A~0~1A | | | -10~0~10V : 10kΩ~∞ | | | 0.6 | | | |


■Manufacturable range

| | _ | T-101HAA (D) | | |
|--------------------|----|---|--|--|
| Input | | As indicated in the table above. | | |
| Outpo | ut | 0.1~20mA, 50mV~10V | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | | |
| supply | DC | 24V±10% | | |

- *1 An error may occur when the waveform of the input current is distorted. For example, when the third harmonic content is 15%, the error is approx. ±2.0%.
- *2 The power flow distinguishing function operates at 50% or more of the rated voltage. At less than 50% of the rated voltage, output with the input being regarded as a receiving current.
- *3 For the power flow, the detected current phase is distinguished.
- *4 A model with unidirectional output specifications can also be manufactured.


| Input | Output |
|---------------------------------------|-------------------------------------|
| (Sending) (Receiving) -5~0~5A -1~0~1A | 0~50~100mV 0~2.5~5V 4~12~20mA |

■Application example

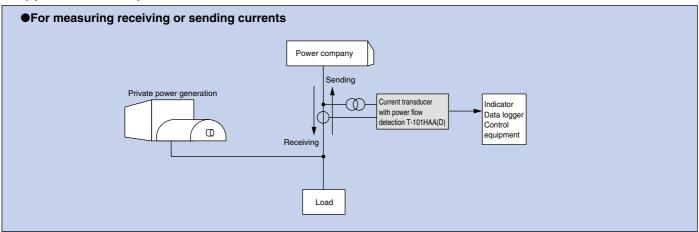


Detection [Insulated]


■Input/Output relationships



■Receiving-sending phase relationship

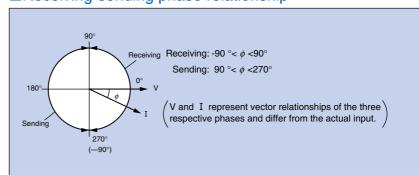

■Connection diagrams (Refer to p.156 for outer dimensions.)

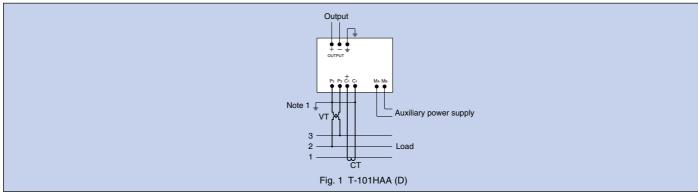

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.

■Ordering method

| Model name | Input | | Output | Auxilians names augusts | | No made and a firm the | |
|---------------|---------|---------|--------------------|-------------------------|--------|------------------------|----|
| Model name | Voltage | Current | Voltage or current | Auxiliary power supply | | Number of units | |
| T-101HAA (D) | 110V | -5-0-5A | -5-0-5V | | 110VAC | | 10 |
| I-10111AA (D) | 1104 | -5-0-5A | -3-0-3 V | | 110040 | | |
| | | | T | | | | |

Specify three values for the output.



Leakage Current Transducers [Insulated]

T-51/T-101 Series

Leakage current transducers detect leakage current in AC cables using a Zero-current transformer (ZCT) and output DC current or DC voltage proportional to the leaking current value

Applications

- Preventive and predictive maintenance management of insulation degradation in electrical equipment
- •Detection of leakage current in AC cables





T-51LG

G ZC

Delivery period classification

| Symb | اما | ⊚Standard | OQuasi-standard | ∆Special | |
|------------------|-----------|--------------------|-----------------|---------------|--|
| Syllib | OI | product | product | product | |
| Reference delive | ry period | Immediate delivery | Within 20 days | 21 to 60 days | |

| Outer shape | shape | Model name | Accuracy (grade) | ZCT Input (AC) | | Output (DC) | | Auxiliary | Weight | Accessory | Delivery period |
|-------------|-------|------------|---------------------|---|-----------|---|------------------------------|---|---------------------------|--|-----------------|
| | Outer | | | Current | Frequency | Voltage or current and load | Ripple/Response speed | power supply | vveigni | (ZCT) | classification |
| | Box | T-51LG | 1.0 | 15mA 30mA 100mA 200mA 500mA 1A 5A | 40Hz~2kHz | $\begin{array}{c} 1 \text{mA} : 0{\sim}5\text{k}\Omega \\ 5 \text{mA} : 0{\sim}1\text{k}\Omega \\ 4{\sim}20 \text{mA} : 0{\sim}600\Omega \\ 100 \text{mV} : 5\text{k}\Omega{\sim}\infty \\ 1\text{V} : 5\text{k}\Omega{\sim}\infty \\ 5\text{V} : 5\text{k}\Omega{\sim}\infty \\ 10\text{V} : 10\text{k}\Omega{\sim}\infty \\ 1{\sim}5\text{V} : 5\text{k}\Omega{\sim}\infty \end{array}$ | 1% P-P or less 1s or less | 110VAC +10 % 50 and 60Hz Consumption VA: 3 | 0.4kg (main unit only) | ZT15B ZT30B ZT40B ZT60B ZT80B ZT100B (Specify) | 0 |

■Manufacturable range

| | _ | T-51LG | | |
|-----------------|----|---|--|--|
| Inpu | t | 15mA~5A | | |
| Outpo | ut | 0.1~20mA, 50mV~10V | | |
| Auxiliary power | AC | 100, 105, 110, 115, 120V ₊₁₀ % 200, 210, 220, 230, 240V ⁻¹⁵ % | | |
| supply | DC | 24V±10% | | |


- *1 Lead wire specifications (between ZCT and transducer)
 Make sure to use shielded wires.
 - Connect the shield (drain line) to the "±" input terminal.

| 5 | Shielded wire specifications | Allowable lead length | | | |
|---|---|-----------------------|--|--|--|
| | Two-core shielded wire of 0.5~2.0mm² (CVVS, etc.) | 25m or less one way | | | |


- *2 When a harmonic component is contained in the measured circuit, the T-51LG measures the effective value of the leakage current including the harmonic component.
- *3 The ZCT is a dedicated accessory, and thus cannot be used in combinations other than those specified for the transducer.
- *4 If the power supply frequency (fi) and output frequency (fo) are connected close to each other in the inverter circuit, a beat may occur in the leakage current and the output may fluctuate.
- *5 Influence of external magnetic field An error of approximately 0.4% may occur if an external magnetic field of 200A/m is applied to the main unit and ZCT.
- *6 Insulation between the input circuit and output circuit. The input terminals and output terminals of the main unit are not insulated.

The measurement circuit (input side) and output circuit can be insulated using an accessory ZCT.


■Usage example

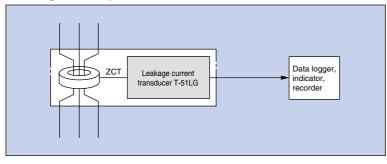

■Input/Output relationships

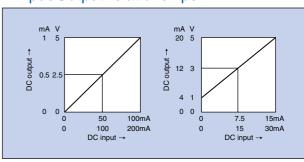

■ Connection diagrams (Refer to p.156 for outer dimensions.)

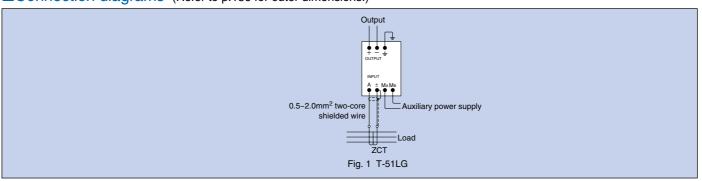

(Refer to p.146 for outer dimensions of the ZCT.)


Reference: Rated input current value selection method

1 Monitoring leakage current due to insulation degradation of loaded equipment

Install the ZCT in the immediate vicinity of the loaded equipment.

The sensitivity current of an earth leakage circuit breaker is determined as indicated below. Select an input current value that is 1 to 1.5 times the value indicated below.

Example: Selecting a sensitivity current according to the electrical shock protection of an earth-leakage circuit breaker.

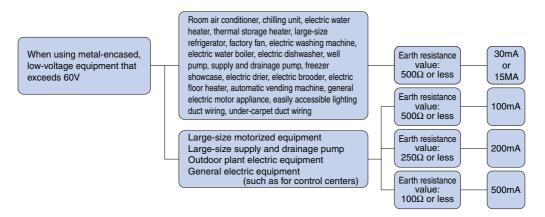

2 Monitoring leakage current in a long cable wiring

Even if the insulation resistance (meg) is normal, floating capacitance is present between the electric line and earth, and some leakage current flows constantly. This must be taken into account when selecting the input current value. An example of a 3-phase, 3-wire 200V circuit is shown in Table 1.

The rated current value is the sum of the value determined in Table 1 and the value determined in Reference 1 above.

Table 1 Leakage currents when 1km of 600V vinyl cable (IV) for \triangle connection 3 ϕ 3w 200V cable wiring is installed.

| Distance from earth portion | Am or more | ® 10cm or more | © 1.5mm or more | Close contact |
|-----------------------------|--|--|--|--|
| Cable size | ●1st floor roof wiring of a wooden building ●Wiring for 2nd floor or higher of a wooden building ●Aerial wiring (excluding © or ①) | ●Wiring inside a reinforced concrete line ●Vinyl pipe wiring or exposed wiring inside a steel beam (excluding © or ①) | ●Vinyl pipe-embedded work ●Vinyl pipe work in close contact with steel beam inside a steel building | Metal pipe wiring work Metal duct work |
| 8 mm ² or less | 0.60mA/km | 1.29mA/km | 19.9mA/km | 100mA/km |
| 14 | 0.66 | 1.44 | 22.1 | 110 |
| 22 | 0.72 | 1.55 | 23.9 | 120 |
| 38 | 0.81 | 1.75 | 26.9 | 135 |
| 50 | 0.91 | 1.97 | 30.3 | 152 |
| 80 | 1.02 | 2.21 | 34.0 | 170 |
| 100 | 1.14 | 2.46 | 37.9 | 189 |
| 150 | 1.25 | 2.72 | 41.8 | 209 |
| 250 | 1.46 | 3.16 | 48.6 | 243 |
| 325 | 1.52 | 3.29 | 50.7 | 253 |
| 500 | 1.71 | 3.69 | 56.8 | 284 |

Table 2 Leakage current conversion table

| Leakage current conversion table | | | | | |
|---|--------|--|--|--|--|
| Type of cable wiring | Factor | | | | |
| 1-phase 100V cable run | 0.3 | | | | |
| 1-phase 3-wire 200V cable run | 0.3 | | | | |
| 3-phase 415 cable run (Y connection) | 0.7 | | | | |

- *1 With respect to the values shown above, the value for rubber-insulated cable (RB) is approximately 70% and that for a three-core 600V crosslinked polyethylene insulated cable (CV) is approximately 50%.
- *2 With respect to the values shown above, the value in the case of 50HZ is 84%.
- *3 For the leakage current of other cables, multiply the value in Table 1 by a factor of 2.
- *4 For the length of the cable run, add all parts beyond the point of installation of the ZCT.

Ordering method





Leakage Current Transducers

T-51/T-101 Series

These transducers detect the leakage current in AC cables using a ZCT, attenuate the harmonic component contained in the current using a built-in low-pass filter, and output DC current or DC voltage proportional to the fundamental leakage current value.

Military Milita



T-51LGF

ZC

Applications

•Measurement of the fundamental leakage current in inverters, thyristor control circuits, or other AC circuits that contain a harmonic component.

Delivery period classification

| · · · · · · , p - · · | | | | |
|---------------------------|--------------------|-----------------|---------------|--|
| Symbol | ⊚Standard | OQuasi-standard | △Special | |
| Syllibol | product | product | product | |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days | |

| Outer shape | Model name | Accuracy | ZCT In | put (AC) | Output (DC | () | Auxiliary power | Weight | | Delivery period |
|-------------|------------|----------|---|-------------|--|------------------------------|---|---------------------------|--|-----------------|
| Outer | woder name | (grade) | Current | Frequency | Voltage or current and load | Ripple/Response speed | supply | vveigni | (ZCT) | classification |
| Вох | T-51LGF | 1.0 | 15mA 30mA 100mA 200mA 500mA 1A 5A | 50 and 60Hz | $\begin{array}{c} 1 mA: 0{\sim}5k\Omega \\ 5 mA: 0{\sim}1k\Omega \\ 4{\sim}20 mA: 0{\sim}600\Omega \\ 100 mV: 5k\Omega{\sim}\infty \\ 1V: 5k\Omega{\sim}\infty \\ 5V: 5k\Omega{\sim}\infty \\ 10V: 10k\Omega{\sim}\infty \\ 1{\sim}5V: 5k\Omega{\sim}\infty \end{array}$ | 1% P-P or less 1s or less | 110VAC **10 % 50 and 60Hz Consumption VA: 5 | 0.4kg (main unit only) | ZT15B ZT30B ZT40B ZT60B ZT80B ZT100B (Specify) | 0 |

■Manufacturable range

| | | T-51LGF |
|-------------------------|----|---|
| Input | | 15mA~5A |
| Output | | 0.1~20mA, 50mV~10V |
| Auxiliary wer supply | | 100, 105, 110, 115, 120V ₊₁₀ / ₋₁₅ // 200, 210, 220, 230, 240V |
| Au | DC | 24V±10% |

*1 Lead wire specifications (between ZCT and transducer) Make sure to use shielded wires. Connect the shield (drain line) to the "±" input terminal.

| Shielded wire specifications | Allowable lead length |
|---|-----------------------|
| Two-core shielded wire of 0.5~2.0mm² (CVVS, etc.) | 25m or less one way |

- *2 The ZCT is a dedicated accessory and thus cannot be used in combinations other than those specified for the transducers.
- *3 When the power supply frequency (fi) and the output frequency (fo) are close to each other in the inverter circuit, beating may occur in the leakage current and the output may fluctuate.
- *4 Influence of external magnetic field An error of approximately 0.4% may occur due to application of an external magnetic field of 200A/m to the main unit and ZCT.
- *5 Isolation between the input circuit and output circuit


 The input and output terminals of the main unit are not insulated.

 The measurement circuit (input side) and output circuit can be isolated by using the accessory ZCT.
- *6 The grade indicates the accuracy when only a fundamental wave is input.


The influences of harmonic components are basically as follows.

- ●Third harmonic content 30% ------ approx. +2.0%
- ●Fifth harmonic content 30% ·······approx. +0.5%
- •Eleventh harmonic content 30% approx. +0.1%

■Harmonic attenuation waveform of low-pass filter




■Application example

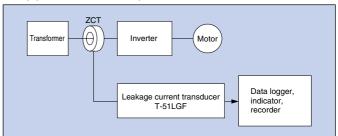


(with Built-in Low-pass Filter) [Insulated]

Connection diagrams (Refer to p.156 for outer dimensions.)

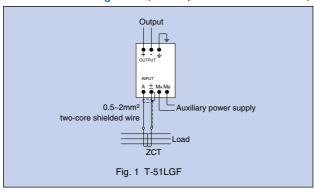

■Outer dimensions of the ZCT unit

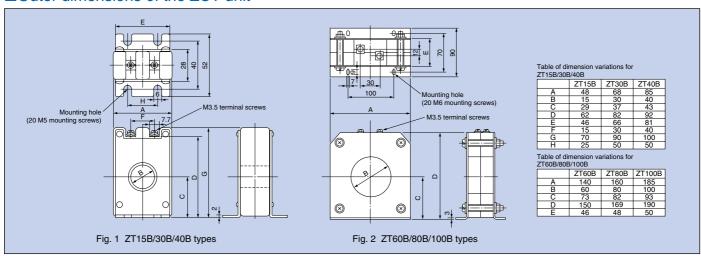

Ordering method





Voltage (Rise/Drop) Detectors [Insulated]

T-51/T-101 Series

<1-phase/3-phase>

These detectors instantaneously detect a voltage drop (or rise) compared to a previously set value, an open phase or a reverse phase (only for 3-phase) in 1-phase or 3-phase AC circuits and output a contact signal.

A "CAL signal" proportional to a preset value is output to enable accurate setting and checking of the value set.



T-101VDL

Applications

- Detecting flicker and instantaneous power interruption
- Monitoring computer power supply
- ●Detecting open phases, reverse phases (only 3-phase AC circuits)

Delivery period classification

| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Symbol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| - | Outer snape | Model name | Function | Circuit | Rated voltage | Setting ran | ge and accur | асу | Dete | | Auxiliant nawar aunnly | Weight | Delivery period |
|---|-------------|------------|-------------------|---------------|--|---|----------------------------------|----------|---|---|----------------------------------|---------|-----------------|
| | Onte | woder name | Function | Circuit | nateu voitage | Variable setting range | CAL output | Accuracy | Method and detection time | Output | Auxiliary power supply | vveigni | classification |
| | × | T-101VDL | Drop detection | 1-phase | 110VAC or 220VAC 50 and 60Hz | ●110V circuit 30~130V ●220V circuit 60~260V | DC 0.3~1.3V DC 0.6~2.6V | | ●Method Voltage crest value detection method | ●Form no-voltage 1c relay contact ●Contact capacity | 110VAC -15 % | 0.6kg | 0 |
| ſ | POX | T-101VDH | Rise detection | or 3-phase | Consumption VA (between lines) 110V: 0.2 220V: 0.4 | ●110V circuit 90~180V ●220V circuit 180~360V | DC 0.9~1.8V DC 1.8~3.6V | ±5% | MethodDetection time1 cycle | 250VAC 3A 30VDC 3A (resistive load) • Alarm indication lamp Red LED | 50 and 60Hz Consumption VA: 3 | 0.6kg | 0 |

- *1 Manufacturable range
 - Auxiliary power...100/110/120/200/220/240VAC (voltage tolerance *10 %) supply 24VDC (voltage tolerance +10%) 100, 120VDC (voltage tolerance tolerance tolerance +10%)
- supply 24VDC (voltage tolerance±10%), 100~120VDC (voltage tolerance 15 %) *2 The detection accuracy is the percentage compared to the rated voltage.
- *3 Output indicator lamp···A red lamp lights when the output contact is operating.
- *4 Output time
 - ●When the drop (or rise) time is 1s or less ········ 1±0.5s
 - ●When the drop (or rise) time exceeds 1s ······drop (or rise) time
 - ●For open or reverse phase ······duration of open or reverse phase
- *5 A contact signal is output when the voltage of one phase drops significantly (to approx. 50% or less of the rated voltage) in a three-phase AC circuit.
- *6 Due to the voltage crest value detection method, error may occur when the input waveform is distorted. Should this happen, calibrate the setting value in accordance with the actual equipment.


- *7 A model that operates when abnormal operation lasts for three cycles can also be manufactured. (Detection time: 40~70ms)
- *8 Continuous application of up to 180V is possible for the 110V rating, and up to 360V is possible for the 220V rating.
- *9 Dielectric strength
 - •Between input terminal and contact output terminal: 2000VAC for 1min.
- Between contact output terminal and CAL output terminal: 2000VAC for 1min.
- *10 CAL output load resistance: $5k\Omega\sim$.
- *11 Drop detection cannot be performed if the auxiliary voltage drops at the same time. The auxiliary power supply should thus be taken from a circuit where voltage drop does not occur.

Detection voltage setting (Please carefully read the accompanying instruction manual)


While measuring the output voltage between the (+) and (-) CAL outputs, set the output to the target value.

(Setting example)


| (| F - 7 | | | |
|---------|----------------|---------------|-------------------|------------|
| Example | Specification | Rated voltage | Detection voltage | CAL output |
| 1 | Drop detection | 110VAC | 90VAC | 0.9VDC |
| 2 | Rise detection | 220VAC | 260VAC | 2.6VDC |

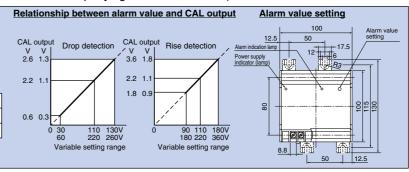

■Connection diagrams (Refer to p.156 for outer dimensions.)

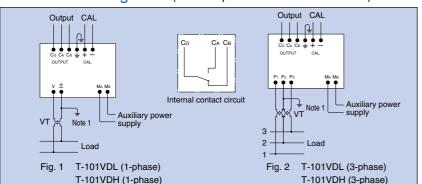

■Detection – output time example



Note 1. For low-voltage circuits, grounding of the secondary side of the instrument voltage transformer is unnecessary.



A ripple (AC component) of approximately 5% P-P is contained in the output of K Series models. Use this filter if the ripple is to be reduced to 1% P-P or less.

Delivery period classification


| Symbol | ⊚Standard | OQuasi-standard | △Special |
|---------------------------|--------------------|-----------------|---------------|
| Syllibol | product | product | product |
| Reference delivery period | Immediate delivery | Within 20 days | 21 to 60 days |

| M | lodel name | Input and output | | Internal resistance | Output ripple | Weight | Delivery period classification |
|---|------------|------------------|------------|---------------------|-----------------|--------|--------------------------------|
| | T-51FA | Voltage | ±20V max. | approx. 160Ω | 1% P-P or less | 0.5kg | 0 |
| | I-STFA | Current | ±30mA max. | арргох. 16052 | 1 % F-F 01 less | 0.5kg | |


^{*1} The H Series and S Series transducers do not require the use of T-51FA because the output ripple is 1% P-P or less.

Warning

The internal resistance of T-51FA is approximately 160Ω . Please note that problems such as the examples listed below may occur.

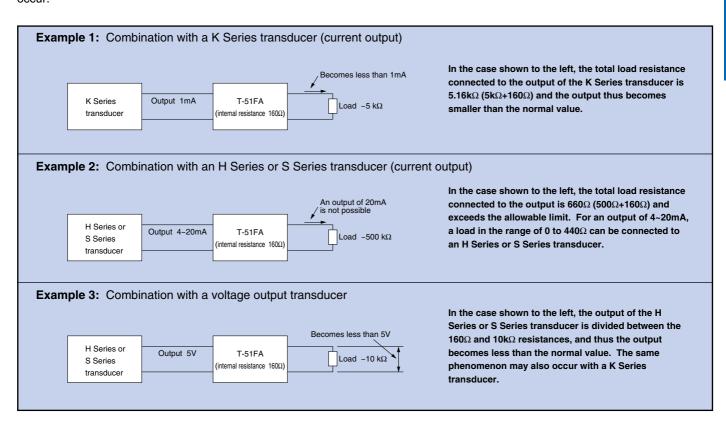

Connection diagrams (Refer to p.156 for outer dimensions.)

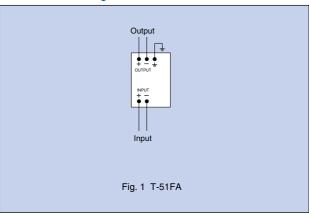


^{*2} T-51FA is not necessary when a transducer and an indicator (Mitsubishi Electric L or Y models) are used in combination.




1. T-51/T-101 Series mounting parts

•Breaker mounting plate for distribution panel

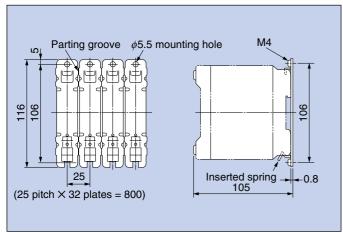

<sup>Please specify "BH-K plate" when purchasing.
10 sheets/box (32 plates/sheet)</sup>


Breaker coupling/mounting tabs for distribution panel

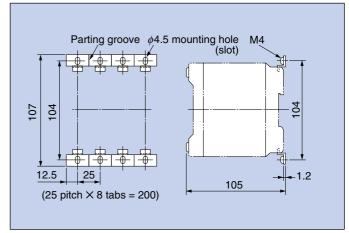

^{*} Please specify "BH-K coupling tabs" when purchasing. 80 sheets/box (8 tabs/sheet)

2. GR-2 standard resistor

Used to inspect resistance-bulb temperature transducers (T-51TP, T-101TPZ). Incorporates a resistance value corresponding to the rated input temperature.






■Method for mounting inside panels


Mounting work is to be performed by a person with the proper technological expertise.

•The following four types of mounting can be performed for models with standard specifications. The mounting parts can be used according to application.

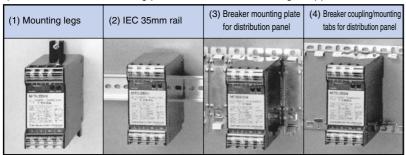


Accessories


Mounting legs are packaged together with the main unit as accessories.



(1) Using mounting legs

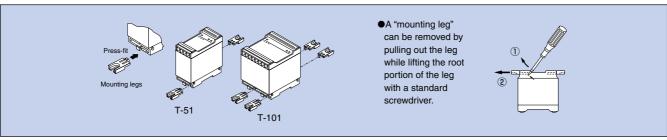


(2) Using an IEC 35mm rail

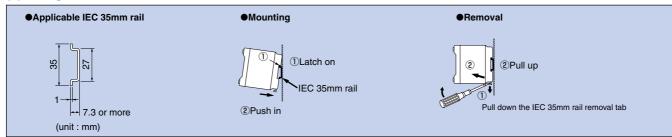


^{*} When mounting using an IEC 35mm rail, affix the unit using a stopper to prevent sliding to the side.

(3) Using a breaker mounting plate for distribution panel

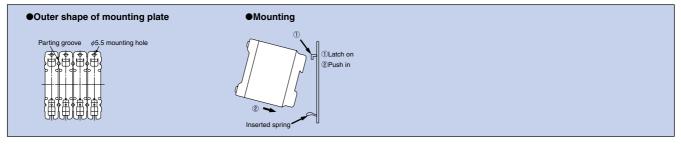

(4) Using a breaker coupling/mounting tabs for distribution panel

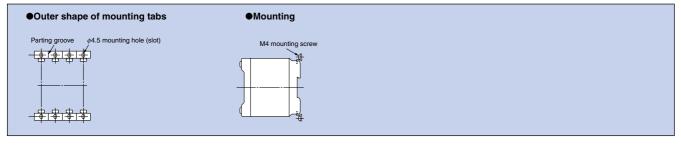


■Snap-fit terminal cover


- The terminal cover is fitted onto the partition walls of the terminal section and can be easily removed.
 - The cover can also be removed by placing the tip of a standard screwdriver into a slot along the side edge of the terminal cover.
- To attach the terminal cover, simply push the cover back into place.
- A nameplate can be inserted in the slot along the side edge of the terminal cover to indicate a signal name or equipment number.

The customer is requested to provide the nameplate.

| Outer shape | Nameplate dimensions |
|-------------|----------------------|
| T-51 | t0.8~1×7.5×45 |
| T-101 | t0.8~1×7.5×95 |

For safety reasons, use an insulating material as the material of the nameplate.

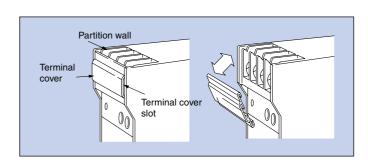




■Power supply indicator (lamp)

An indicator (red LED) that shows current is being in supplied from an auxiliary power supply is provided (except for K Series).

Use this for daily inspection and as a guideline for judging whether or not the device is operating.






■Wiring


Connection work is to be performed by a person with the proper technological expertise.


- Connections must be made correctly and securely. Be careful because erroneous wiring not only causes malfunctions and damages equipment, but may also spread problems to other power equipment.
- •As the lead wires for connecting the output and load of a transducer, use two-core shielded wires or twistedpair wires to prevent malfunction and failure due to transmission noise and disturbance surge. If the transmission distance exceeds 100m, current output specifications; for example, 4~20mA DC are recommended.
- Do not bring the output line close to or bundle it together with other power lines and the input lines (i.e., VT, CT and auxiliary power supply).
- •Although the H Series, S Series, instrumentation and peripheral transducers are provided with auxiliary power supply terminals, if the voltage of the measured circuit is comparatively stable and within the allowable range of the auxiliary power supply, the voltage can be supplied from the measured circuit (VT secondary side).
 However, if the voltage of a generator is supplied from the measured circuit, the transducer output may fluctuate when the voltage during operation such as starting or stopping of the generator falls below the rated value.
- Ground the shield line of a shielded cable on the receiving side.
 However, depending on the circumstances of external noise, it may be better to ground it on the transducer

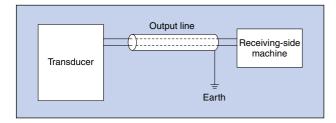

Connecting the input line

For temperature transducers, isolators, DC level transducers or other transducers that handle minute input signals, arrangements must be made to prevent interference such as noise and surge in the input line. For input lines such as these, in order to prevent incorrect operation and failure due to transmission or noise interference, please use shielded or twisted cables. Additionally, avoid installation alongside power lines or other noise sources as well as pairing different input lines with each other and other lines as shown below.

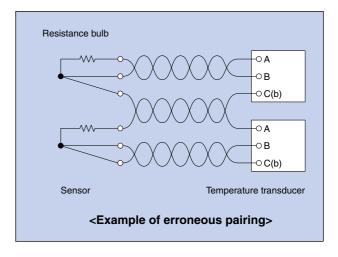


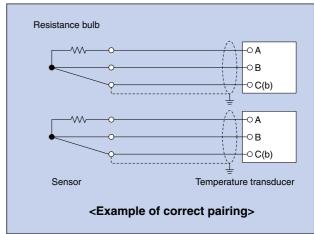

side.


Signal line connection distance

The connection distance depends on conditions such as the output signal line specifications of the transducer, signal line installation method, external magnetic field and electric field, and cannot be determined unconditionally. However, empirically speaking, the lengths shown below should be used as a reference.

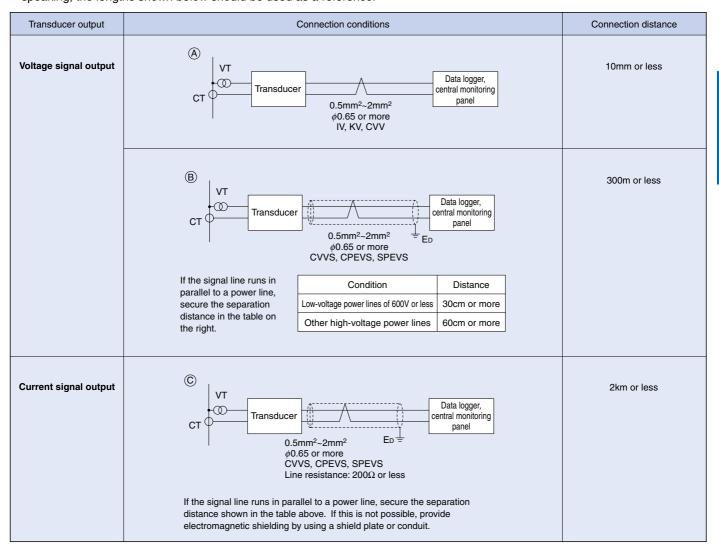

■Applicable crimp terminals and tightening torques

| Series | Applicable crimp terminals | Tightening torque |
|-------------|--|-------------------|
| T-51, T-101 | Round crimp terminals (outer diameter: ϕ 8.5 or less) for M4 screws | 0.98~1.47N•m |





■Short-circuiting and opening of output terminals


- ●Terminals for current output ··········· Although the terminals may be opened/short-circuited, a voltage of 8~50V is generated when they are opened.
- ●Terminals for voltage output ········ Although the terminals may be opened, do not short-circuit them.

Checking output

Release the load and measure with a voltmeter or ammeter using an input resistance within the specified load range (except the K Series).

K Series transducer

Measure with a voltmeter or ammeter using the same input resistance as the specified load resistance. If such an indicator is not available, check using the following method.

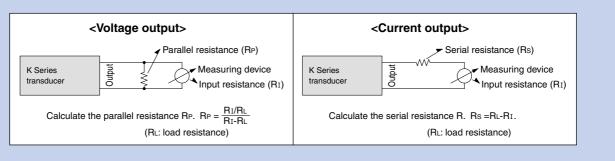

■Output adjustment

- Although the transducer output is adjusted according to the predetermined specifications, use the span adjuster or zero adjuster on the transducer surface to perform readjustment for matching.
 Ordinarily, do not touch these except in special cases.
- With the T-51 and T-101 series, output adjustment is performed upon removing the cap. For dust prevention, put the cap back on after adjustment.
- Adjustment method
 - ① With the span adjuster and zero adjuster, the output increases when turned clockwise and decreases when turned counterclockwise.
 - ② With the zero adjuster, the output range is increased or decreased by a fixed value (approximately ±0.3~±5% with respect to the span) as shown in the figure on the right.
 - ③ With the span adjuster, the output increases or decreases at the same proportion (±3%~±15% with respect to the rated output) with zero input as the base point.
- Output
 Input

 Output
 Input


 Output
 Input

 Input


- Standard adjustment procedure
 - Apply the auxiliary power supply and perform zero adjustment so that the predefined output is output in a state where an input is not applied. Then, apply the rated input and perform span adjustment so that the rated output is output. However, zero adjustment of a frequency transducer is performed with the lower-limit frequency being input, and span adjustment is performed with the upper-limit frequency being input.
- Do not apply an excessive force to the adjusters.



●Fig. 1 T-51 Series

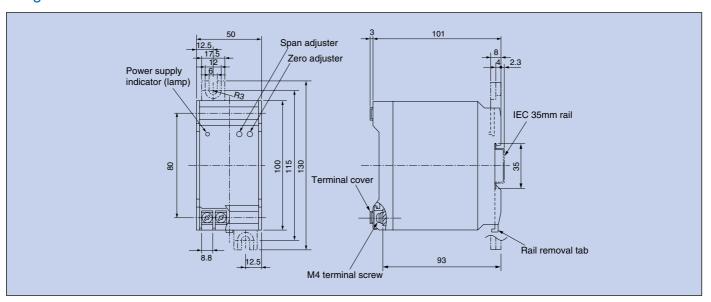

●Fig. 2 T-101 Series

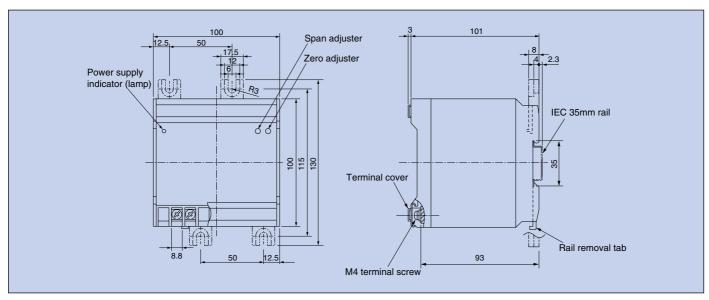



T-120M collective Multi-transducers


With multi-transducers, the required AC electric quantities can be measured by inputting the secondary sides of a VT and CT.

- Measurement elements
 - Analog outputs

AC voltage, AC current, active power, reactive power Power factor, Frequency

Harmonic voltage, harmonic current

- Pulse outputs
 - Active electric energy, reactive electric energy
- ●Block diagram

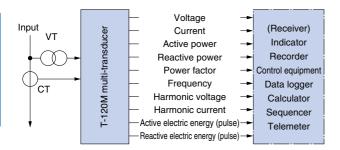



■Features

- •Various elements can be measured with one unit.
- ●A liquid-crystal display and buttons enable setting flexibility.
- •Supports power flow measurement (sending, receiving) and can be used for monitoring power generating equipment. (Active power, reactive power, power factor, active electric energy, reactive electric energy)
- Compact size realizes reducted mounting space.

■Analog output patterns

| Dhaga wire | Analog output pattern | Measurement element | | | | | | | | | | | | |
|--------------------------|-----------------------|---------------------|------------------|-------------|----------------|------------|-----|-----|-----|------------------|------|--------------------|------|--|
| Phase-wire system | | | | | Pulse output | | | | | | | | | |
| 5,510111 | | CH1 | CH2 | СНЗ | CH4 | CH5 | CH6 | CH7 | CH8 | CH9 | CH10 | CH11 | CH12 | |
| 3-phase | P01 | V ₁₂ | V ₂₃ | V 31 | l ₁ | l 2 | Із | W | PF | var | Hz | | | |
| 3-wire system 1-phase | P02 | V ₁₂ | HV ₁₂ | V 31 | l ₁ | l 2 | HI₁ | W | PF | var | Hz | Wh, Varh | | |
| 3-wire system | P03 | V ₁₂ | V ₂₃ | V 31 | l ₁ | l 2 | Із | W | PF | HV ₁₂ | HI₁ | (set using switch) | | |
| 1-phase 2-wire system | P01 | V ₁₂ | HV ₁₂ | 1 | l ₁ | _ | HI1 | W | PF | var | Hz | | | |

The output pattern is fixed at P01 for 1-phase, 2-wire systems.

HI: Harmonic current, HV: Harmonic voltage, -: No measurement element (fixed at lower limit output)

[Insulated]

■Specifications

| | | Ite | em | | | Specification | | | | | | | | | | |
|----------------------|---------------------------|---------------------------|---|---|---|--|--|--|--|--|--|--|--|--|--|--|
| M | ode | el name | | T-120M | | - | | | | | | | | | | |
| In | dic | ator rating |) | 110V/220 | 0V 5A 50/60Hz | | | | | | | | | | | |
| Р | has | e-wire sys | stem | Can be u | used in common with 1-pha | se, 2-wire, 1-phase, 3-wire and 3- | phase, 3-wire systems | | | | | | | | | |
| Ν | um | ber of out | put points | Analog o | output: 10, pulse output: 2 | | | | | | | | | | | |
| | | | | | 1-phase, 2-wire, | Secondary voltage 110V: 0~150 | | | | | | | | | | |
| | | AC volta | ge | Grade 0.5 | 3-phase, 3-wire | Secondary voltage 220V: 0~300 | | | | | | | | | | |
| | _ | | | | phase, 3-wire | 0~150V/0~300V (set using swite | ch) V ₃₁ is fixed at 300V | | | | | | | | | |
| | = | AC curre | ent | Grade 0.5 | | | | | | | | | | | | |
| ements | ith JIS C 1111) | Active po | ower | Grade 0.5 | Positive side: Can be set in the r | t using switch) (P: rated power) range of approx. 40~120% of the rated power. range of approx20~-100% of the rated power. ent is enabled) | 1-phase 110V 500WXVT 2-wire 220V 1000W | d voltage ratioXCT ratio /XCT ratio /XCT ratio | | | | | | | | |
| Measurement elements | Analog (complies with JIS | Reactive | power | Grade 0.5 | Q (lead) ~0~Q (lag) kvar (Can be set in the range of app (power flow measurement) | rox. 40~120% of the rated reactive power. | | ratioXCT ratio /XCT ratio | | | | | | | | |
| sance |) (con | Power fa | Power factor | | Lead 0.5~1~Lag 0.5/Lead (power flow measurement) | 1 0~1~Lag 0 (set using switch) ent is enabled) | | | | | | | | | | |
| Je j | 9 | Frequen | | Grade 1.0 | 45~55Hz/55~65Hz (set us | | | | | | | | | | | |
| _ | Ans | Harmonic voltage | Overall (2nd to 15th- order) content (%) | Grade 2.0 | 0~30VXVT ratio (when 110V is selected as 0~20% (switching betwee | secondary voltage) (Fixed at 0~30V in the case is enabled) | of 1-phase 3-wire.) | | | | | | | | | |
| | | Harmonic current | Overall (2nd to 15th- order) content (%) | Grade 2.0 | | ratio/0~5AXCT ratio (set using sen effective value and content (% | | | | | | | | | | |
| | Pulse | Active el | ectric energy | Complies | s with JIS C 1216 (ordinary | class) (switching between sendin | g and receiving directions is | enabled) | | | | | | | | |
| | Pu | Reactive | e electric energy | Complies | s with JIS C 1263 (switching | between sending and receiving | directions is enabled) | | | | | | | | | |
| | | | specifications | | | set using switch) ($5k\Omega\sim\infty$), specify | y when ordering | | | | | | | | | |
| | | stive load) | | * With limiter function and zero and span adjustment functions | | | | | | | | | | | | |
| R | ippl | е | | 1% P-P or less | | | | | | | | | | | | |
| R | esp | onse | Effective value | | | itched for current and power) | | | | | | | | | | |
| | ee | | Harmonics | 7s (demand time interval can be switched) | | | | | | | | | | | | |
| | | | Demand time interval setting | | 0~60s (in 10s intervals), 1~10min (in 1min intervals), 10~30min (in 5min intervals) (0s setting is instantaneous output.) | | | | | | | | | | | |
| P | ulse | e output s | pecifications | Contact of Pulse wid | Output form: semiconductor relay, no-voltage contact Contact capacity: Leak current for 110VAC or less, 0.1A or less: 15μA for 110VAC Leak current for 100VDC or less, 0.1A or less: 1μA for 100VDC (on resistance is 12Ω or less) Pulse width: 0.125s/0.5s/1s±20% (set using switch) Pulse units: Selected from 4 types according to full-load active power (set using switch; see "Setting method" for details) | | | | | | | | | | | |
| D | ispl | ay | | Liquid-crystal display is lit while power is supplied (RUN, analog output pattern display) Various settings are possible (set as primary side values) | | | | | | | | | | | | |
| A | uxil | iary powe | | | any of 100-240VAC $^{+10}_{-15}$ %, | | | | | | | | | | | |
| С | ons | umption | Voltage circuit | | | nen approx. 220V (all phases) | | | | | | | | | | |
| V | | | Current circuit | | 0.1VA (all phases) | N/A (000)/AO) 0N/ (400)/E | 20/ | | | | | | | | | |
| | 4 | | Auxiliary power supply | | | VA (220VAC), approx. 6W (100VE | JC) | | | | | | | | | |
| | | r dimensio | | | H100×D101 | o: M2 E | | | | | | | | | | |
| | | inal screw | /8 | Input terminals: M4, output terminals: M3.5 | | | | | | | | | | | | |
| ۷۱ | eig/ | H | | 0.6kg | Houseut terminals as a whole and suter | a batuaan auviliaru nawar tarminala aa a whale eed e | utor cooing | 00001/40 | | | | | | | | |
| | | mercial fre tand volta | | Between voltag | Between input/output terminals as a whole and outer casing, between auxiliary power terminals as a whole and outer casing 2000VAC Between voltage input terminals as a whole and current input terminals as a whole, between auxiliary power terminals as a whole and input terminal as a whole 50/60Hz 1min | | | | | | | | | | | |
| In | sul | ation resis | stance | $10M\Omega$ or more at the same locations as the above (500VDC) | | | | | | | | | | | | |
| | | | | | | erformed unless the fundamental wave | e content is 75% or more of the ra | ted voltage | | | | | | | | |

Remarks (1) Regarding the harmonic output, measurement of harmonics cannot be performed unless the fundamental wave content is 75% or more of the rated voltage.

(2) An analog output of approximately 100% or more may be output for a few seconds immediately after turning on the auxiliary power supply (until the internal voltage stabilizes).

■Mounting method

Four types of mounting are available.


The mounting methods are the same as those of the T-51 and T-101 series. Refer to the "Mounting method for T-51 and T-101 series" on p.151.

■Names and number of accessories

Mounting legs ······4pcs.

Instruction manual ······1 copy

■Operation method



(2) Method for checking settings (button functions)




When the ⊕ button or ⊖ button is pressed for 1s or more, the setting value checking mode is entered. The respective setting values are displayed by consecutively pressing the ⊕ button or ⊖ button (refer to "Setting method" in regard to the screen).

- Primary ← Primary ← Active power ← Active power measurement ← Power factor ← Reactive power ← Voltage current measurement range range (negative side)
- → Operation screen ← → Pulse output CH12 ← → Pulse output CH11 ← → Harmonic current ← → Harmonic voltage ← → Frequency ←
 The active power measurement range (negative side) is displayed when the special bidirectional setting is set for active power.
- The harmonic voltage and harmonic current are not displayed when the analog output pattern is P01.
 The reactive power measurement range and frequency are not displayed when the analog output pattern is P03.

Setting Method

Setting method

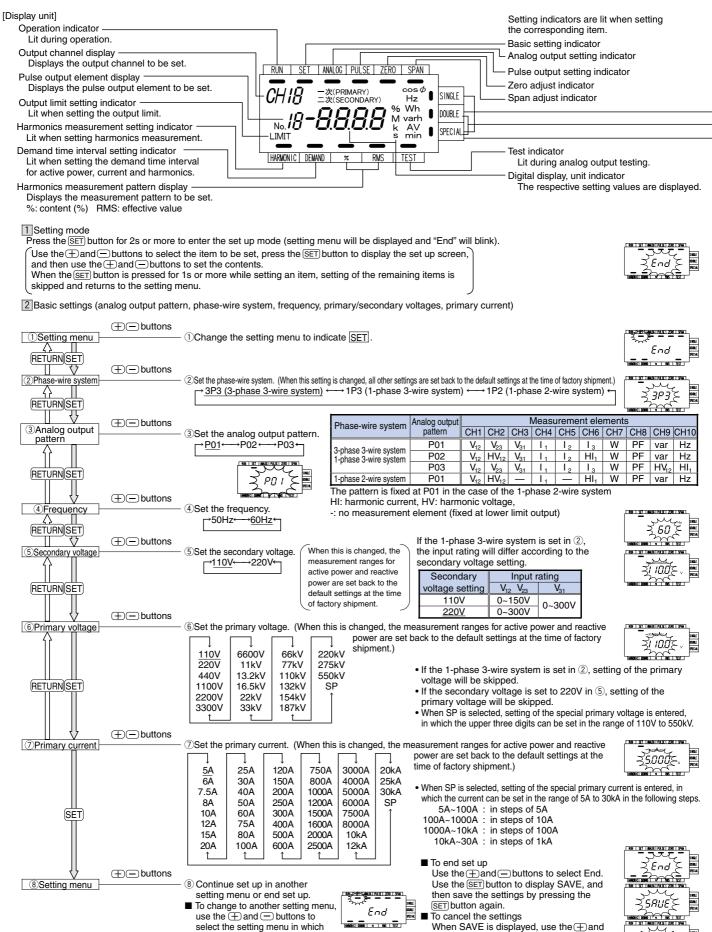

set up is to be performed.

buttons to select CANL and then press

the (SET) button to cancel the settings.


ZCRNLS

Active power measurement direction setting indicator. [Button functions] Indicates the active power measurement direction to be set. SINGLE: unidirectional, DOUBLE: bidirectional, DOUBLE SPECIAL: special bidirectional Indication of measurement direction of power factor and reactive :The set up mode is entered when this is pressed for 2s or more. power during power flow Used for selecting an item to be set, and setting various items. Indicates the measurement direction of power factor and reactive + or -: Used for increasing/decreasing a setting value during set up, and power during power flow.

DOUBLE: Without power flow expansion for checking setting values. :Used for selecting (setting back) an item to be set. RETURN SPECIAL: With power flow expansion. Special primary voltage/current setting indicator The underline in the setting specifications indicates 3 Analog output settings the default value at the time of factory shipment. (一) buttons 1 Setting menu 1) Change the setting menu to indicate ANALOG End (RETURN)(SET ⊕ buttons 98 | ST | MACK | PUS | 200 | SI ②Set the unidirectional, bidirectional, or special bidirectional setting for active power measurement.

→ SINGLE: unidirectional ←→ DOUBLE: bidirectional ←→ DOUBLE SPECIAL: special bidirectional ← 2 Unidirectional 1000 bidirectional or special bidirectional Example for active power of 1000kW setting for active power Special bidirectiona {} RETURN SET 12 ⊕ buttons 1000W -1000W 1000W -250W 1000W Power 3)Set the active power measurement range Phase-wire system | Secondary voltage Rated active power (A) Setting of the upper three digits can be 3,000,5 3-phase 1000WXVT ratioXCT ratio performed in a range of approx. 40~120% of the rated active power 3-wire 220\ 2000WXCT ratio (table on the right). system (Direct) (B) If the special bidirectional setting is set, the negative side measurement 1-phase 3 wire system 1000WXCT ratio RETURN SET 1-phase 110V 500WXVT ratioXCT ratio range can be set in a range of approx. 2-wire 220V -20~-100% of the rated active power (-25% at the time of factory shipment) 1000WXCT ratio system (Direct) The unit will be var in the case of reactive power. in continuation to (A). ⊕ buttons 4 Power factor (4) Set the value of the power factor with respect to the maximum output value (see "(8) Power flow" for an output example) →<u>0.5-1 (LEAD0.5-1-LAG0.5)</u> ←→0-1 (LEAD0-1-LAG0) ← RETURN SET ⊕ buttons ⑤Reactive power ⑤Set the reactive power measurement range (see "® Power flow" for an output example). 30002 \bullet The upper three digits can be set in a range of approx. 40~120% of the rated RETURN SET reactive power (setting at the time of factory shipment: 100%). ⊕ buttons When this is changed, the zero adjust 6 Analog output 6Set the analog output to 1-5V or 0-5V. <u>1-5V (1-5V output)</u> ←→0-5V (0-5V output) 0-5 or 1-5 and span adjust are set back to the default settings at the time of factory shipment. This setting is not available with the 4-20mA specifications for analog output. RETURN SET • The same specifications are applied to all analog output CHs. Setting according to CH cannot be performed ⊕ buttons N | SET | MANUE | POLSE | 2590 | 5990 Output limit Set the analog output when the full scale is exceeded. →<u>oFF (no limit)</u> ← → on (with limit) ← ZOFF E oFF (no limit): The upper-limit output is output to approx. +5% RETURN SET and the lower-limit output is output to approx. -5%. on (with limit): The upper-limit output is output to approx. +1% and the lower-limit output is output to approx. -1%. ⊕ buttons 8 Power Set the measurement direction of power factor/reactive power during power flow. 2-4 DOUBLE (without power flow expansion) → 2-4 SPECIAL (with power flow expansion) (Without poy (With power flow expansion) ver flow expansion) 0-1-0 0-1-0 0.5-1-0.5 12 12 0 0.5 1 0.5 0 0.5 1 0.50 0.5 0.5 0 0.5 1 0.5 0 0.5 1 0.50 (With power flow expansion SET Lead Lag Lead Lag Send Receiv Lead Lag Receive Example in the case of reactive power of 1000va ⊕ buttons Ontinue set up in another setting menu or end set up. 9 Setting menu (Refer to 8 Setting menu of 2 Basic settings.") End

Setting Method



(+)(-) buttons

⊕ buttons

⊕ buttons

2 Pulse output

RETURN SET

③ Pulse output

RETURN SET

(4) Set the element and

pulse unit for pulse

output CH2 in the same manne

(RETURN)(SET)


5 Pulse width


6Setting menu

SET

CH1 pulse unit

CH11 element






| Element that can be set | | | | | | | | | | |
|-------------------------|---|--|--|--|--|--|--|--|--|--|
| Element (indication) | Pulse output element (measurement range) | | | | | | | | | |
| No 1 Wh | Active electric energy (receiving) (pulse output CH11) | | | | | | | | | |
| No 2 Wh | Active electric energy (sending) | | | | | | | | | |
| No 3 varh | Reactive electric energy (receiving, lag) (pulse output CH12) | | | | | | | | | |
| No 4 varh | Reactive electric energy (receiving, lead) | | | | | | | | | |
| No 5 varh | Reactive electric energy (sending, lag) | | | | | | | | | |
| No 6 varh | Reactive electric energy (sending, lead) | | | | | | | | | |
| No 7 varh | Reactive electric energy (receiving, lag + sending, lead) | | | | | | | | | |
| No 8 varh | Reactive electric energy (receiving, lead + sending, lag) | | | | | | | | | |
| None | No pulse output element | | | | | | | | | |
| | | | | | | | | | | |

③Set the pulse unit for the pulse output CH11 (C1A-C1B).

Select from the table below in accordance with the full-load active power.



Full-load active power (kW)= $\alpha \times$ (primary voltage) \times (primary current)


(α: 1 for 1-phase, 2-wire system; 2 for 1-phase, 3-wire system; $\sqrt{3}$ for 3-phase, 3-wire system) However, calculate with the primary voltage being 100V for the 1-phase, 3-wire system. For reactive power, the unit W is changed to var.

(4) The same elements as those of CH11 can be set for the pulse output CH2 (C2A-C2B).

5 Set the pulse width

<u>0.125s</u>←

The same specifications are applied to all pulse output CHs. Setting according to CH



- When 0.500s is set: full-load active power/pulse unit≤3600
- When 1.000s is set: full-load active power/pulse unit≤1800
- 6 Continue set up in another setting menu or end set up (Refer to Setting menu of " | Basic settings.")




₹<u>0</u> 125€

CHI SOUD I E

5 Analog output adjustment (zero adjust, span adjust)

(+)(−) buttons



1) Change the setting menu to indicate ZERO SPAN.

2 Perform zero adjustment of the analog output CH1. Set in the range of $-30\sim0\sim30$

- · During current output, adjustment of approx ±0.16mA can be performed.

 • During voltage output, adjustment of approx.
- ±0.05V can be performed.
- 3 Perform span adjustment of the analog output CH1. Set in the range of -75~0~75.
 - During current output, adjustment of approx. ±0.48mA can be performed.
 - · During voltage output, adjustment of approx. ±0.15V can be performed.

Movement of zero adjustment value Input

Movement during span adjustment

⑤Continue set up in another setting menu or end set up. (Refer to 8 Setting menu of "2 Basic settings.")












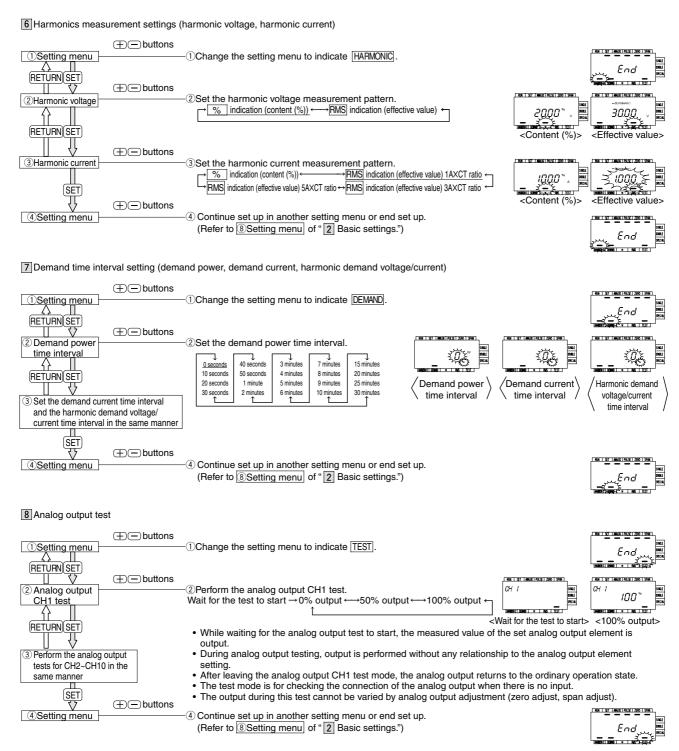


Remarks: Refer to "Operation method" on p.158 regarding the method for checking settings.



Input/Output Relationships


■Input/Output relationships

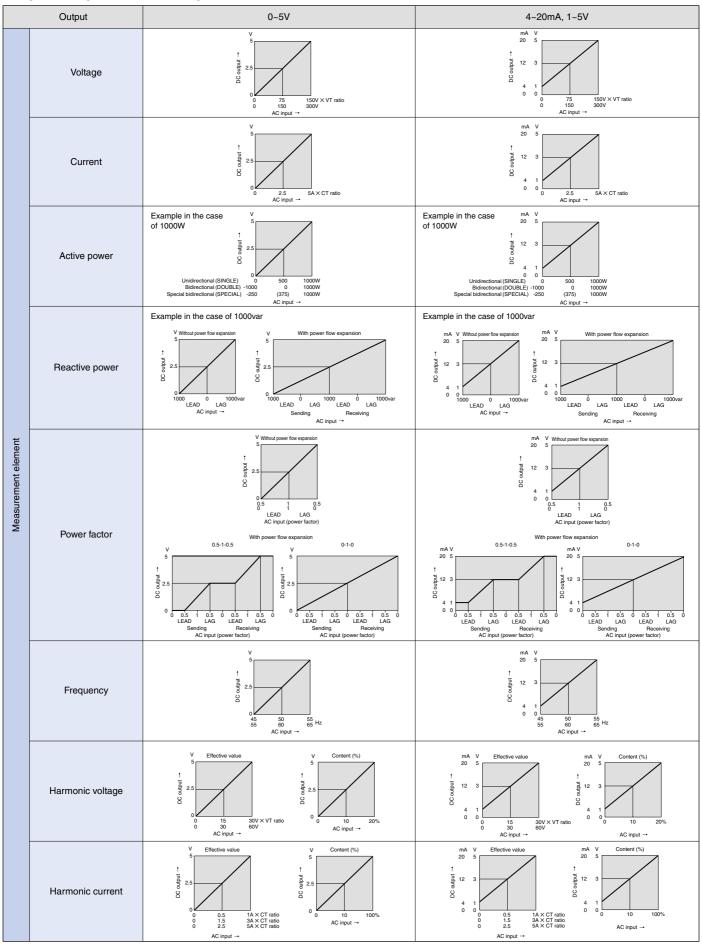




Outer Dimensions/Connection Diagrams

Outer dimensions, and names and functions of respective parts

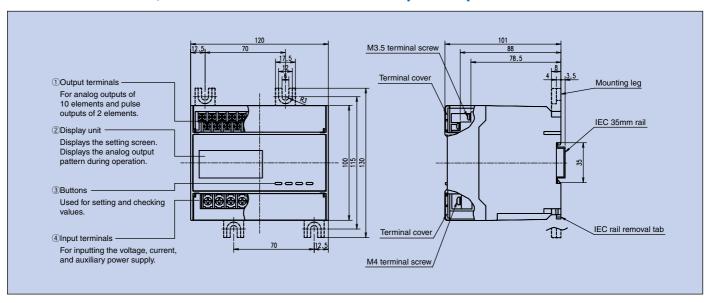

■Connection diagrams

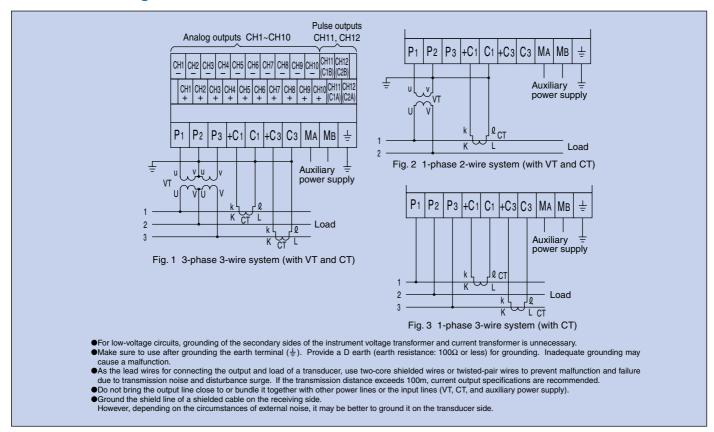

■Ordering method

| Model name | Output Voltage or current | Number of units |
|------------|------------------------------|-----------------|
| T-120M | 0-5V | 3 |

Special Application Transducers

T-120HA harmonics transducers [Insulated]

■Applications


Harmonics transducers perform constant monitoring of the harmonic voltage and harmonic current of a power system, and help to prevent disorder due to harmonics in advance.



■Features

- Various harmonics measurement elements (10 elements) can be measured with one unit.
- •The harmonic voltage and current can be measured with one unit.
- ●The harmonic voltage (current) effective value and content (%) can be measured (*).
- The instantaneous value and average value can be measured. (Switching)
- *: Output selected by setting

■Usage example

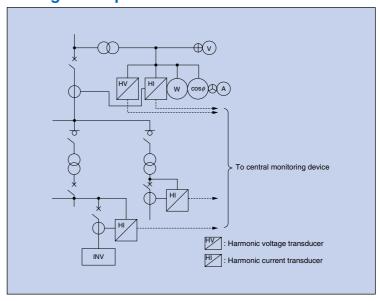

■Analog output patterns

| Analog output nottorns | | Measurement element | | | | | | | | | | | |
|------------------------|------|---------------------|------------------|--------------|---------------|---------------|--------------|-----|------|------|--|--|--|
| Analog output patterns | CH1 | CH2 | СНЗ | CH4 | CH5 | CH6 | CH7 | CH8 | CH9 | CH10 | | | |
| P01 | V(1) | V(3) | V(5) | V(7) | V(11) | V(13) | ΣVH | ΣІн | Vrms | Irms | | | |
| P02 | I(1) | I (3) | I ₍₅₎ | I (7) | I (11) | I (13) | ΣVΗ | ΣІн | Vrms | Irms | | | |
| P03 | V(3) | V ₍₅₎ | V ₍₇₎ | I (3) | I (5) | I (7) | Σ V H | ΣІн | Vrms | Irms | | | |

(1) (3) (5) (7) (11) (13): order of harmonic wave, Σ : overall harmonic wave, rms: overall effective value

■Specifications

| | It | em | | | Specification | | | | | | | |
|--|------------------|--------------------------------------|---|--|---|---------------------|--|--|--|--|--|--|
| Mod | del name | | T-120HA | | · | | | | | | | |
| Indi | cator rating | | 110V/220V | 5A 50/60Hz | Z | | | | | | | |
| Pha | se-wire syster | n | 1-phase, 2- | 1-phase, 2-wire system | | | | | | | | |
| Nur | nber of output | points | Analog output: 10 points | | | | | | | | | |
| | AC voltage | Effective value | Grade 0.5 | 110/220V | Secondary voltage 110V: 0~150VXVT ratio | | | | | | | |
| l s Î | AC voltage | Fundamental wave component | Grade 2.0 | 110/2200 | Secondary voltage 220V: 0~300V | | | | | | | |
| <u>∓</u> | AC current | Effective value | Grade 0.5 | 5A | 0~5AXCT ratio | | | | | | | |
| ĔÖ | AO Cuiteili | Fundamental wave component | Grade 2.0 | JA | 0~3AXOTTAIIO | | | | | | | |
| e S | | Orders measured | 3rd, 5th, 7t | 3rd, 5th, 7th, 11th, 13th, and overall (2nd to 15th-order) harmonics | | | | | | | | |
| r C | Harmonic | n-th order (overall) | | | Secondary voltage 110V: 0~30VXVT | | | | | | | |
| me ≱itl | voltage | effective value | Grade 2.0 | 110/220V | Secondary voltage 220V: 0~60V | | | | | | | |
| are | | Content (%) | | | 0~20% (switching between effective value and content (%) is e | enabled) | | | | | | |
| ast | | Orders measured | 3rd, 5th, 7t | h, 11th, 13th, | and overall (2nd to 15th-order) harmonics | | | | | | | |
| Measurement elements (complies with JIS C 1111) | Harmonic current | n-th order (overall) effective value | Grade 2.0 | 5A | 0~1AXCT ratio/0~3AXCT ratio/0~5AXCT ratio | | | | | | | |
| | | Content (%) | | | 0~100% (switching between effective value and content (%) is | ent (%) is enabled) | | | | | | |
| | log output spe | cifications | 4~20mA (0~600Ω) or 0~5V/1~5V (set using switch) (5kΩ~∞), specify when ordering | | | | | | | | | |
| _ \ | istive load) | | *With limiter function and zero and span adjustment functions | | | | | | | | | |
| Rip | ole | | 1% P-P or | less | | | | | | | | |
| | | Overall effective value | 1s | | | | | | | | | |
| | ponse | Fundamental wave component | 7s | . • | | | | | | | | |
| spe | ed | n-th order/content (%) | 7s (demand time interval can be set) | | | | | | | | | |
| | | Demand time intervals | 0~60s (in 10s intervals), 1~10min (in 1min intervals), 10~30min (in 5min intervals) | | | | | | | | | |
| Dis | olay | | Liquid-crystal display lights when electricity is supplied (RUN, analog output pattern display). Various settings are possible (set as primary-side values). | | | | | | | | | |
| Aux | iliary power su | ipply | Can use any of 100-240VAC ⁺¹⁰ ₋₁₅ %, 50-60Hz, 100VDC ⁺⁴⁰ ₋₂₅ % | | | | | | | | | |
| | | Voltage circuit | 0.1VA whe | n approx. 110 | V, 0.2VA when approx. 220V (all phases) | | | | | | | |
| Cor | sumption VA | Current circuit | Approx. 0.1 | VA (all phase | es) | | | | | | | |
| | | Auxiliary power supply | Approx. 10 | VA (110VAC), | , approx. 12VA (220VAC), approx. 6W (100VDC) | | | | | | | |
| Out | er dimensions | (mm) | W120×H10 | 00×D101 | | | | | | | | |
| Teri | minal screws | | Input termi | nals: M4, outp | out terminals: M3.5 | | | | | | | |
| Wei | ght | | 0.6 kg | | | | | | | | | |
| | | | | | rminals as a whole and outer casing | | | | | | | |
| | | | Between a | uxiliary power | r terminals as a whole and outer casing | 2000VAC | | | | | | |
| Cor | nmercial freque | ency | | 0 1 | erminals as a whole and current input terminals as a whole | (50/60Hz) | | | | | | |
| with | stand voltage | | | , , | r terminals as a whole and input terminal as a whole | 1min | | | | | | |
| | | | | | as a whole and output terminals as a whole | '''''' | | | | | | |
| | | | Between a | uxiliary power | r terminals as a whole and output terminal as a whole | | | | | | | |
| Insu | ılation resistan | ce | 10M Ω or m | ore at the sar | me locations as above (500VDC) | | | | | | | |

Remarks (1) Regarding harmonic output, the measurement of harmonics cannot be performed unless the fundamental wave content is 75% or more of the rated voltage.

(2) An analog output of approximately 100% or more may be output for a few seconds immediately after turning on the auxiliary power supply (until the internal voltage stabilizes).

■Mounting method


Four types of mounting are available.

The mounting methods are the same as those of the T-51 and T-101 series. Refer to the "Mounting method for T-51 and T-101 series" on p.151.

■Names and numbers of accessories

Mounting legs ------4pcs.
Instruction manual -----1 copy

■Operation method



(2) Method for checking settings (button functions)



- When the⊕button or ⊕button is pressed for 1s or more, the setting value checking mode is entered. The respective setting values are displayed by consecutively pressing the⊕button or ⊕button (see the "Setting method" for the screen).

rimary voltage ←Primary current ←Harmonic voltage ←Harmonic current ←Operation screen ←



Special Application Transducers

T-120HA harmonics transducers [Insulated]

10A

12A

15A

20A

(+)(-) buttons

60A

75A

80A

100A

6 Continue set up in another setting menu or end set up.

set up is to be performed

To change to another setting menu,

use the \oplus and \bigcirc buttons to

select the setting menu in which

300A

400A

500A

600A

1500A

1600A

2000A

2500A

7500A


8000A

10kA

12kA

End

Setting Method

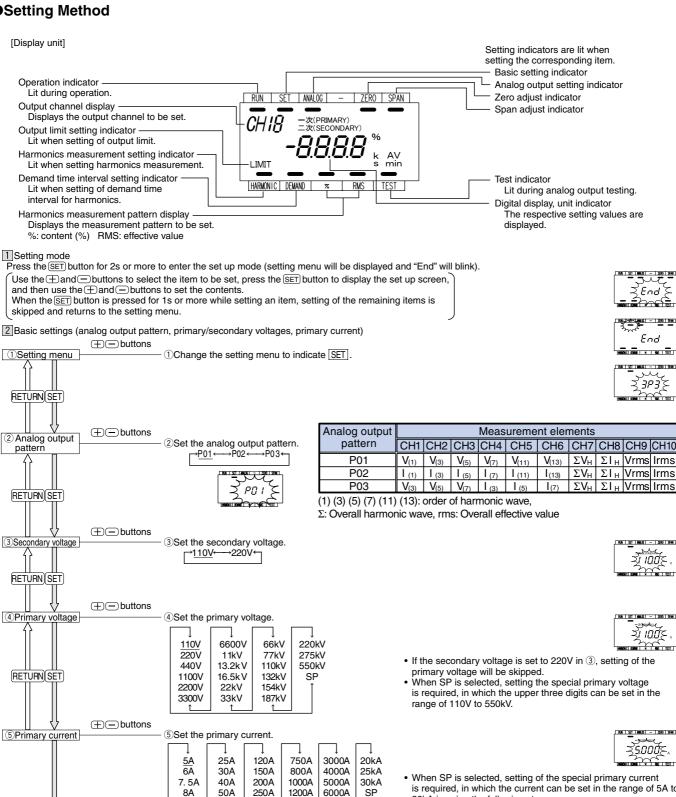



is required, in which the current can be set in the range of 5A to 30kA in using the following steps.

5A~100A: in steps of 5A 100A~1000A: in steps of 10A 1000A~10kA: in steps of 100A 10kA~30A: in steps of 1kA

■ To end set up

Use the ⊕and —buttons to select End. Use the SET button to display SAVE, and then save the settings by pressing the SET button again.


To cancel the settings

When SAVE is displayed, use the ⊕and buttons to select CANL and then press the (SET) button to cancel the settings.



SET

6Setting menu

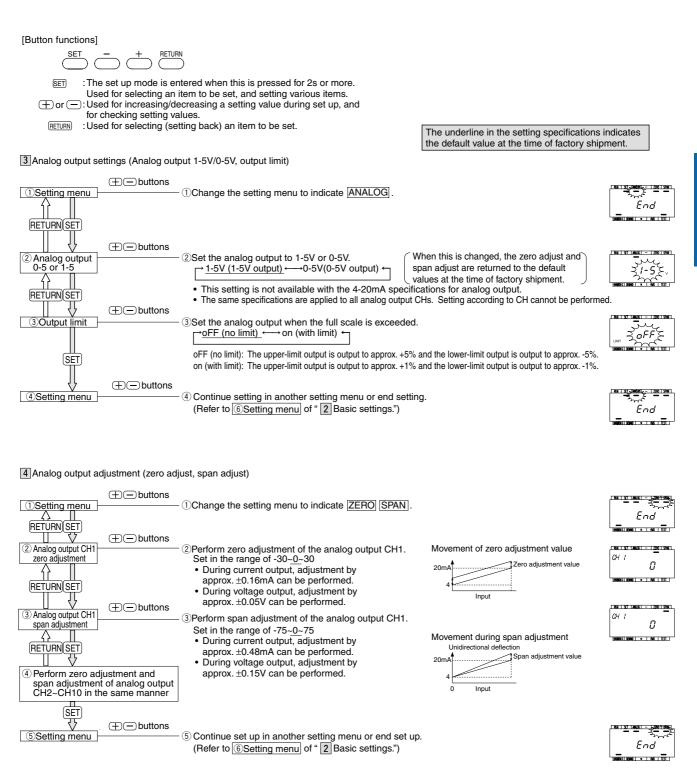




Special Application Transducers

T-120HA harmonics transducers [Insulated]

Setting method

SET

4 Setting menu

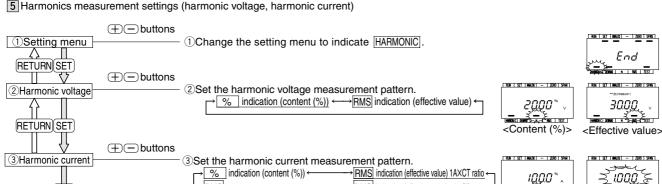

(4) Continue set up in another setting menu or end set up.

RMS indication (effective value) 3AXCT ratio

(Refer to 6 Setting menu of "2 Basic settings.")

RMS indication (effective value) 5AXCT ratio ←








<Content (%)>

6 Demand time interval setting (harmonic demand time interval)

⊕ buttons

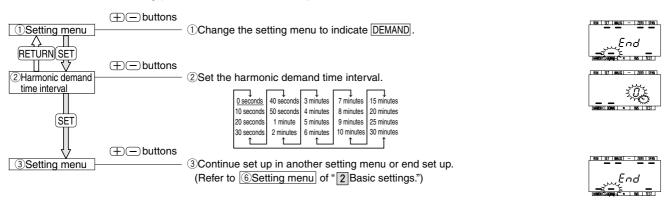




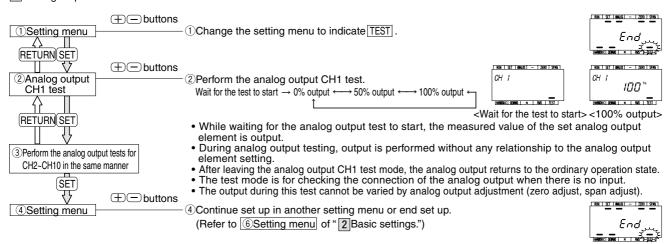


Remarks: Refer to "Operation method" on p.166 regarding the method for checking settings.

Outer dimensions, and names and functions of respective parts

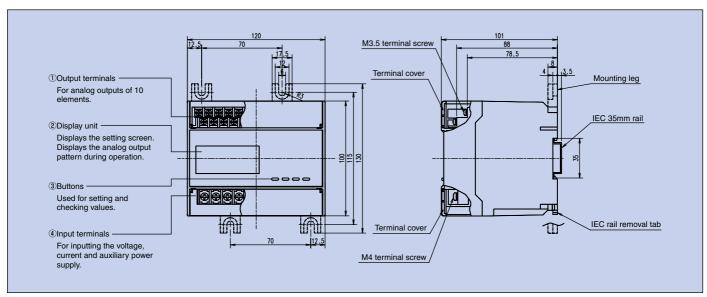

■Connection diagrams

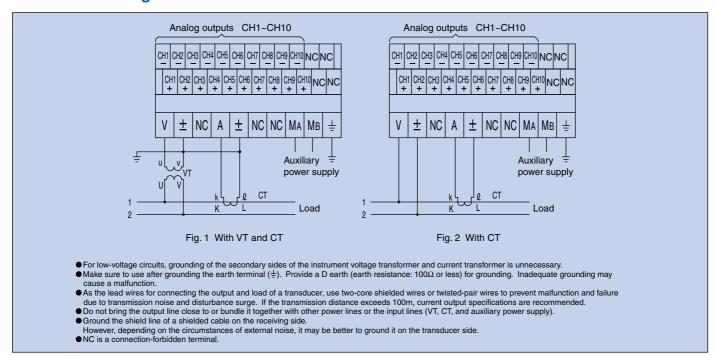

■Ordering method

| Model name | Output | Niumbar of unita |
|------------|--------------------|------------------|
| | Voltage or current | Number of units |
| T-120HA | 4~20mA | 5 |

Special Application Transducers

Active power/active energy transducers [Insulated]

■Applications

Needs for measuring power and electric energy in various power generating equipment and factory production lines, monitoring operating conditions of power generating equipment, ascertaining generated active electric energy, and performing energy-specific unit management of factory production lines are increasing in recent years.

Needs for detailed monitoring of electricity usage quantities according to respective divisions for carrying out factory energy-saving measures and ascertaining the results of energy-saving measures are also increasing.

The Mitsubishi Electric T-51WWH transducer can be used for such applications.



■Features


Compact and lightweight

- The outer dimensions are 50(W)×100(H)×118mm(D).
- Weights only 0.5kg.
 Does not take up mounting space.


Dual output of active power and active electric energy

- Can measure the active power and active electric energy of a circuit and deliver two outputs with one unit. A signal of 4~20mA DC is output for active power and a pulse signal is output for active electric energy.
- Less expensive, more compact and more space-saving than a watthour meter and active power transducer combination.

■Usage examples

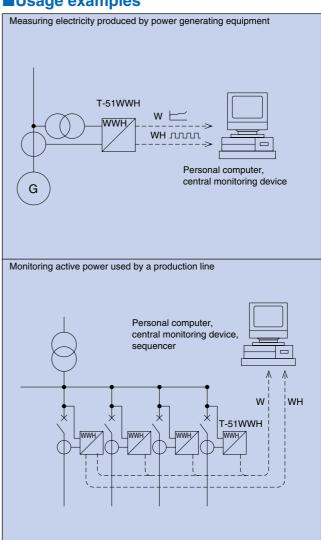

Outer dimensions

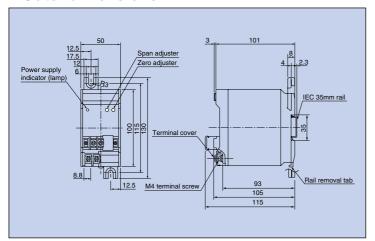

■Specifications

| Item | Specif | ication |
|------------------------|--|--|
| Model name | T-51\ | wwh |
| Measurement element | Power | Electric energy |
| Input range | 0~1000W (for 110V 5A input) | |
| Input range | 0~2000W (for 220V 5A input) | |
| Phase-wire system | 3-phase, 3-wire system or 1-phase, 3-wir | e system (Please specify when ordering) |
| Ratings | 110V 5A 50-60Hz or 220V 5A 50-6 | 0Hz (Please specify when ordering) |
| Output | 4~20mA DC (analog output) Load resistance: 0~525Ω | (1) Pulse unit: □kWh/P (primary side) (2) Pulse output ①Output form : open collector ②Output current : IoL 30mA max ③Withstand voltage between collector and emitter : VcE 35V max ④Pulse width : 100~150ms ⑤Leakage current : 100 μA or less (VcE=35V) (3) Measure only in positive direction |
| Accuracy | 0.5 | (Normal) |
| Auxiliary power supply | Unnecessary (supplied from input | voltage between P1~P3, load: 5VA) |
| Weight | 0.5 | 5kg |
| Consumption VA | Current circuit I ₁ 0.1VA I ₃ 0.1VA | Voltage circuit P ₁ -P ₂ 2.5VA P ₂ -P ₃ 2.5VA |


■Manufacturable range

(1) Secondary side (available) power value

| Input | Secondary side power value (available power value) | | | | | | | |
|---------|--|---|--|--|--|--|--|--|
| input | Standard specifications | Manufacturable range | | | | | | |
| 110V 5A | 0-1000W (standard specification) | VT, CT secondary-side power value: 500~1200W | | | | | | |
| 220V 5A | 0-2000W (standard specification) | VT, CT secondary-side power value: 1000~2400W | | | | | | |

*VT, CT secondary side power value= $\frac{\text{primary-side power value (W)}}{\text{VCT ratio}}$

■Connection diagram

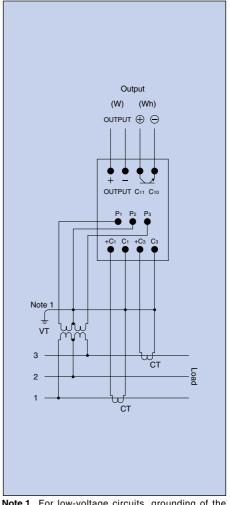

Note 1. For low-voltage circuits, grounding of the secondary sides of the instrument voltage transformer and current transformer is unnecessary.


(2) Pulse unit \cdots Specify from among three of pulse units according to the full-load active power

| Full-load active power (kw) | 1~less than 10kW | 10~less than 100kW | 100~less than 1000kW | 1000~less than 10000kW | 10000~less than 100000kW |
|-----------------------------|-------------------------------------|---------------------------------|-------------------------------|-------------------------------|----------------------------------|
| Pulse unit (specify) | 0.001kWh/P 0.01kWh/P 0.1kWh/P | 0.01kWh/P 0.1kWh/P 1kWh/P | 0.1kWh/P 1kWh/P 10kWh/P | 1kWh/P 10kWh/P 100kWh/P | 10kWh/P 100kWh/P 1000kWh/P |

Example: 3-phase, 3-wire 200V 100/5A circuit

Full-load active power = $\frac{\sqrt{3} \times 200 \times 100}{1000}$ =34.6kW Based on the above table, specify from among 0.01kWh/P, 0.1kWh/P and 1kWh/P.

Accessories



■Ordering method

| Model name | Phase-wire | VT ratio | CT ratio | Primary side power value | Output | Output pulse unit | Number of units |
|------------|------------|----------|----------|--------------------------|-----------|----------------------|-----------------|
| T-51WWH | 3P3W | 440/110V | 750/5A | 0~600kW | 4~20mA DC | 1kWh/P | 3 |

— For △-Y connection, please specify as such.

Usage/Care/Storage/Request for

Usage

- Install transducers in panels and use them as interface equipment for inputting DC signals corresponding to items measured
 into various devices such as central monitor panels, data loggers and measuring equipment.
- Transducers do not have any particular items requiring operation.

Care

During periodic maintenance that accompanies power interruption, use a soft cloth to wipe off the dust and debris that collects on the surface of the transducer.

In the case of severe soiling, dip a cloth in a neutral detergent diluted with water, wring well, and then wipe the transducer surface. Do not wipe using a chemically-treated dust cloth or cleanser such as benzene or thinner, otherwise discoloration or deformation of the surface may occur.

Storage

Store transducers according to the following procedures. Removal work is to be performed by a person with proper technological expertise in electric works.

1 Removing a transducer

- Turn off the power to the circuits (input, auxiliary power) connected to the transducer. Confirm that no voltage is applied.
- •Use a screwdriver to loosen and remove the terminal screws of the transducer.
- •Perform the "Method for mounting" procedure on p.151 in reverse to remove the transducer.

2 Storage

For storage, refer to section 8 on p.109.

Maintenance and Inspection

Request for maintenance and inspection

Perform maintenance and inspection as below to ensure continued use of transducers. (Inspection while power is interrupted must be performed either every six months or every year.)

1 Daily inspection

- Are there any broken parts in the outer peripheral portion?
- •Are there any abnormal noises or odors?
- Have debris, dust or water drops accumulated?
- •For the T-51 and T-101 series, is the power-on indicator lamp lit?
- •For the T-120 series, is there any abnormality in the LCD screen?
- •Is there any indication, record or alarm related to abnormal measurement data in central monitor, data logger or measurement equipment, that receives transducer output signals?

2 Periodic inspection

Inspect the following in addition to the above.

- •Is there any abnormality in the output of the transducer? (Check during inspection of receiving/transforming equipment or plant.)
- Are any of the terminal screws loose? (Before performing this check, ensure that equipment is in the power interrupted state.)
- Is there any overheating or deformation due to stress to various components such as the terminals or outer casing?

Refer to "Checking output" on p.155 concerning inspection procedures.

Performance

| Classification | | | Power transducers | | | | | | | | |
|------------------|---|---|---|---|----------------------------|--------------------------|-----------------------------------|---------|--|--|--|
| Product name | | | Current transducers | | Voltage tra | ansducers | Active powe | | | | |
| Model Box | | | T-51KAA T-51KSS T-51HAA T-51HSS | T-101SAA | T-51KAV T-51HAV | T-101SAV | T-101HW | T-101SW | | | |
| Grade | | 0.5 | 0.25 | 0.5 | 0.25 | 0.5 | 0.25 | | | | |
| | Tolerance | % with respect to basal value | ±0.5% | ±0.25% | ±0.5% | ±0.25% | ±0.5% | ±0.25% | | | |
| | Influence of temperature | % with respect to basal value upon change of ±10° from 23°C | ±0.5% | ±0.25% | ±0.5% | ±0.25% | ±0.5% | ±0.25% | | | |
| | Influence of frequency *1 | % with respect to basal value upon change of ±5% from rated frequency | ±0.25% (both) | ±0.13% | ±0.25% (both) | ±0.13% | ±0.25% (both) | ±0.13% | | | |
| | Influence of voltage | % with respect to basal value upon change of ±10% from rated voltage | _ | _ | _ | _ | ±0.25% | ±0.13% | | | |
| | Influence of current | % with respect to basal value upon change of 20% and 120% of the rating from rated frequency | _ | _ | _ | _ | _ | _ | | | |
| Performance | Influence of power factor (reactive factor) | % with respect to basal value upon change from a power factor (reactive factor) of 1 to a LAG and LEAD of 0.5 each | _ | _ | _ | _ | ±0.5% | ±0.25% | | | |
| | Continuous overload | | 120% of rated input value | | 120% of rate | ed input value | 120% of rated | | | | |
| | 1.5 times rated voltage | | | | Supply electricity | | Supply electricity | | | | |
| | Instantaneous overload | | Supply electricity for 10s duration | | 10 times at | 10s intervals | 10 times at Supply electricity | | | | |
| | (input) | 2 times rated current 10 times at 10s intervals Supply electricity for 3s duration | | | _ | _ | 10 times at Supply electricit | | | | |
| | | 10 times rated current | | min intervals | _ | _ | 5 times at 5 | | | | |
| | | between electric circuit and outer casing | 2000VAC for 1min | | | | | | | | |
| | Withstand | Itage between input circuit and output circuit | 2000VAC for 1min (units without an auxiliary power supply are excluded) | | | | | | | | |
| | voltage | | 2000VAC for 1min | | | | | | | | |
| | | between output circuit and auxiliary power supply | 2000VAC for 1min (units without an auxiliary power supply are excluded) | | | | | | | | |
| | Insulation resistance | Test voltage: 500VDC | $10M\Omega$ or more (at relative humidity of 80% or less) | | | | | | | | |
| | Noise | Auxiliary power supply | | | ±1500V, puls | se width: 1 µs | | | | | |
| | resistance | Input | | ±1500V, | pulse width: 1μ s (cur | rrent input circuits are | e exempt) | | | | |
| | Impa | ct resistance | 490m/s² (50G), in 3 directions, 6 times with mounting legs mounted | | | | | | | | |
| | Vibration resistance | | 16.7Hz, double a | 16.7Hz, double amplitude 4mm, in 3 directions, 1h each (corresponding to approx. 2.2G) with mounting legs mounted | | | | | | | |
| Usage conditions | Usage te | mperature range | | -10 | ~50°C (daily mean te | emperature: 35°C or le | ess) | | | | |
| ge con | Storage to | emperature range | | | -20~ | 60°C | | | | | |
| Usa | | Humidity | | | 30~85% rela | ative humidity | | | | | |

^{*1} For models with the "both" specified, the % with respect to basal value that is the maximum value of the mutual difference between output values when the frequency is changed from 45 to 65Hz.

| | | | ı | Power transducers | | | | | |
|---|-------------------|-------------------------|-----------------------------------|-----------------------|---|---------------------|---------------------------------------|-------------------|--|
| Reactive power | er transducers | Phase angle | transducers | Power-factor | transducers | Frequency | Voltage phase angle transducers | | |
| T-101HVAR | T-101SVAR | T-101HPA T-101HPA(U) | T-101SPA(U) | T-101HPF(U) | T-101SPF(U) | T-51HF | T-101SF | T-101SY | |
| 0.5 | 0.25 | 2.0 | 1.0 | 3.0 | 2.0 | 1.0 | 0.5 | 1.0 | |
| ±0.5% ±0.25 | | ±2% (±2.4°) | ±1% (±1.2°) | ±3% | ±2% | ±1% (±0.1Hz) | ±0.5% (±0.05Hz) | ±1% (±1.2°) | |
| ±0.5% | ±0.25 | ±2% (±2.4°) | ±1% (±1.2°) | ±3% | ±2% | ±1% (±0.1Hz) | ±0.5% (±0.05Hz) | ±0.7% (±0.84°) | |
| ±0.25% (both) | ±0.13% | ±1% (±1.2°) | ±0.5% (±0.6°) | ±1.5% | ±1% | _ | _ | ±0.5% (±0.6°) | |
| ±0.25% | ±0.13% | ±1% (±1.2°) | ±0.5% (±0.6°) | ±1.5% | ±1% | ±0.5% (±0.05Hz) | ±0.25% (±0.025Hz) | ±0.5% (±0.6°) | |
| _ | _ | ±2% (±2.4°) | ±1% (±1.2°) | ±3% | ±2% | _ | _ | _ | |
| ±0.5% | ±0.25% | _ | _ | _ | _ | _ | _ | _ | |
| 120% of rated | l input voltage | 120% | of rated input volta | ge, 120% of rated | current | 1: | 20% of rated voltag | ge | |
| Supply electricity | | Supply ele | ectricity for 10s dura | ation 10 times at 10 | Supply electricity for 10s duration 10 times at 10s | | | | |
| Supply electricity | | Supply ele | ectricity for 10s dura | ation 10 times at 10 |)s intervals | _ | | | |
| Supply electricity | y for 3s duration | Supply el | ectricity for 3s dura | tion 5 times at 5mi | n intervals | _ | | | |
| 5 times at 5r | nin intervais | 117 | | 2000VAC for 1min | | | | | |
| | | | | 2000VAC for 1min | | | | | |
| | | | | 2000VAC for 1min | | | | | |
| 2000VAC for 1min | | | | | | | | | |
| | | | | at relative humidity | | | | | |
| ± 1500 V, pulse width: 1 μ s | | | | | | | | | |
| | | | ±1500V, pulse widt | | | | | | |
| | 10 = 11 . | | /s ² (50G), in 3 direc | | | | | | |
| | 16.7Hz, dou | ble amplitude 4mn | n, in 3 directions, 1h | | | a) with mounting le | egs mounted | | |
| -10~50°C (daily mean temperature: 35°C or less) | | | | | | | | | |
| -20~60°C 30~85% relative humidity | | | | | | | | | |
| | | | 30~ | OO /O TOIGUVE HUITIII | uny | | | | |

 $^{^{\}star}2$ The performance value of the phase angle transducer in parenthesis () corresponds to input conversion values for inputs of LEAD 60° ~0~LAG 60° .

^{*3} The performance value of the frequency transducer in parenthesis () corresponds to input conversion values for inputs of 45 to 55Hz or 55 to 65Hz.

^{*4} The performance value of the voltage phase angle transducer in parenthesis () corresponds to input conversion values for inputs of LEAD 60°~0~LAG 60°.



| Classification | | | Power transducers | | | | | | | | | | | | |
|------------------|---------------------------------------|-------------------|--|---|--|-----------|----------------|--------------|-----------------|-------------------------|--------------|---------|-------------|-------------|--|
| | | Product name | | DC level volta | DC reverse voltage | | High- speed | Limiter | Adders | Temperature transducers | | | | First-order | |
| | | | | transducers | 130141013 | isolators | Limiter | 7.000.0 | Resistance bulb | | Thermocouple | | transducers | | |
| | Model name | Box | | T-51DL | T-51DR | T-101IS | T-101ISQ | T-51LM | T-101AD | T-51TP | T-101TPZ | T-101TC | T-101TCZ | T-51DS | |
| | Grade | | 0.25 | 0.25 | 0.25 | 0.25 | 0.25 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | | |
| | Tolera | ınce | % with respect to basal value | ±0.25% | ±0.25% | ±0.25% | ±0.25% | ±0.25% | ±0.5% | ±0.5% | ±0.5% | ±0.5% | ±0.5% | ±0.5% | |
| | | nce of erature | % with respect to basal value upon change of ±10° from 23°C | ±0.25% | ±0.25% | ±0.25% | ±0.25% | ±0.25% | ±0.5% | ±0.5% | ±0.5% | ±0.5% | ±0.5% | ±0.5% | |
| | | nce of ency *1 | % with respect to basal value upon change of ±5% from rated frequency | _ | _ | _ | _ | _ | _ | _ | _ | _ | _ | _ | |
| ance | voltag | nce of le | % with respect to basal value upon change of ±10% from rated voltage | _ | _ | _ | _ | _ | _ | _ | _ | _ | _ | _ | |
| Performance | Continuous overload | | | | | | 120% | of rated inp | ut value | | | | | | |
| Perf | Instantaneous 1.5 times rated voltage | | Supply electricity for 10s duration 10 times at 10s intervals (temperature transducers excluded) | | | | | | | | | | | | |
| | overlo | ad | 2 times rated current | | Supply electricity for 10s duration 10 times at 10s intervals (temperature transducers excluded) | | | | | | | | | | |
| | | | between electric circuit and outer casing | | 2000VAC for 1min *2 | | | | | | | | | | |
| | Withst | tand | between input circuit and auxiliary power supply | | 2000VAC for 1min | | | | | | | | | | |
| | voltag | je | between input circuit and output circuit | 2000VAC/DC 2000VAC/DC for 1min | | | | | | | _ | | | | |
| | | | between output circuit and auxiliary power supply | | | | | | | | | | | | |
| | Insula | ition ance | Test voltage: 500VDC | 10M Ω or more (at relative humidity of 80% or less) | | | | | | | | | | | |
| | Noise | | Auxiliary power supply | | | | | ±1500 | V, pulse wid | dth: 1 <i>µ</i> s | | | | | |
| | resista | ance | Input | | | ±50 | 00V, pulse w | idth: 1µs (c | urrent inpu | t specificati | ons are exe | mpt) | | | |
| | Impact resistance | | | 490m/s² (50G), in 3 directions, 6 times with mounting legs mounted | | | | | | | | | | | |
| | Vibration resistance | | 16.7Hz | 16.7Hz, double amplitude 4mm, in 3 directions, 1h each (corresponding to approx. 2.2G) with mounting legs mounted | | | | | | | | | | | |
| itions | U | Jsage te | mperature range | | | | -10~50 | °C (daily m | ean temper | ature: 35°C | or less) | | | | |
| Usage conditions | S | torage te | emperature range | | | | | | -20~60°C | | | | | | |
| Usage | | H | Humidity | | | | | 30~85 | % relative h | numidity | | | | | |

^{*1} For models with the "both" specified, the % with respect to basal value that is the maximum value of the mutual difference between output values when the frequency is changed from 45 to 65Hz.


| Peripheral transducers | | | | | | | | | |
|--|----------------------------------|---|--|--|--|--|--|--|--|
| AC current demand transducers transducers (moderate time interval) AC voltage demand transducers (moderate time interval) | | Current transducers with power flow detection | Leakage current transducers | Voltage drop detectors Voltage rise detectors | | | | | |
| T-101HAA(DS) T-101HAV(DS) | | T-101HAA(D) | T-51LG T-51LGF | T-101VDL T-101VDH | | | | | |
| 0.5 | 0.5 | 0.5 | 1.0 | _ | | | | | |
| ±0.5% ±0.5% | | ±0.5% | ±1.0% | setting accuracy ±5% | | | | | |
| ±0.5% | ±0.5% | ±0.5% | ±1.0% | _ | | | | | |
| ±0.25% (both) | ±0.25% (both) | ±0.25% (both) | ±1.0% *3 | _ | | | | | |
| - | _ | ±0.25% | - | _ | | | | | |
| 120% of rated input value | | | | | | | | | |
| | Supply electricity for 10s durat | ion 10 times at 10s intervals (temp | perature transducers excluded) | | | | | | |
| | Supply electricity for 10s durat | ion 10 times at 10s intervals (temp | perature transducers excluded) | | | | | | |
| | | 2000VAC for 1min | | | | | | | |
| | | 2000VAC for 1min | | | | | | | |
| | 2000VAC/DC for 1min (i | n combination with a ZCT for leak | age current transducers) | | | | | | |
| | | 2000VAC for 1min | | | | | | | |
| | 10ΜΩ ο | r more (at relative humidity of 80% | or less) | | | | | | |
| | +1500V pulse | ±1500V, pulse width: 1μs | fucers exempt) | | | | | | |
| ±1500V, pulse width: 1 µs (leakage current transducers exempt) 490m/s² (50G), in 3 directions, 6 times with mounting legs mounted | | | | | | | | | |
| 16.7Hz, | | ctions, 1h each (corresponding to a | | mounted | | | | | |
| , | <u> </u> | °C (daily mean temperature: 35°C | ·· · · · · · · · · · · · · · · · · · · | | | | | | |
| | | -20~60°C | | | | | | | |
| | | 30~85% relative humidity | | | | | | | |
| ** F== T==1 O +l== 0/itle == | | | | | | | | | |


^{*2} For T-51LG, the % with respect to basal value that is the maximum value of the mutual difference between output values when the frequency is changed from 40 to 2kHz.

For T-51LGF, the % with respect to basal value that is the maximum value of the mutual difference between output values when the frequency is changed from 45 to 60Hz.


Overall Connection Diagrams

Fixed-load output (K Series)

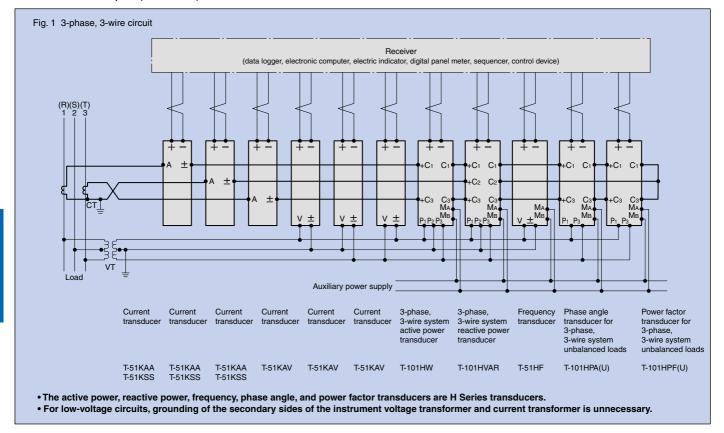


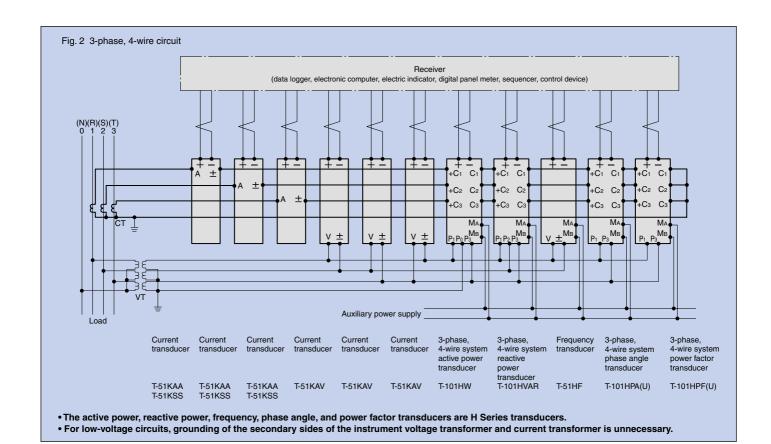

●Constant-current/Constant-voltage output (H Series, S Series)

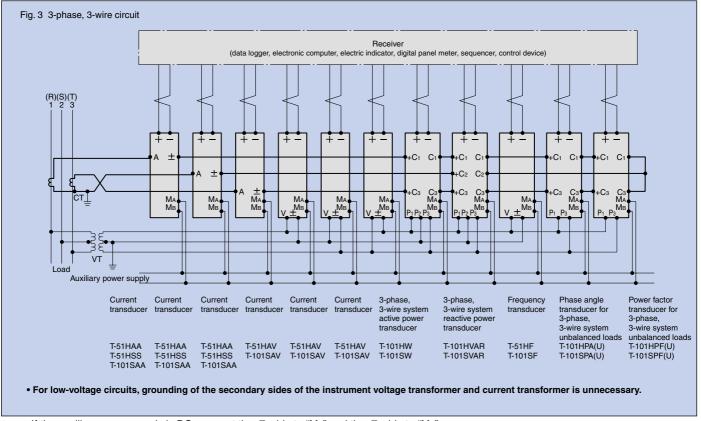

If the auxiliary power supply is DC, connect the \oplus side to "Ma" and the \ominus side to "MB".

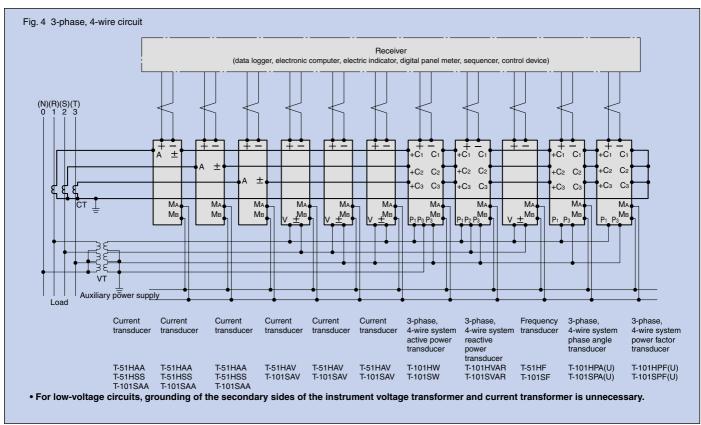

If the auxiliary power supply is DC, connect the \oplus side to "Ma" and the \ominus side to "MB".

Glossary of Terms

Fixed-load output


An output system that can be used only with the load resistance value connected to the output being a single, predetermined value and with which an error occurs if the load resistance value differs from the specified value.

Constant-voltage output/Constant-current output

An output system that can be used if the load resistance value connected to the output is within a predefined range, and is suited for cases where the load resistance value is unspecified and cases where future load increase is predicted.

Load

The full load resistance value connected to the output terminals of a transducer.

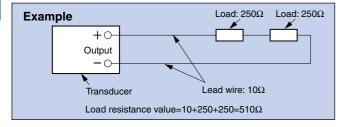

Output span

The difference between the upper-limit value and lower-limit value of an effective output range.

Example 1: For an output of 5V, the span is 5V.


Example 2: For an output of 4~20mA, the span is 16mA.

Example 3: For an output of -5~0~5V, the span refers respectively to the + side span of +5V and the – side span of -5V.

Auxiliary power supply (control power supply)

An AC power supply or DC power supply necessary for operation of the transducer and supplied from the exterior (i.e., not supplied from the measured circuit). If the voltage of the measured circuit is comparatively stable, it can be used for connection to the auxiliary power-supply terminals.

Example: Connection to auxiliary power supply from a measured circuit.

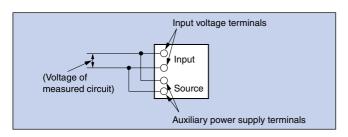


Accuracy (grade)

A term expressing the accuracy of a transducer classified according to the tolerance and limits of influence (influence of temperature, influence of frequency and other allowable limits of performance).

Example: The tolerance of a grade 0.5 transducer is within $\pm 0.5\%$. The tolerance for an input of 1000W and output of 5V is: $5V\times(\pm 0.5\%)=\pm 25mV$.

Output ripple (P-P)


An AC component contained in the output expressed by a ratio of the peak-to-peak value of the AC component and the span.

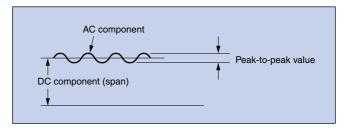

Response time


The time it takes for the output to settle within a specified range of a final stationary value when the input changes suddenly from one fixed value to another.

Ordinarily refers to the time it takes for the output to settle within $\pm 1\%$ of the rated output value centered at a final output value when a step input that gives rise to an output change of from 0% to approximately 90% of the effective output range or from 100% to approximately 10% of the effective output range is applied.



Effective output range

A range within the output range in which predefined performance is guaranteed.




The diagram to the left is an input-output characteristics diagram for T-51KSS and T-51HSS. The effective output range is 0~0.8mA (the output range of 0.8~1mA is not an effective output range).

Saturation output

Although the output in the range 0~0.8mA is proportional to the input in the diagram above, the proportion of change of output gradually decreases and saturates with respect to the proportion of change of input in the 0.8~1mA region. Such an output is called "saturation output".

3-phase balanced circuit

When loads $\dot{Z}a$, $\dot{Z}b$ and $\dot{Z}c$ that are connected to a 3-phase power supply are all equal, the respective voltages \dot{V}_{RS} , \dot{V}_{ST} and \dot{V}_{TR} are all equal in magnitude and phase difference among the respective voltages. The respective line currents \dot{I}_{R} , \dot{I}_{S} and \dot{I}_{T} are also all equal in magnitude and phase difference. Such a circuit is called a 3-phase balanced circuit.

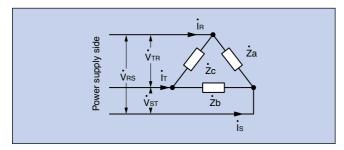

•3-phase unbalanced loads


When loads $\dot{Z}a$, $\dot{Z}b$ and $\dot{Z}c$ that are connected to a 3-phase power supply are not equal, the respective line currents \dot{I}_{R} , \dot{I}_{S} and \dot{I}_{T} are also not equal in magnitude and phase difference among the respective currents. Such loads are called 3-phase unbalanced loads.

Among phase angle transducers, there are those that can be used with 3-phase unbalanced loads (for 3-phase unbalanced loads) and those that cannot be used with 3phase unbalanced loads (for 3-phase balanced circuit).

Third harmonic

A voltage or a current with frequency that is 3 times that of the fundamental frequency voltage or current (fundamental wave: a 60Hz AC voltage or current in the case of an input frequency of 60Hz).

When a third harmonic or other harmonic is contained, the waveform becomes distorted and becomes a cause of measurement error.

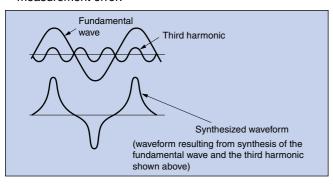

Burnout


A term often used with temperature transducers and refers to a function by which, when an input line into the temperature transducer or a temperature sensor beyond the input line, becomes disconnected, the output is rises above the effective output range (normally, the output is increased ... positive burnout).

Cold junction compensator

A thermocouple sensor's electromotive force is input to a thermocouple temperature transducer. The voltage corresponds to a temperature less than T°C, the temperature measured at the point only affected by the ambient temperature, Ta°C, thereby compensating for the Ta°C part. This action is performed by a cold junction compensator, which is either attached externally to the transducer or built-in.


Zero adjuster

With a zero adjuster, the output range is increased or decreased by a fixed value (approximately ±0.3~±5% with respect to the span) as shown in the figure below.



Span adjuster

With a span adjuster, the output increases or decreases at the same proportion (±3%~±15% with respect to the rated output) with zero input as the base point.



Mitsubishi Electric Indicators and Transducers

| Country/Region | Sales office | Tel/Fax |
|----------------|---|--|
| USA | Mitsubishi Electric Automation Inc. 500 Corporate Woods Parkway Vernon Hills, IL 60061, USA | Tel:+1-847-478-2100 Fax:+1-847-478-0327 |
| Brazil | MELCO-TEC Rep. Com.e Assessoria Tecnica Ltda. Av Paulista, 1439-Cj. 72 Cerqueira Cesar CEP 01311-200, Sao Paulo, SP, CEP:01311-200, Brazil | Tel: +55-11-3146-2200 Fax: +55-11-3146-2217 |
| Germany | Mitsubishi Electric Europe B.V. German Branch Gothaer Strasse 8 D-40880 Ratingen, Germany | Tel:+49-2102-486-0 Fax:+49-2102-486-1120 |
| UK | Mitsubishi Electric Europe B.V. UK Branch Travellers Lane, Hatfield, Hertfordshire., AL10 8XB, UK | Tel:+44-1707-276100 Fax:+44-1707-278992 |
| Italy | Mitsubishi Electric Europe B.V. Italy Branch Viale Colleoni 7-20041 Agrate Brianza (Milano), Italy | Tel: +39-039-60531 Fax: +39-039-6053312 |
| Spain | Mitsubishi Electric Europe B.V. Spanish Branch Carretera de Rubi 76-80 E-08190 Sant Cugat del Valles (Barcelona), Spain | Tel: +34-93-565-3131 Fax: +34-93-589-1579 |
| France | Mitsubishi Electric Europe B.V. French Branch 25, Boulevard des Bouvets, F-92741 Nanterre Cedex, France | Tel : +33-1-5568-5568 Fax : +33-1-5568-5757 |
| Czech Republic | Mitsubishi Electric Europe B.V. Czech Branch Avenir Business Park, Radlická 714/113a CZ-158 00 Praha 5 | Tel : +420-251-551-470 Fax : +420-251-551-471 |
| Poland | Mitsubishi Electric Europe B.V. Polish Branch ul. Krakowska 50 32-083 Balice, Poland | Tel: +48-12-630-47-00 Fax: +48-12-630-47-01 |
| Russia | Mitsubishi Electric Europe B.V. Moscow Office 52/3, Kosmodamianskaya nab., 115054, Moscow, Russia | Tel: +7-812-633-3497 Fax: +7-812-633-3499 |
| South Africa | Circuit Breaker Industries Ltd. Private Bag 2016, ZA-1600 Isando, South Africa | Tel: +27-11-928-2000 Fax: +27-11-392-2354 |
| China | Mitsubishi Electric Automation (China) Ltd. No.1386 Hongqiao Road, Mitsubishi Electric Automation Center Shanghai China, 200336 | Tel: +86-21-2322-3030 Fax: +86-21-2322-3000 |
| Taiwan | Setsuyo Enterprise Co., Ltd. 6F., No.105 Wu-Kung 3rd.Rd, Wu-Ku Hsiang, Taipei Hsine 248, Taiwan | Tel: +886-2-2299-2499 Fax: +886-2-2299-2509 |
| Korea | Mitsubishi Electric Automation Korea Co., Ltd. 1480-6, Gayang-dong, Gangseo-ku Seoul 157-200, Korea | Tel: +82-2-3660-9552 Fax: +82-2-3664-8372 |
| Singapore | Mitsubishi Electric Asia Pte, Ltd. 307 Alexandra Road #05-01/02, Mitsubishi Electric Building Singapore 159943 | Tel: +65-6470-2480 Fax: +65-6476-7439 |
| Thailand | Mitsubishi Electric Automation (Thailand) Co., Ltd. Bang-Chan Industrial Estate No.111 Soi Serithai 54, T.Kannayao, A.Kannayao, Bangkok 10230 Thailand | Tel: +66-2-517-1326 Fax: +66-2-517-1328 |
| Indonesia | P.T. Autoteknindo Sumber Makmur Muara Karang Selatan Block A/Utara No.1 Kav. No.11 Kawasan Industri/Pergudangan Jakarta-Utara 14440, P.O Box 5045 Jakarta 11050, Indonesia | Tel: +62-21-663-0833 Fax: +62-21-663-0832 |
| India | Messung Systems Pvt., Ltd. Electronic Sadan NO:III Unit No15, M.I.D.C Bhosari, Pune-411026, India | Tel: +91-20-2712-3130 Fax: +91-20-2712-8108 |
| Australia | Mitsubishi Electric Australia Pty. Ltd. 348 Victoria Road, Rydalmere, N.S.W 2116, Australia | Tel: +61-2-9684-7777 Fax: +61-2-9684-7245 |



Eco Changes is the Mitsubishi Electric Group's environmental statement, and expresses the Group's stance on environmental management. Through a wide range of businesses, we are helping contribute to the realization of a sustainable society.

MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE: TOKYO BUILDING, 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN